




INSTALLATION GUIDE

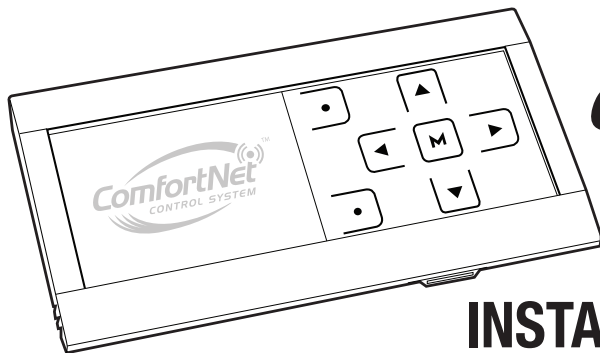


Prior to Installation, verify that the indoor and outdoor equipment are both ComfortNet™ compatible. The equipment manufacturer is not responsible for use of components not compatible with the ComfortNet system.

ComfortNet™ is a trademark of Goodman Manufacturing Company, L.P.
© 2011 Goodman Manufacturing Company, L.P.

NOTE: Refer to installation manual for detailed instructions.
Manual I/O-723 WR Manual 37-7242B


1

Remove and Inventory All ComfortNet™ Components

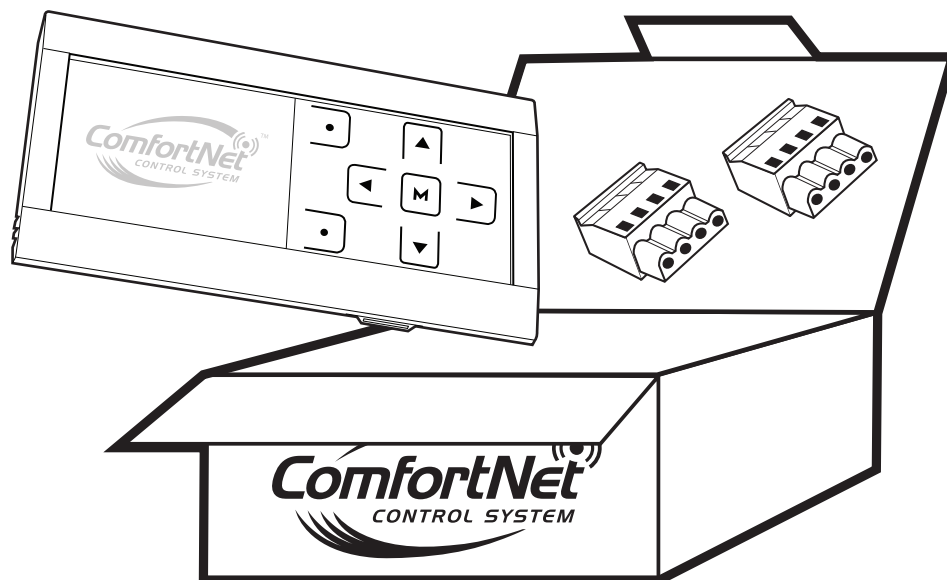


2

Install HVAC Components

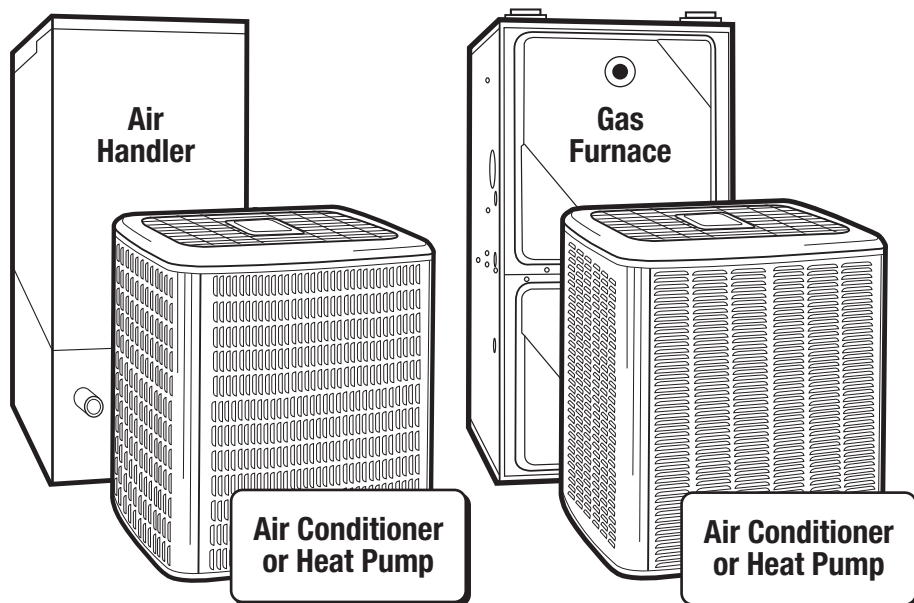

3


Remove 9-Pin Connector from Furnace or Air Handler Control

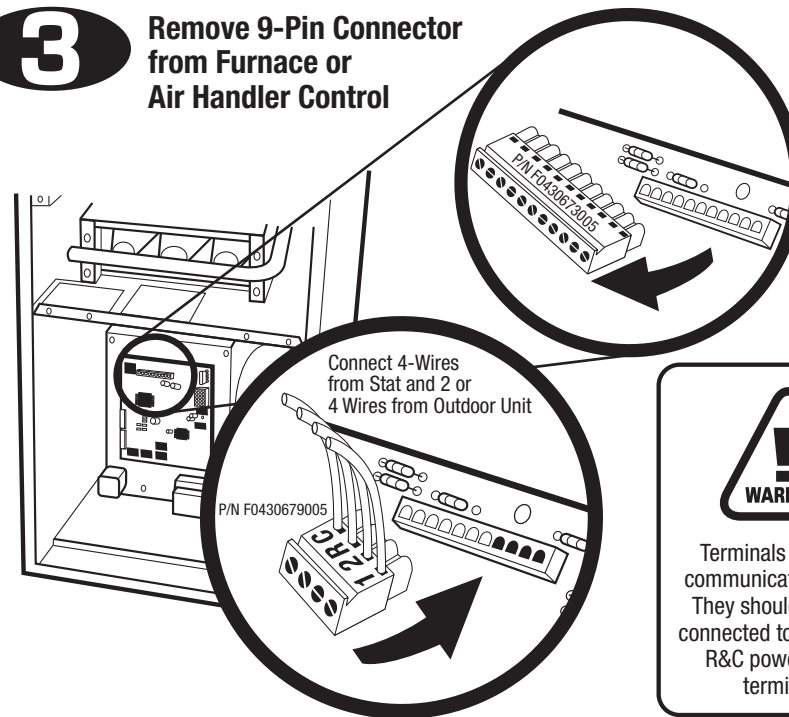


WARNING
Terminals 1 & 2 are communications wires. They should never be connected to the 24 VAC R&C power supply terminals.

4


**Remove Outdoor Unit Cover
and 7-Pin Connector**

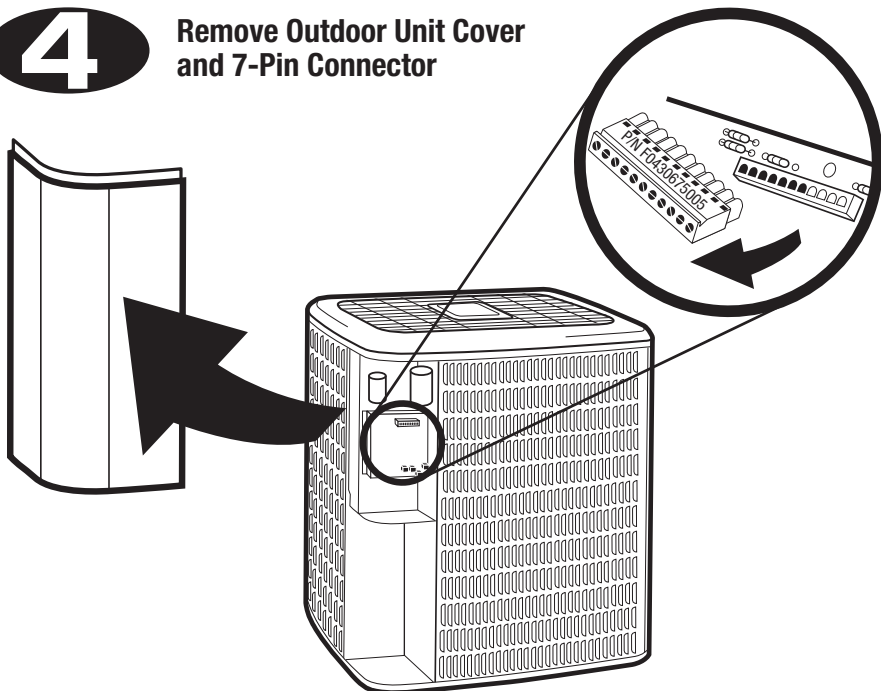**5**

**Two Ways to Connect to the Outdoor Unit
METHOD ONE: 4-WIRE CONNECTION**

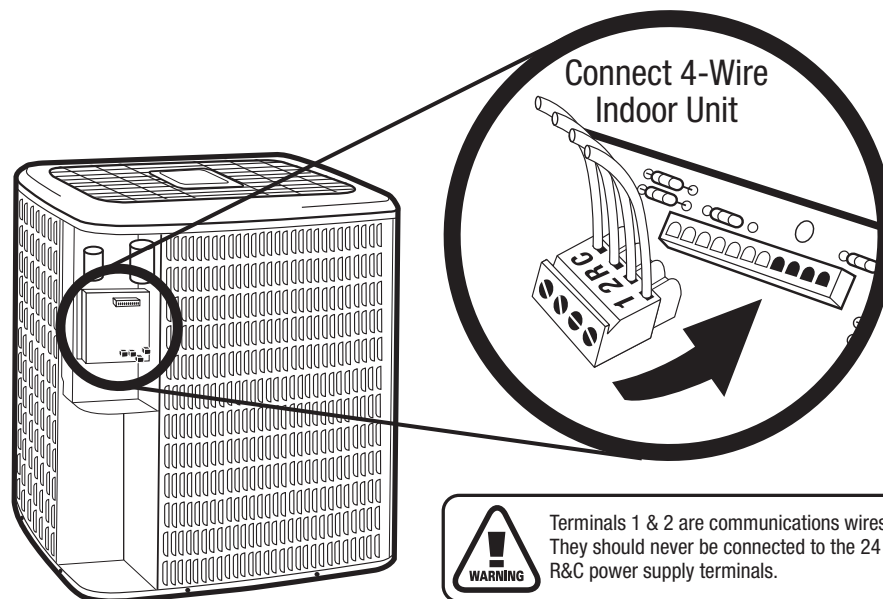**6**

**Two Ways to Connect to the Outdoor Unit
METHOD TWO: 2-WIRE/TRANSFORMER CONNECTION**

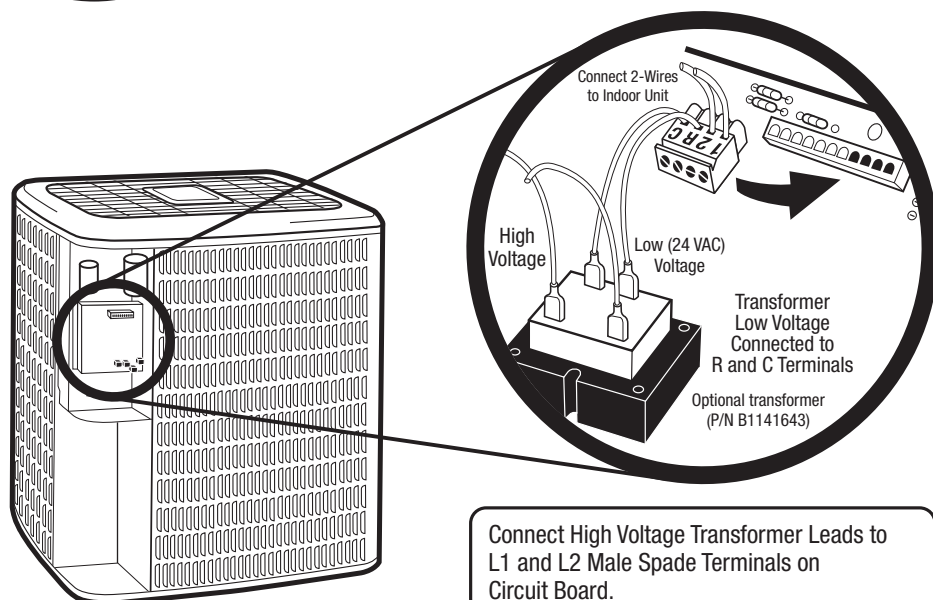**7**

Install Thermostat on Interior Wall

NOTE: Thermostat will automatically configure to the system once high voltage power is applied to the indoor and outdoor equipment.

