




## **McDaniel Metals, Inc.**


1318 Buschong  
Houston, Texas 77039  
Phone (281) 987-8400  
Fax (281) 987-9494

### Installation Instructions for PGMDH 101-103 & PGMDHM 101-103 MANUAL AND MOTORIZED FRESH AIR DAMPERS FOR GOODMAN / AMANA GPG/ APG GAS PACK 2-5 TON PACKAGE UNITS


1. OPEN UNIT DISSCONNECT SWITCH!
2. Remove blower access panel next to return air opening and save screws for use on damper panel.
3. Replace panel with fresh air damper using screws from step 2.
4. Adjust damper to desired level of fresh air.
5. Close disconnect switch.
6. For motorized dampers: follow steps 1-3, then proceed to step #7.
7. Mate control plugs.
8. Close disconnect switch.

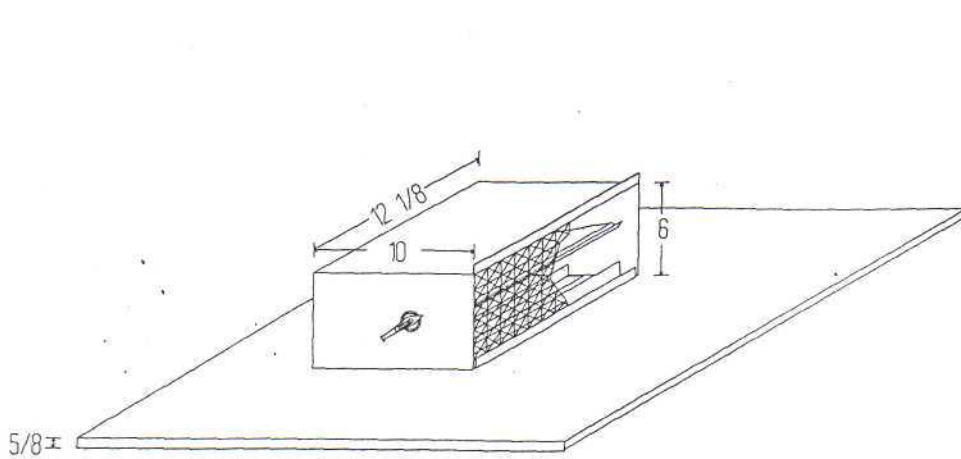

PGMDH101-103

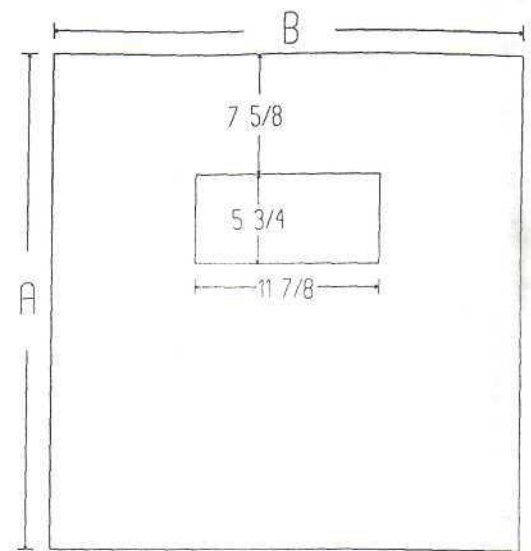

BOTTOM VIEW

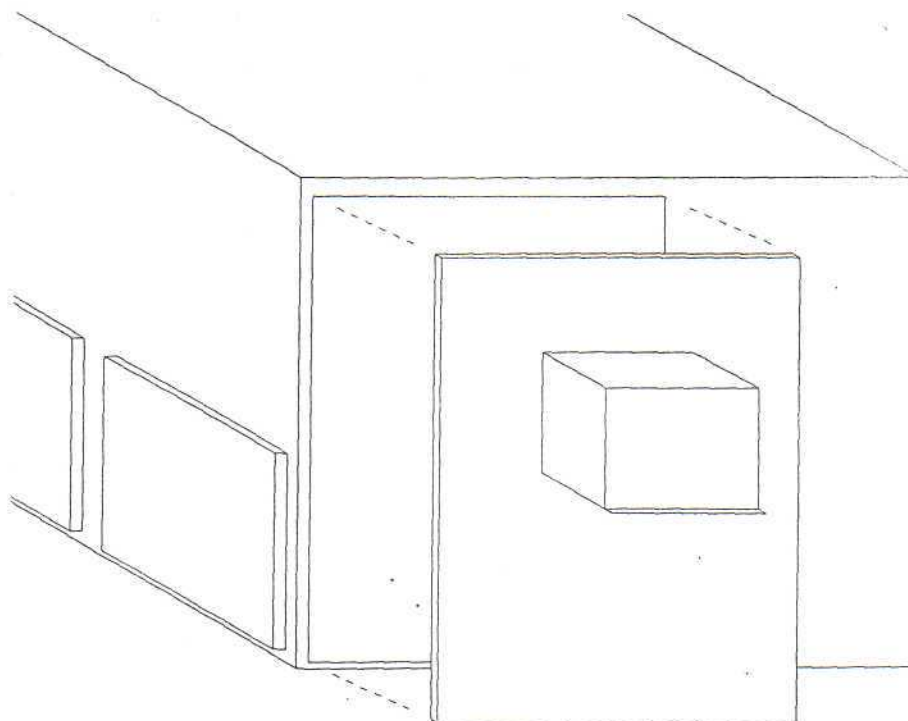

|          | A    | B     |
|----------|------|-------|
| PGMDH101 | 26.5 | 29.75 |
| PGMDH102 | 31.5 | 29.75 |
| PGMDH103 | 39   | 29.75 |