
Raychem[®]

QuickNet-RK QuickNet™ Heating Cable Repair Kit

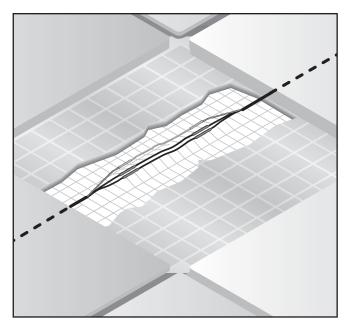

Installation Instructions

Description

The QuickNet-RK repair kit is for repairing heating cable that is damaged during installation of the QuickNet mat. The kit includes jumper wires to bridge the heating element after the damaged section is removed. The kit contents are sufficient to repair one damaged section up to 5 inches long. If more than 5 inches of cable has been damaged, the mat must be replaced.

Tools Required

- Wire Strippers 16-26 AWG
- Gloves
- Scissors

- Heat gun (1000°F air temp with heat deflector required)
- Multimeter (capable of 200K ohms)

Other Required Materials

- QuickNet System Installation Manual (H57704)
- QuickStat Thermostat Installation and Operation Manual (H57725)

Optional Tile Removal Tools

· Grout removal tool


Hammer

Approvals



Kit Contents:

| Item Qty | | Description |
|----------|---|-----------------------------|
| Α | 2 | Jumper wires (blue) |
| В | 6 | SolderSleeve® connectors |
| С | 4 | Heat-shrinkable tubing |
| D | 1 | Ground wire (non-insulated) |



WARRANTY & APPROVALS DISCLAIMER

The QuickNet-RK Repair Kit is for making minor repairs to the QuickNet heating cable if it is damaged during or after installation. Because the condition of the damaged mat, site conditions and installer capability can vary,

Tyco Thermal Controls does not warrant the repair or warrant that the repaired floor warrning system will function properly. Use of this kit voids the warranty of the repaired portion of the heating cable. Repairs

should only be attempted by a qualified electrician or experienced craftsmen familiar with good electrical practice and techniques for tile installation and removal. Contact Tyco Thermal Controls for assistance.

! WARNING:

WARNING: Shock and Fire Hazard.

If the QuickNet mat is damaged or not installed properly, fire or shock could occur resulting in serious personal injuries or damage to property. You must carefully follow the warnings and instructions contained in these instructions and the QuickNet Installation Manual (H57704). Contact Tyco Thermal Controls for assistance.

- The QuickStat thermostat must be used. It has a ground-fault circuit interrupter (GFCI) to prevent electric shock.
- The QuickNet-RK repair kit must be installed by qualified personnel familiar with generally accepted construction techniques and safe electrical practices. The installation must comply with all
- national and local electrical codes. If you are unfamiliar with these requirements, contact a licensed electrician.
- Electric wiring and the heating mat are installed in the floor. Be sure that the floor is not penetrated by nails, screws, or similar devices that can cause damage on first installation or during subsequent floor repairs in the future.
- Do not use this Repair Kit to splice different QuickNet mats together. It is designed only to repair a damaged section of heating cable in a single mat.
- The QuickNet heating cable cannot be cut to length, crossed over itself, or installed closer than the spacing in the mat.

- QuickNet mats can only be installed beneath ceramic tile or natural stone surfaces. Do not install beneath wooden, carpeted, linoleum, or other type floors.
- Do not step directly on or damage the heating cable during installation.
- Do not install the QuickNet mat across expansion joints.
- Follow the manufacturer's instructions for installing tiles, scratch coat, thin-set mortar, or quick drying mortar beds.
- Do not allow heating cable, cold lead, or floor temperature sensor to cross over themselves or each other.


1

• Turn off the power to the QuickNet floor warming system at the circuit breaker before starting any repair work.




2

 Disconnect the QuickNet cold leads, power wires and floor sensor leads from the the QuickStat Thermostat. This provides additional safety and allows for the testing required in later steps.

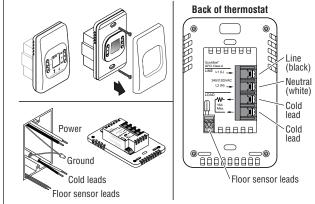


3

- If the damaged section has not been installed in mortar, proceed to Step 7.
- Remove the tile above the damaged section by removing the grout with a removal tool, being careful not to further damage the heating cable. Do not use a knife or chisel.

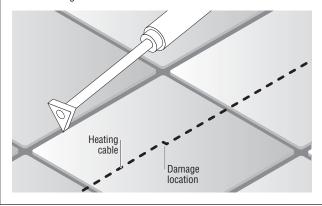


4

 Once the grout is removed, carefully break away the tile using a hammer.

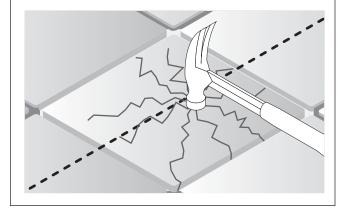


5


 Remove any broken tile and vacuum other debris from the exposed surface to locate the damaged heating cable section.

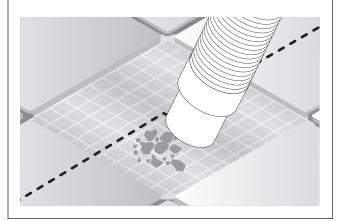

6

 To expose the damaged section, break mortar away from the heating cable with the hammer, making sure not to damage the cable.

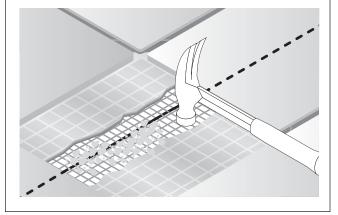


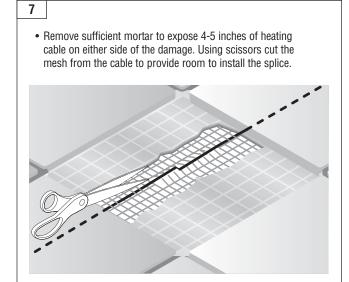



Remove at least 3 inches, and up to 5 inches of heating cable including the damaged section leaving two protruding ends of heating cable. If more than 5" of cable has been damaged, the mat must be replaced.


• Remove the damaged section.


Damaged section

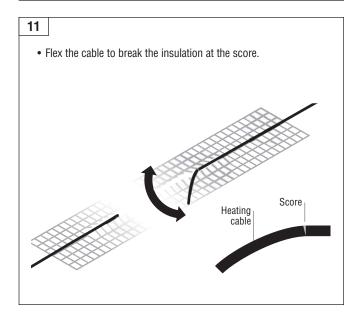


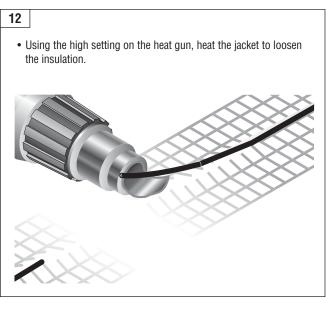


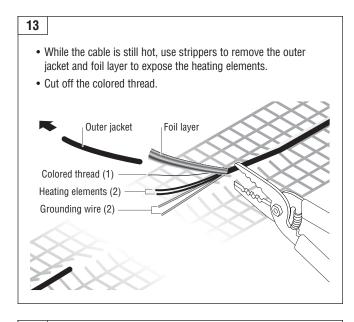


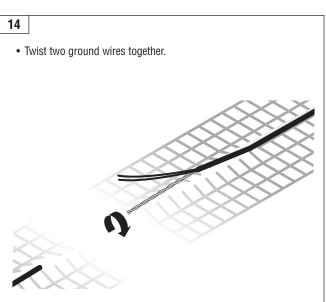


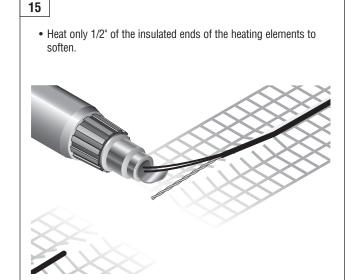


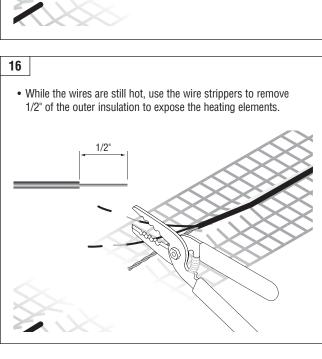


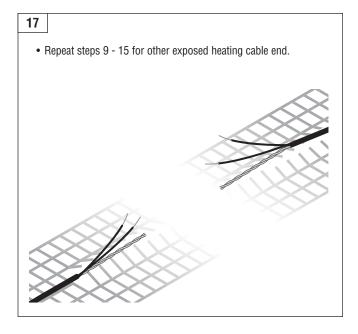


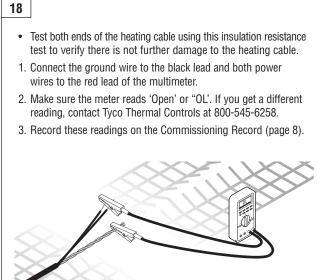


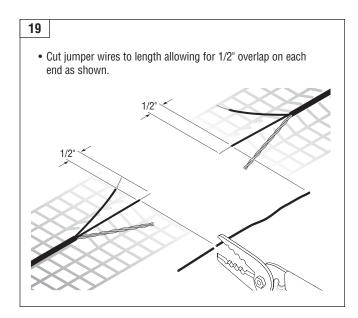


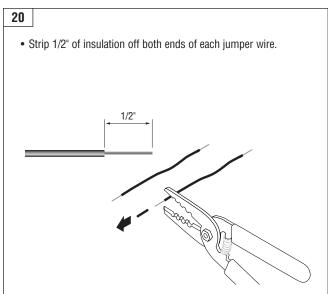

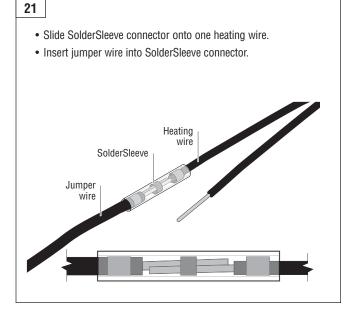


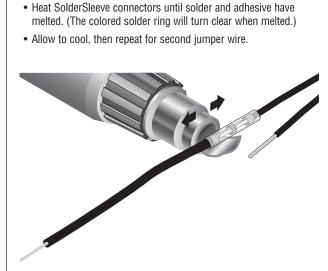


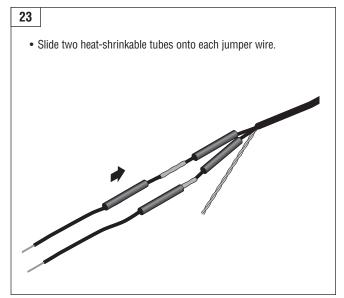

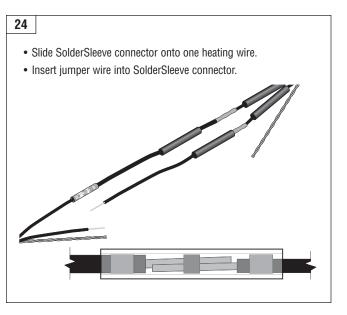



Heat SolderSleeve connectors until solder and adhesive have melted. Allow to cool, then repeat for second jumper wire.

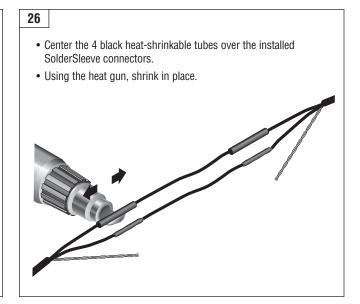

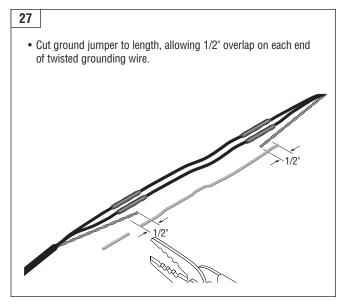



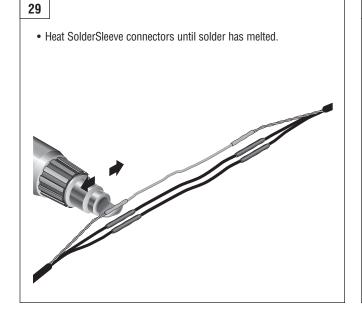

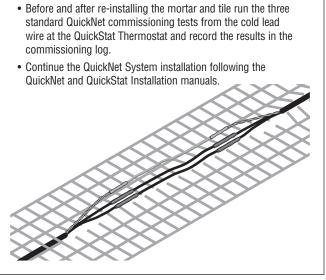


Once the QuickNet splice is completed, conduct the following three commissioning tests on this page and record the values on the QuickNet-RK Commissioning Record (on page 8). Retain these readings with the original QuickNet Commissioning Record.

Testing Procedure

1 Insulation Resistance Test


This test ensures that the insulating jackets of the mat are not damaged. A low value indicates the mat has been damaged and must be replaced.

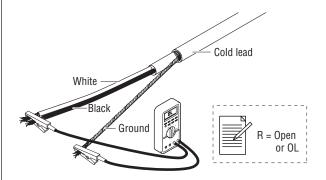

- 1. Connect the ground wire to the black lead and both power wires to the red lead of the multimeter.
- Set your multimeter to the 200 K ohm range. Make sure the meter reads 'Open' or "OL'. If you get a different reading, contact Tyco Thermal Controls at 800-545-6258.
- 3. Record these readings on the Commissioning Record (page 8).

2 Heating Cable Resistance Test


This test measures the resistance of the mat and is used to determine circuit integrity.

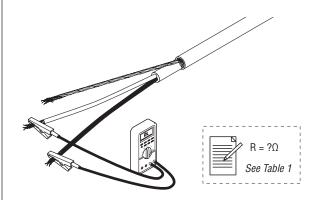

- 1. Set your multimeter to the **200 ohm** range.
- 2. Connect the multimeter leads to the black and white cold lead
- Compare this resistance reading to the resistance specified in the QuickNet Resistance Table below. The value should be within ±10%. If you get a different reading, contact Tyco Thermal Controls at 800-545-6258.
- 4. Record these readings on the Commissioning Record (page 8).

3 Sensor Resistance Test

This test measures the resistance of the floor sensor and is used to verify the sensor integrity.

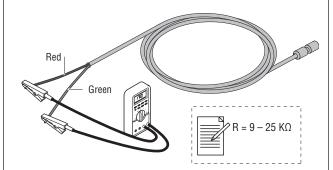

- 1. Set your multimeter to the 200 K ohm range.
- $2. \ \mbox{Connect}$ the multimeter leads to the red and green lead wires.
- 3. Make sure the meter reads between 9–25 K Ω . If you get a different reading, contact Tyco Thermal Controls at 800-545-6258.
- 4. Record these readings on the Commissioning Record (page 8).

| QuickNet Mat Resistance Table 120 V QuickNet with thermostat | | | | | | | |
|---|---------------|----------------|--|--|--|--|--|
| Catalog Number | Size ft² (m²) | Resistance Ohm | | | | | |
| OHICKNET-010-1 | 10 (0.9) | 120 | | | | | |

| outured Humber | 0120 11 (111) | modistance oning |
|----------------|--|---|
| QUICKNET-010-1 | 10 (0.9) | 120 |
| QUICKNET-020-1 | 20 (1.9) | 60 |
| QUICKNET-030-1 | 30 (2.8) | 40 |
| QUICKNET-040-1 | 40 (3.7) | 30 |
| QUICKNET-050-1 | 50 (4.6) | 24 |
| QUICKNET-060-1 | 60 (5.6) | 20 |
| QUICKNET-070-1 | 70 (6.5) | 17 |
| QUICKNET-080-1 | 80 (7.4) | 15 |
| QUICKNET-090-1 | 90 (8.4) | 13 |
| QUICKNET-100-1 | 100 (9.3) | 12 |
| | QUICKNET-010-1 QUICKNET-020-1 QUICKNET-030-1 QUICKNET-040-1 QUICKNET-050-1 QUICKNET-060-1 QUICKNET-070-1 QUICKNET-080-1 QUICKNET-090-1 | QUICKNET-010-1 10 (0.9) QUICKNET-020-1 20 (1.9) QUICKNET-030-1 30 (2.8) QUICKNET-040-1 40 (3.7) QUICKNET-050-1 50 (4.6) QUICKNET-060-1 60 (5.6) QUICKNET-070-1 70 (6.5) QUICKNET-080-1 80 (7.4) QUICKNET-090-1 90 (8.4) |

| 240 V QuickNet Mats with thermostat (and without thermostat) | | | | | | |
|--|--|-----------------|--|--|--|--|
| Catalog Number | Size ft ² (m ²) | Resistance Ohms | | | | |
| QUICKNET-050-2 (-050X-2) | 50 (4.6) | 96 | | | | |
| QUICKNET-060-2 (-060X-2) | 60 (5.6) | 80 | | | | |
| QUICKNET-080-2 (-080X-2) | 80 (7.4) | 60 | | | | |
| QUICKNET-100-2 (-100X-2) | 100 (9.3) | 48 | | | | |
| | | | | | | |

QuickNet-RK Cable Repair Commissioning Record (retain this record)

| Installer | | | | | | |
|-------------------------|----------|---|--------------------------------|-----------------|--------------------|-----------------|
| Date of commissioning: | | | | Company: | | |
| Name of installer: | | | | | | |
| Street: | | | | | | |
| City: | | | | Postal code: | | |
| Phone (office): | | | | Phone (mobile): | | |
| Fax: | | | | Email: | | |
| Website: | | | | | | |
| Project data | | | | | | |
| Customer name: | | | | | | |
| Street: | | | | | | |
| City: | | | | Postal code: | | |
| Sub floor type: | □Wood | | ☐ Concrete | Floor covering: | ☐ Ceramic tile | ☐ Natural stone |
| Room type: | ☐ Kitche | | ☐ Bathroom ☐ Other: | Rated voltage: | ☐ 120 V ☐ 240 V | |
| | | | | Recorded value | | |
| QuickNet mat | | | Catalog number: | | | |
| | E | Batch | date (from box or cord label): | | | |
| Insulation resistance | | Before embedding in mortar*: | | | (ΚΩ) | |
| | | | After embedding in mortar*: | | (ΚΩ) | |
| | | | After floor covering*: | | (ΚΩ) | |
| Heating cable resistanc | е | Before embedding in mortar*: After embedding in mortar*: | | | (Ω) | |
| | _ | | | | (Ω) | |
| | | | After floor covering*: | | (Ω) | |
| Sensor resistance | | Before embedding in mortar*: | | | (ΚΩ) | |
| | | | After embedding in mortar*: | | (ΚΩ) | |
| | | | After floor covering*: | | (ΚΩ) | |

Installer: Please leave this record with homeowner.

Tyco, QuickNet, QuickStat, Raychem and SolderSleeve are trademarks or registered trademarks of Tyco Thermal Controls LLC or its affiliates.

Worldwide Headquarters Tyco Thermal Controls 300 Constitution Drive Menlo Park, CA 94025-1164 USA Tel (800) 545-6258 Fax (800) 596-5004 info@tycothermal.com www.tycothermal.com Canada Tyco Thermal Controls 250 West Street Trenton, Ontario Canada KBV 5S2 Tel (800) 545-6258 Fax (800) 596-5004 Important: All information, including illustrations, is believed to be reliable. Users, however, should independently evaluate the suitability of each product for their particular application. Tyco Thermal Controls makes no warranties as to the accuracy or completeness of the information, and disclaims any liability regarding its use. Tyco Thermal Controls' only obligations are those in the Tyco Thermal Controls Standard Terms and Conditions of Sale for this product, and in no case will Tyco Thermal Controls or its distributors be liable for any incidental, indirect, or consequential damages arising from the sale, resale, use, or misuse of the product. Specifications are subject to change without notice. In addition Tyco Thermal Controls reserves the right to make changes—without notification to Buyer—to processing or materials that do not affect compliance with any applicable specification.

^{*} Refer to QuickNet Installation Manual (H57704) for further installation and testing details. Available online at www.tycothermal.com.