

ASXC16
HIGH-EFFICIENCY, COMFORTNET-COMPATIBLE
SPLIT-SYSTEM AIR CONDITIONER
UP TO 16 SEER

COOLING CAPACITY:
24,000 - 57,000 BTU/H



Contents

Nomenclature 2
 Product Specifications 3
 Expanded Cooling Data 4
 AHRI Ratings..... 20
 Wiring Diagram..... 35
 Dimensions 36
 Accessories 36

Standard Features

- R-410A chlorine-free refrigerant
- Two-Stage Copeland[®] UltraTech scroll compressor
- High-density foam compressor sound blanket
- ComfortNet[™] Communications System compatible
- Expanded ComfortAlert[™] diagnostics built in
- Simple low-voltage wiring to outdoor unit in communicating mode
- Diagnostic indicator lights and storage of six fault codes
- Color-coded terminal strip for non-communicating set-up
- Fully charged for 15' of tubing length
- Factory-installed filter drier
- Ambient temperature sensors
- Sweat connection service valves with easy access to gauge ports
- AHRI Certified; ETL Listed

Cabinet Features

- Amana[®] brand sound control top design
- Wire fan discharge grille
- Steel louver coil guard
- Baked-on powder paint finish
- Rust-resistant coated screws
- Compact footprint
- Top and side maintenance access
- Single-panel access to controls with space provided for field-installed accessories
- When properly anchored, meets 2010 Florida Building Code unit integrity requirements for hurricane-type winds (Anchor bracket kits available.)



* Complete warranty details available from your local dealer or at www.amana-hac.com. To receive the Lifetime Unit Replacement Limited Warranty (good for as long as you own your home) and 10-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration is not required in California or Québec.



NOMENCLATURE

	A	S	X	C	16	036	1	A	A
	1	2	3	4	5,6	7,8,9	10	11	12
Brand	A Amana® Brand								Engineering * Minor Revision
Product Category	S Split System								Engineering * Major Revision
Unit Type	C Condenser R-22		X Condenser R-410A		H Heat Pump R-22		Z Heat Pump R-410A		Electrical
Communication Feature	C ComfortNet 4-wire communications ready								
Efficiency	13 13 SEER	16 16 SEER							
	14 14 SEER	18 18 SEER							
								1 208/230 V, 1 Phase, 60 Hz	
								2 220/240 V, 1 Phase, 50 Hz	
								3 208/230 V, 3 Phase, 60 Hz	
								4 460 V, 3 Phase, 60 Hz	
								5 380/415 V, 3 Phase, 50 Hz	
									Nominal Capacity
								018 1½ Tons	048 4 Tons
								024 2 Tons	060 5 Tons
								030 2½ Tons	090 7½ tons
								036 3 Tons	120 10 Tons
								042 3½ Tons	

* Neither used for order entry or inventory management.



SPECIFICATIONS

	ASXC16 0241BB	ASXC16 0241BC	ASXC16 0361BB	ASXC16 0361BC	ASXC16 0481B*	ASXC16 0601B*
COOLING CAPACITY						
Nominal Cooling (BTU/h)	24,000	24,000	36,000	36,000	48,000	60,000
Decibels	71	71	73	73	74	75
COMPRESSOR						
RLA	10.3	11.7	16.7	15.3	21.2	28.8
LRA	52.0	58.0	82.0	83.0	104.0	152.9
CONDENSER FAN MOTOR						
Horsepower (RPM)	1/6	1/6	1/6	1/6	1/6	1/6
FLA	1.1	1.1	0.9	0.9	1.2	1.0
REFRIGERATION SYSTEM						
Refrigerant Line Size ¹						
Liquid Line Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Line Size ("O.D.)	3/4"	3/4"	7/8"	7/8"	1 1/8"	1 1/8"
Refrigerant Connection Size						
Liquid Valve Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Valve Size ("O.D.)	3/4"	3/4"	3/4"	3/4"	7/8"	7/8"
Valve Connection Type	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat
Refrigerant Charge	97	97	107	107	132	197
ELECTRICAL DATA						
Voltage-Hz	208/230-60	208/230-60	208/230-60	208/230-60	208/230-60-1	208/230-60-1
Minimum Circuit Ampacity ²	14.0	15.7	21.8	20.0	27.7	37.2
Max. Overcurrent Protection ³	20	20	35	35	45	60
Min / Max Volts	197/253	197/253	197/253	197/253	197/253	197/253
Power Supply	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"
EQUIPMENT WEIGHT (LBS)	180	180	184	184	219	279
SHIP WEIGHT (LBS)	198	198	202	202	241	301

¹ Tested and rated in accordance with AHRI Standard 210/240

² Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes

³ Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

- Always check the S&R plate for electrical data on the unit being installed.
- Installer will need to supply 3/8" to 1 1/8" adapters for suction line connections.
- Unit is charged with refrigerant for 15' of 3/8" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.
- Installation of these units requires the specified TXV Kit to be installed on the indoor coil. THE SPECIFIED TXV IS DETERMINED BY THE OUTDOOR UNIT NOT THE INDOOR COIL.

EXPANDED COOLING DATA — ASXC160241**/CA*F3636C6C*+TXV/MBVC1200** LOW STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	18.0	18.7	20.4	-	17.6	18.2	20.0	-	17.2	17.8	19.5	-	16.7	17.4	19.0	-	15.9	16.5	18.1	-	14.7	15.3	16.7	-
	S/T	0.75	0.63	0.43	-	0.78	0.65	0.45	-	0.80	0.66	0.46	-	0.82	0.69	0.48	-	0.85	0.71	0.49	-	0.86	0.72	0.50	-
	ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-
	kW	1.10	1.12	1.16	-	1.19	1.21	1.25	-	1.26	1.29	1.34	-	1.33	1.37	1.41	-	1.39	1.43	1.48	-	1.44	1.48	1.53	-
	Amps	4.5	4.6	4.7	-	4.8	4.9	5.1	-	5.2	5.3	5.5	-	5.6	5.7	5.9	-	5.9	6.1	6.3	-	6.3	6.4	6.6	-
	HI PR	228	245	248	-	258	277	281	-	293	315	319	-	334	359	364	-	375	404	409	-	420	452	458	-
	Lo PR	122	125	137	-	125	129	141	-	129	133	146	-	133	137	150	-	135	140	153	-	139	143	156	-
	MBh	17.5	18.1	19.8	-	17.1	17.7	19.4	-	16.7	17.3	18.9	-	16.3	16.8	18.5	-	15.4	16.0	17.5	-	14.3	14.8	16.2	-
	S/T	0.71	0.60	0.41	-	0.74	0.62	0.43	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.68	0.47	-	0.82	0.68	0.47	-
	ΔT	19	17	13	-	19	17	13	-	19	17	13	-	20	17	13	-	19	17	13	-	18	16	12	-
kW	1.09	1.11	1.15	-	1.18	1.20	1.24	-	1.25	1.28	1.33	-	1.32	1.35	1.40	-	1.38	1.41	1.46	-	1.43	1.47	1.52	-	
Amps	4.4	4.5	4.7	-	4.8	4.9	5.0	-	5.2	5.3	5.5	-	5.5	5.7	5.8	-	5.9	6.0	6.2	-	6.2	6.4	6.6	-	
HI PR	226	243	246	-	255	274	278	-	290	312	316	-	330	355	360	-	372	400	405	-	416	447	454	-	
Lo PR	120	124	136	-	124	128	140	-	128	132	144	-	132	136	148	-	134	138	151	-	137	142	155	-	
MBh	16.1	16.7	18.3	-	15.8	16.3	17.9	-	15.4	15.9	17.5	-	15.0	15.6	17.0	-	14.3	14.8	16.2	-	13.2	13.7	15.0	-	
S/T	0.69	0.58	0.40	-	0.71	0.60	0.41	-	0.73	0.61	0.42	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.79	0.66	0.46	-	
ΔT	19	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	18	16	12	-	
kW	1.08	1.10	1.14	-	1.17	1.19	1.23	-	1.24	1.27	1.31	-	1.31	1.34	1.39	-	1.37	1.40	1.45	-	1.42	1.45	1.50	-	
Amps	4.4	4.5	4.6	-	4.7	4.8	5.0	-	5.1	5.3	5.4	-	5.5	5.6	5.8	-	5.8	6.0	6.2	-	6.2	6.3	6.5	-	
HI PR	223	240	244	-	252	271	275	-	287	309	313	-	327	352	357	-	368	396	401	-	412	443	449	-	
Lo PR	119	123	134	-	123	127	138	-	127	131	143	-	130	134	147	-	133	137	150	-	136	140	153	-	

70	MBh	18.3	18.8	20.4	21.9	17.9	18.4	19.9	21.4	17.5	18.0	19.4	20.9	17.0	17.5	19.0	20.4	16.2	16.7	18.0	19.3	15.0	15.4	16.7	17.9
	S/T	0.85	0.76	0.58	0.37	0.88	0.79	0.60	0.38	0.90	0.81	0.61	0.39	0.93	0.84	0.63	0.41	0.92	0.83	0.63	0.40	0.93	0.83	0.63	0.41
	ΔT	21	20	16	11	21	20	16	11	22	20	16	11	22	20	16	11	21	20	16	11	20	18	15	10
	kW	1.10	1.12	1.16	1.20	1.19	1.21	1.25	1.30	1.26	1.29	1.34	1.38	1.33	1.37	1.41	1.46	1.39	1.43	1.48	1.53	1.44	1.48	1.53	1.58
	Amps	4.5	4.6	4.7	4.9	4.8	4.9	5.1	5.3	5.2	5.3	5.5	5.7	5.6	5.7	5.9	6.1	5.9	6.1	6.3	6.5	6.3	6.4	6.6	6.9
	HI PR	228	245	248	254	258	277	281	287	293	315	319	326	334	359	364	372	375	404	409	418	420	452	458	468
	Lo PR	122	125	137	146	125	129	141	150	129	133	146	155	133	137	150	159	135	140	153	162	139	143	156	166
	MBh	17.8	18.3	19.8	21.3	17.4	17.9	19.3	20.8	16.9	17.4	18.9	20.3	16.5	17.0	18.4	19.8	15.7	16.2	17.5	18.8	14.5	15.0	16.2	17.4
	S/T	0.81	0.73	0.55	0.35	0.84	0.75	0.57	0.37	0.86	0.77	0.58	0.38	0.89	0.80	0.60	0.39	0.92	0.83	0.63	0.40	0.93	0.83	0.63	0.41
	ΔT	22	20	17	12	22	21	17	12	22	21	17	12	23	21	17	12	22	20	17	12	21	19	16	11
kW	1.09	1.11	1.15	1.19	1.18	1.20	1.24	1.29	1.25	1.28	1.33	1.37	1.32	1.35	1.40	1.45	1.38	1.41	1.46	1.51	1.43	1.47	1.52	1.57	
Amps	4.4	4.5	4.7	4.8	4.8	4.9	5.0	5.2	5.2	5.3	5.5	5.7	5.5	5.7	5.8	6.1	5.9	6.0	6.2	6.4	6.2	6.4	6.6	6.8	
HI PR	226	243	246	251	255	274	278	284	290	312	316	323	330	355	360	368	372	400	405	414	416	447	454	464	
Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	137	142	155	165	
MBh	16.4	16.9	18.3	19.6	16.0	16.5	17.9	19.2	15.6	16.1	17.4	18.7	15.3	15.7	17.0	18.2	14.5	14.9	16.2	17.3	13.4	13.8	15.0	16.1	
S/T	0.78	0.70	0.53	0.34	0.81	0.73	0.55	0.35	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.37	0.89	0.80	0.60	0.39	0.90	0.80	0.61	0.39	
ΔT	22	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	19	16	11	
kW	1.08	1.10	1.14	1.18	1.17	1.19	1.23	1.27	1.24	1.27	1.31	1.36	1.31	1.34	1.39	1.44	1.37	1.40	1.45	1.50	1.42	1.45	1.50	1.56	
Amps	4.4	4.5	4.6	4.8	4.7	4.8	5.0	5.2	5.1	5.3	5.4	5.6	5.5	5.6	5.8	6.0	5.8	6.0	6.2	6.4	6.2	6.3	6.5	6.8	
HI PR	223	240	244	249	252	271	275	281	287	309	313	320	327	352	357	364	368	396	401	410	412	443	449	459	
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 Amps = outdoor unit amps (comp.-fan)
 kW = Total system power

EXPANDED COOLING DATA — ASXC160241**/CA*F3636C6C*+TXV/MBVC1200** LOW STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	18.6	19.0	20.3	21.7	18.2	18.6	19.9	21.2	17.8	18.1	19.4	20.7	17.3	17.7	18.9	20.2	16.5	16.8	18.0	19.2	15.2	15.6	16.6	17.8
	S/T	0.93	0.88	0.71	0.53	0.97	0.91	0.74	0.55	1.00	0.93	0.76	0.57	1.00	0.96	0.78	0.58	1.00	1.00	0.81	0.61	1.00	1.00	0.82	0.61
	ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	23	20	16	21	21	19	15
	kW	1.10	1.12	1.16	1.20	1.19	1.21	1.25	1.30	1.26	1.29	1.34	1.38	1.33	1.37	1.41	1.46	1.39	1.43	1.48	1.53	1.44	1.48	1.53	1.58
	Amps	4.5	4.6	4.7	4.9	4.8	4.9	5.1	5.3	5.2	5.3	5.5	5.7	5.6	5.7	5.9	6.1	5.9	6.1	6.3	6.5	6.3	6.4	6.6	6.9
	HI PR	228	245	248	254	258	277	281	287	293	315	319	326	334	359	364	372	375	404	409	418	420	452	458	468
	Lo PR	122	125	137	146	125	129	141	150	129	133	146	155	133	137	150	159	135	140	153	162	139	143	156	166
	MBh	18.1	18.5	19.7	21.1	17.7	18.1	19.3	20.6	17.2	17.6	18.8	20.1	16.8	17.2	18.4	19.6	16.0	16.3	17.4	18.7	14.8	15.1	16.2	17.3
	S/T	0.89	0.84	0.68	0.51	0.92	0.87	0.70	0.53	0.95	0.89	0.72	0.54	0.98	0.92	0.75	0.56	1.00	0.95	0.77	0.58	1.00	0.96	0.78	0.58
	ΔT	25	24	21	16	25	24	21	17	25	24	21	17	25	24	21	17	24	24	21	17	23	22	19	15
kW	1.09	1.11	1.15	1.19	1.18	1.20	1.24	1.29	1.25	1.28	1.33	1.37	1.32	1.35	1.40	1.45	1.38	1.41	1.46	1.51	1.43	1.47	1.52	1.57	
Amps	4.4	4.5	4.7	4.8	4.8	4.9	5.0	5.2	5.2	5.3	5.5	5.7	5.5	5.7	5.8	6.1	5.9	6.0	6.2	6.4	6.2	6.4	6.6	6.8	
HI PR	226	243	246	251	255	274	278	284	290	312	316	323	330	355	360	368	372	400	405	414	416	447	454	464	
Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	137	142	155	165	
MBh	16.7	17.1	18.2	19.5	16.3	16.7	17.8	19.0	15.9	16.3	17.4	18.6	15.5	15.9	17.0	18.1	14.8	15.1	16.1	17.2	13.7	14.0	14.9	15.9	
S/T	0.86	0.81	0.66	0.49	0.89	0.83	0.68	0.51	0.91	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.98	0.92	0.75	0.56	0.99	0.92	0.75	0.56	
ΔT	25	24	21	17	25	24	21	17	25	24	21	17	26	25	21	17	25	24	21	17	24	23	20	16	
kW	1.08	1.10	1.14	1.18	1.17	1.19	1.23	1.27	1.24	1.27	1.31	1.36	1.31	1.34	1.39	1.44	1.37	1.40	1.45	1.50	1.42	1.45	1.50	1.56	
Amps	4.4	4.5	4.6	4.8	4.7	4.8	5.0	5.2	5.1	5.3	5.4	5.6	5.5	5.6	5.8	6.0	5.8	6.0	6.2	6.4	6.2	6.3	6.5	6.8	
HI PR	223	240	244	249	252	271	275	281	287	309	313	320	327	352	357	364	368	396	401	410	412	443	449	459	
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163	
85	MBh	19.0	19.3	20.2	21.6	18.5	18.9	19.8	21.1	18.1	18.4	19.3	20.6	17.6	18.0	18.8	20.1	16.8	17.1	17.9	19.1	15.5	15.8	16.6	17.7
	S/T	0.98	0.94	0.85	0.69	1.00	0.98	0.88	0.72	1.00	1.00	0.91	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.97	0.79	1.00	1.00	0.98	0.79
	ΔT	25	25	23	20	25	25	24	21	25	25	24	21	24	24	24	21	23	23	24	20	21	22	22	19
	kW	1.10	1.12	1.16	1.20	1.19	1.21	1.25	1.30	1.26	1.29	1.34	1.38	1.33	1.37	1.41	1.46	1.39	1.43	1.48	1.53	1.44	1.48	1.53	1.58
	Amps	4.5	4.6	4.7	4.9	4.8	4.9	5.1	5.3	5.2	5.3	5.5	5.7	5.6	5.7	5.9	6.1	5.9	6.1	6.3	6.5	6.3	6.4	6.6	6.9
	HI PR	228	245	248	254	258	277	281	287	293	315	319	326	334	359	364	372	375	404	409	418	420	452	458	468
	Lo PR	122	125	137	146	125	129	141	150	129	133	146	155	133	137	150	159	135	140	153	162	139	143	156	166
	MBh	18.4	18.8	19.6	21.0	18.0	18.3	19.2	20.5	17.5	17.9	18.7	20.0	17.1	17.4	18.3	19.5	16.3	16.6	17.4	18.5	15.1	15.4	16.1	17.2
	S/T	0.93	0.90	0.81	0.66	0.97	0.93	0.84	0.68	0.99	0.96	0.86	0.70	1.00	0.99	0.89	0.72	1.00	1.00	0.93	0.75	1.00	1.00	0.93	0.76
	ΔT	26	26	24	21	27	26	25	21	27	26	25	21	26	26	25	22	25	25	25	21	23	24	23	20
kW	1.09	1.11	1.15	1.19	1.18	1.20	1.24	1.29	1.25	1.28	1.33	1.37	1.32	1.35	1.40	1.45	1.38	1.41	1.46	1.51	1.43	1.47	1.52	1.57	
Amps	4.4	4.5	4.7	4.8	4.8	4.9	5.0	5.2	5.2	5.3	5.5	5.7	5.5	5.7	5.8	6.1	5.9	6.0	6.2	6.4	6.2	6.4	6.6	6.8	
HI PR	226	243	246	251	255	274	278	284	290	312	316	323	330	355	360	368	372	400	405	414	416	447	454	464	
Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	137	142	155	165	
MBh	17.0	17.3	18.1	19.3	16.6	16.9	17.7	18.9	16.2	16.5	17.3	18.4	15.8	16.1	16.9	18.0	15.0	15.3	16.0	17.1	13.9	14.2	14.8	15.8	
S/T	0.90	0.87	0.78	0.64	0.93	0.90	0.81	0.66	0.96	0.92	0.83	0.68	0.99	0.95	0.86	0.70	1.00	0.99	0.89	0.72	1.00	1.00	0.90	0.73	
ΔT	26.8	26	25	22	27	27	25	22	27	27	25	22	27	27	25	22	26	26	25	22	24	25	23	20	
kW	1.08	1.10	1.14	1.18	1.17	1.19	1.23	1.27	1.24	1.27	1.31	1.36	1.31	1.34	1.39	1.44	1.37	1.40	1.45	1.50	1.42	1.45	1.50	1.56	
Amps	4.4	4.5	4.6	4.8	4.7	4.8	5.0	5.2	5.1	5.3	5.4	5.6	5.5	5.6	5.8	6.0	5.8	6.0	6.2	6.4	6.2	6.3	6.5	6.8	
HI PR	223	240	244	249	252	271	275	281	287	309	313	320	327	352	357	364	368	396	401	410	412	443	449	459	
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 Amps = outdoor unit amps (comp.+fan)
 kW = Total system power

EXPANDED COOLING DATA — ASXC160241**/CA*F3636C6C*+TXV/MBVC1200** HIGH STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																											
		65°F				75°F				85°F				95°F				105°F				115°F							
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
70	MBh	23.5	24.4	26.7	-	23.0	23.8	26.1	-	22.4	23.2	25.5	-	21.9	22.7	24.8	-	20.8	21.5	23.6	-	20.2	20.9	22.9	-	18.7	19.4	21.2	-
	S/T	0.76	0.63	0.44	-	0.78	0.66	0.45	-	0.80	0.67	0.47	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.82	0.69	0.48	-	0.83	0.69	0.48	-
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	19	17	13	-	18	15	12	-
	kW	1.50	1.53	1.58	-	1.62	1.65	1.71	-	1.72	1.76	1.82	-	1.81	1.86	1.92	-	1.89	1.94	2.00	-	1.88	1.92	1.98	-	1.94	1.99	2.06	-
	Amps	5.9	6.0	6.2	-	6.4	6.5	6.7	-	6.9	7.1	7.3	-	7.4	7.5	7.8	-	7.8	8.0	8.3	-	390	419	425	-	437	470	476	-
	HI PR	237	255	258	-	268	288	292	-	304	327	332	-	347	373	378	-	390	419	425	-	437	470	476	-	432	465	471	-
Lo PR	122	125	137	-	125	129	141	-	129	134	146	-	133	137	150	-	136	140	153	-	136	140	153	-	139	143	156	-	
70	MBh	22.8	23.7	25.9	-	22.3	23.1	25.3	-	21.8	22.6	24.7	-	21.2	22.0	24.1	-	20.2	20.9	22.9	-	20.2	20.9	22.9	-	18.7	19.4	21.2	-
	S/T	0.72	0.60	0.42	-	0.75	0.63	0.43	-	0.77	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.69	0.48	-	0.82	0.69	0.48	-	0.83	0.69	0.48	-
	ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	18	15	12	-
	kW	1.49	1.52	1.57	-	1.61	1.64	1.69	-	1.71	1.75	1.80	-	1.80	1.84	1.90	-	1.88	1.92	1.98	-	1.88	1.92	1.98	-	1.94	1.99	2.06	-
	Amps	5.9	6.0	6.2	-	6.3	6.5	6.7	-	6.8	7.0	7.2	-	7.3	7.5	7.7	-	7.8	7.9	8.2	-	386	415	421	-	432	465	471	-
	HI PR	234	252	256	-	265	285	289	-	301	324	329	-	343	369	374	-	386	415	421	-	434	465	471	-	432	465	471	-
Lo PR	120	124	136	-	124	128	140	-	128	132	144	-	132	136	148	-	134	138	151	-	134	138	151	-	138	142	155	-	
70	MBh	21.1	21.8	23.9	-	20.6	21.3	23.4	-	20.1	20.8	22.8	-	19.6	20.3	22.3	-	18.6	19.3	21.1	-	18.6	19.3	21.1	-	17.3	17.9	19.6	-
	S/T	0.70	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.79	0.66	0.46	-	0.80	0.67	0.46	-
	ΔT	19	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	19	17	13	-	18	16	12	-
	kW	1.48	1.51	1.56	-	1.59	1.63	1.68	-	1.69	1.73	1.79	-	1.78	1.82	1.89	-	1.86	1.90	1.97	-	1.86	1.90	1.97	-	1.93	1.97	2.04	-
	Amps	5.8	5.9	6.1	-	6.3	6.4	6.6	-	6.8	6.9	7.2	-	7.2	7.4	7.6	-	7.7	7.9	8.1	-	382	411	417	-	428	460	467	-
	HI PR	232	249	253	-	262	282	286	-	298	321	325	-	340	365	370	-	382	411	417	-	428	460	467	-	428	460	467	-
Lo PR	119	123	134	-	123	127	138	-	127	131	143	-	130	134	147	-	133	137	150	-	133	137	150	-	136	140	153	-	

900	MBh	23.9	24.6	26.7	28.6	23.4	24.1	26.0	27.9	22.8	23.5	25.4	27.3	22.2	22.9	24.8	26.6	21.1	21.8	23.6	25.3	19.6	20.2	21.8	23.4
	S/T	0.86	0.77	0.58	0.37	0.89	0.80	0.60	0.39	0.91	0.82	0.62	0.40	0.94	0.84	0.64	0.41	0.98	0.88	0.66	0.43	0.99	0.88	0.67	0.43
	ΔT	21	19	16	11	21	20	16	11	21	20	16	11	21	20	16	11	21	19	16	11	20	18	15	10
	kW	1.50	1.53	1.58	1.63	1.62	1.65	1.71	1.77	1.72	1.76	1.82	1.88	1.81	1.86	1.92	1.98	1.89	1.94	2.00	2.07	1.96	2.01	2.07	2.15
	Amps	5.9	6.0	6.2	6.5	6.4	6.5	6.7	7.0	6.9	7.1	7.3	7.6	7.4	7.5	7.8	8.1	7.8	8.0	8.3	8.6	8.3	8.5	8.7	9.1
	HI PR	237	255	258	264	268	288	292	298	304	327	332	339	347	373	378	386	390	419	425	435	437	470	476	487
Lo PR	122	125	137	146	125	129	141	150	129	134	146	155	133	137	150	159	136	140	153	163	139	143	156	167	
800	MBh	23.2	23.9	25.9	27.8	22.7	23.4	25.3	27.1	22.1	22.8	24.7	26.5	21.6	22.2	24.1	25.8	20.5	21.1	22.9	24.5	19.0	19.6	21.2	22.7
	S/T	0.82	0.73	0.56	0.36	0.85	0.76	0.58	0.37	0.87	0.78	0.59	0.38	0.90	0.81	0.61	0.39	0.93	0.84	0.63	0.41	0.94	0.84	0.64	0.41
	ΔT	22	20	17	11	22	20	17	12	22	20	17	12	22	21	17	12	22	20	17	11	21	19	16	11
	kW	1.49	1.52	1.57	1.62	1.61	1.64	1.69	1.75	1.71	1.75	1.80	1.87	1.80	1.84	1.90	1.97	1.88	1.92	1.98	2.05	1.94	1.99	2.06	2.13
	Amps	5.9	6.0	6.2	6.4	6.3	6.5	6.7	6.9	6.8	7.0	7.2	7.5	7.3	7.5	7.7	8.0	7.8	7.9	8.2	8.5	8.2	8.4	8.7	9.0
	HI PR	234	252	256	261	265	285	289	295	301	324	329	336	343	369	374	382	386	415	421	430	432	465	471	482
Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	138	142	155	165	
700	MBh	21.4	22.1	23.9	25.6	20.9	21.6	23.3	25.0	20.4	21.0	22.8	24.4	19.9	20.5	22.2	23.8	18.9	19.5	21.1	22.7	17.5	18.1	19.6	21.0
	S/T	0.79	0.71	0.54	0.34	0.82	0.73	0.56	0.36	0.84	0.75	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.81	0.61	0.39	0.91	0.81	0.62	0.40
	ΔT	22	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	22	21	17	12	21	19	16	11
	kW	1.48	1.51	1.56	1.61	1.59	1.63	1.68	1.74	1.69	1.73	1.79	1.85	1.78	1.82	1.89	1.95	1.86	1.90	1.97	2.04	1.93	1.97	2.04	2.11
	Amps	5.8	5.9	6.1	6.3	6.3	6.4	6.6	6.8	6.8	6.9	7.2	7.4	7.2	7.4	7.6	7.9	7.7	7.9	8.1	8.4	8.1	8.3	8.6	8.9
	HI PR	232	249	253	259	262	282	286	292	298	321	325	332	340	365	370	379	382	411	417	426	428	460	467	477
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 Amps = outdoor unit amps (comp.+fan)
 kW = Total system power

EXPANDED COOLING DATA — ASXC160241**/CA*F3636C6C*+TXV/MBVC1200** HIGH STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	24.3	24.9	26.6	28.4	23.8	24.3	26.0	27.7	23.2	23.7	25.3	27.1	22.6	23.1	24.7	26.4	21.5	22.0	23.5	25.1	21.5	22.0	23.5	25.1
	S/T	0.94	0.89	0.72	0.54	1.00	0.92	0.75	0.56	1.00	0.94	0.77	0.57	1.00	1.00	0.79	0.59	1.00	1.00	0.82	0.61	1.00	1.00	0.82	0.61
	ΔT	23	22	20	16	24	23	20	16	24	23	20	16	23	24	20	16	22	22	20	16	20	21	18	15
	kW	1.50	1.53	1.58	1.63	1.62	1.65	1.71	1.77	1.72	1.76	1.82	1.88	1.81	1.86	1.92	1.98	1.89	1.94	2.00	2.07	1.89	1.94	2.00	2.07
	Amps	5.9	6.0	6.2	6.5	6.4	6.5	6.7	7.0	6.9	7.1	7.3	7.6	7.4	7.5	7.8	8.1	7.8	8.0	8.3	8.6	8.3	8.5	8.7	9.1
	HI PR	237	255	258	264	268	288	292	298	304	327	332	339	347	373	378	386	390	419	425	435	437	470	476	487
	Lo PR	122	125	137	146	125	129	141	150	129	134	146	155	133	137	150	159	136	140	153	163	139	143	156	167
	MBh	23.6	24.1	25.8	27.6	23.1	23.6	25.2	26.9	22.5	23.0	24.6	26.3	22.0	22.5	24.0	25.7	20.9	21.3	22.8	24.4	19.3	19.8	21.1	22.6
	S/T	0.90	0.84	0.69	0.51	0.93	0.88	0.71	0.53	0.96	0.90	0.73	0.55	0.99	0.93	0.75	0.56	1.00	0.96	0.78	0.58	1.00	0.97	0.79	0.59
	ΔT	24	23	20	16	25	24	21	16	25	24	21	16	25	24	21	17	24	24	21	16	22	22	19	15
kW	1.48	1.51	1.57	1.61	1.61	1.64	1.69	1.75	1.71	1.75	1.80	1.87	1.80	1.84	1.90	1.97	1.88	1.92	1.98	2.05	1.94	1.99	2.06	2.13	
Amps	5.9	6.0	6.2	6.4	6.3	6.5	6.7	6.9	6.8	7.0	7.2	7.5	7.3	7.5	7.7	8.0	7.8	7.9	8.2	8.5	8.2	8.4	8.7	9.0	
HI PR	234	252	256	261	265	285	289	295	301	324	329	336	343	369	374	382	386	415	421	430	432	465	471	482	
Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	138	142	155	165	
MBh	21.8	22.3	23.8	25.5	21.3	21.8	23.3	24.9	20.8	21.3	22.7	24.3	20.3	20.7	22.2	23.7	19.3	19.7	21.0	22.5	17.9	18.2	19.5	20.8	
S/T	0.87	0.81	0.66	0.50	0.90	0.84	0.69	0.51	0.92	0.87	0.70	0.53	0.95	0.89	0.73	0.54	0.99	0.93	0.75	0.56	1.00	0.93	0.76	0.57	
ΔT	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	17	23	22	19	16	
kW	1.48	1.51	1.56	1.61	1.59	1.63	1.68	1.74	1.69	1.73	1.79	1.85	1.78	1.82	1.89	1.95	1.86	1.90	1.97	2.04	1.93	1.97	2.04	2.11	
Amps	5.8	5.9	6.1	6.3	6.3	6.4	6.6	6.8	6.8	6.9	7.2	7.4	7.2	7.4	7.6	7.9	7.7	7.9	8.1	8.4	8.1	8.3	8.6	8.9	
HI PR	232	249	253	259	262	282	286	292	298	321	325	332	340	365	370	379	382	411	417	426	428	460	467	477	
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163	

900	MBh	24.8	25.2	26.4	28.2	24.2	24.7	25.8	27.6	23.6	24.1	25.2	26.9	23.0	23.5	24.6	26.2	21.9	22.3	23.4	24.9	20.3	20.7	21.6	23.1
	S/T	0.99	0.96	0.86	0.70	1.00	0.99	0.89	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.98	0.80	1.00	1.00	0.99	0.80
	ΔT	25	25	23	20	25	25	24	21	24	25	24	21	24	24	24	21	22	23	23	20	21	21	22	19
	kW	1.50	1.53	1.58	1.63	1.62	1.65	1.71	1.77	1.72	1.76	1.82	1.88	1.81	1.86	1.92	1.98	1.89	1.94	2.00	2.07	1.96	2.01	2.07	2.15
	Amps	5.9	6.0	6.2	6.5	6.4	6.5	6.7	7.0	6.9	7.1	7.3	7.6	7.4	7.5	7.8	8.1	7.8	8.0	8.3	8.6	8.3	8.5	8.7	9.1
	HI PR	237	255	258	264	268	288	292	298	304	327	332	339	347	373	378	386	390	419	425	435	437	470	476	487
	Lo PR	122	125	137	146	125	129	141	150	129	134	146	155	133	137	150	159	136	140	153	163	139	143	156	167
	MBh	24.0	24.5	25.7	27.4	23.5	23.9	25.1	26.8	22.9	23.4	24.5	26.1	22.4	22.8	23.9	25.5	21.2	21.7	22.7	24.2	19.7	20.1	21.0	22.4
	S/T	0.94	0.91	0.82	0.67	0.98	0.94	0.85	0.69	1.00	0.97	0.87	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.94	0.76	1.00	1.00	0.94	0.77
	ΔT	26	26	24	21	26	26	25	21	26	26	25	21	26	26	25	21	24	25	24	21	23	23	23	20
kW	1.49	1.52	1.57	1.62	1.61	1.64	1.69	1.75	1.71	1.75	1.80	1.87	1.80	1.84	1.90	1.97	1.88	1.92	1.98	2.05	1.94	1.99	2.06	2.13	
Amps	5.9	6.0	6.2	6.4	6.3	6.5	6.7	6.9	6.8	7.0	7.2	7.5	7.3	7.5	7.7	8.0	7.8	7.9	8.2	8.5	8.2	8.4	8.7	9.0	
HI PR	234	252	256	261	265	285	289	295	301	324	329	336	343	369	374	382	386	415	421	430	432	465	471	482	
Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	138	142	155	165	
MBh	22.2	22.6	23.7	25.3	21.7	22.1	23.1	24.7	21.2	21.6	22.6	24.1	20.6	21.0	22.0	23.5	19.6	20.0	20.9	22.3	18.2	18.5	19.4	20.7	
S/T	0.91	0.88	0.79	0.64	0.94	0.91	0.82	0.67	0.97	0.93	0.84	0.68	1.00	0.96	0.87	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.91	0.74	
ΔT	26.5	26	25	21	27	26	25	22	27	26	25	22	27	27	25	22	26	26	25	21	24	24	23	20	
kW	1.48	1.51	1.56	1.61	1.59	1.63	1.68	1.74	1.69	1.73	1.79	1.85	1.78	1.82	1.89	1.95	1.86	1.90	1.97	2.04	1.93	1.97	2.04	2.11	
Amps	5.8	5.9	6.1	6.3	6.3	6.4	6.6	6.8	6.8	6.9	7.2	7.4	7.2	7.4	7.6	7.9	7.7	7.9	8.1	8.4	8.1	8.3	8.6	8.9	
HI PR	232	249	253	259	262	282	286	292	298	321	325	332	340	365	370	379	382	411	417	426	428	460	467	477	
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 Amps = outdoor unit amps (comp.+fan)
 kW = Total system power

EXPANDED COOLING DATA — ASXC160361** / CA*F3743*6A* +TXV / MBVC1600** LOW STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE															
		65°F				75°F				85°F				95°F				105°F				115°F							
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
70	MBh	24.9	25.8	28.3	-	24.3	25.2	27.6	-	23.8	24.6	27.0	-	23.2	24.0	26.3	-	22.0	22.8	25.0	-	22.0	22.8	25.0	-	20.4	21.1	23.2	-
	S/T	0.72	0.60	0.41	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.45	-	0.82	0.68	0.47	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-
	kW	1.50	1.53	1.58	-	1.61	1.65	1.70	-	1.72	1.75	1.81	-	1.81	1.85	1.91	-	1.88	1.93	1.99	-	1.88	1.93	1.99	-	1.95	2.00	2.06	-
	Amps	5.8	6.0	6.2	-	6.3	6.4	6.6	-	6.8	7.0	7.2	-	7.3	7.4	7.7	-	7.7	7.9	8.1	-	7.7	7.9	8.1	-	8.2	8.3	8.6	-
	HI PR	220	237	240	-	249	268	271	-	283	304	309	-	322	347	352	-	348	374	380	-	348	374	380	-	413	444	450	-
Lo PR	119	123	134	-	123	127	138	-	127	131	143	-	130	135	147	-	133	137	150	-	133	137	150	-	136	141	153	-	
70	MBh	24.2	25.1	27.5	-	23.6	24.5	26.8	-	23.1	23.9	26.2	-	22.5	23.3	25.5	-	21.4	22.2	24.3	-	21.4	22.2	24.3	-	19.8	20.5	22.5	-
	S/T	0.68	0.57	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.78	0.65	0.45	-	0.78	0.65	0.45	-	0.78	0.65	0.45	-
	ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	18	15	12	-
	kW	1.49	1.52	1.57	-	1.60	1.64	1.69	-	1.70	1.74	1.80	-	1.79	1.83	1.89	-	1.87	1.91	1.97	-	1.87	1.91	1.97	-	1.93	1.98	2.04	-
	Amps	5.8	5.9	6.1	-	6.2	6.4	6.6	-	6.7	6.9	7.1	-	7.2	7.4	7.6	-	7.6	7.8	8.1	-	7.6	7.8	8.1	-	8.1	8.3	8.5	-
	HI PR	218	234	238	-	246	265	269	-	280	301	306	-	319	343	348	-	345	371	376	-	345	371	376	-	409	439	446	-
Lo PR	118	122	133	-	122	125	137	-	126	130	142	-	129	133	145	-	132	136	148	-	132	136	148	-	135	139	152	-	
696	MBh	22.3	23.1	25.3	-	21.8	22.6	24.8	-	21.3	22.1	24.2	-	20.8	21.5	23.6	-	19.7	20.4	22.4	-	19.7	20.4	22.4	-	18.3	18.9	20.8	-
	S/T	0.66	0.55	0.38	-	0.68	0.57	0.39	-	0.70	0.58	0.40	-	0.72	0.60	0.42	-	0.75	0.63	0.43	-	0.75	0.63	0.43	-	0.76	0.63	0.44	-
	ΔT	19	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	18	16	12	-
	kW	1.47	1.51	1.55	-	1.59	1.62	1.67	-	1.69	1.73	1.78	-	1.78	1.82	1.88	-	1.85	1.89	1.96	-	1.85	1.89	1.96	-	1.92	1.96	2.03	-
	Amps	5.7	5.9	6.0	-	6.2	6.3	6.5	-	6.7	6.8	7.1	-	7.1	7.3	7.5	-	7.6	7.8	8.0	-	7.6	7.8	8.0	-	8.0	8.2	8.5	-
	HI PR	216	232	235	-	244	262	266	-	277	298	303	-	316	340	345	-	341	367	372	-	341	367	372	-	404	435	441	-
Lo PR	117	121	132	-	120	124	136	-	125	128	140	-	128	132	144	-	130	134	147	-	130	134	147	-	134	138	150	-	
904	MBh	25.3	26.1	28.2	30.3	24.7	25.5	27.6	29.6	24.2	24.9	26.9	28.9	23.6	24.3	26.3	28.2	22.9	23.6	25.5	27.4	22.9	23.6	25.5	27.4	21.7	22.4	24.2	26.0
	S/T	0.81	0.73	0.55	0.35	0.84	0.75	0.57	0.37	0.87	0.77	0.59	0.38	0.89	0.80	0.60	0.39	0.93	0.83	0.63	0.40	0.93	0.83	0.63	0.40	0.89	0.80	0.60	0.39
	ΔT	21	19	16	11	21	20	16	11	21	20	16	11	21	20	16	11	21	20	16	11	21	20	16	11	20	18	15	10
	kW	1.50	1.53	1.58	1.63	1.61	1.65	1.70	1.76	1.72	1.75	1.81	1.87	1.81	1.85	1.91	1.97	1.88	1.93	1.99	2.06	1.88	1.93	1.99	2.06	1.95	2.00	2.06	2.13
	Amps	5.8	6.0	6.2	6.4	6.3	6.4	6.6	6.9	6.8	7.0	7.2	7.4	7.3	7.4	7.7	7.9	7.7	7.9	8.1	8.4	7.7	7.9	8.1	8.4	8.2	8.3	8.6	8.9
	HI PR	220	237	240	245	249	268	271	277	283	304	309	315	322	347	352	359	348	374	380	388	348	374	380	388	413	444	450	460
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	135	147	156	133	137	150	160	133	137	150	160	136	141	153	163	
70	MBh	24.6	25.3	27.4	29.4	24.0	24.7	26.8	28.7	23.5	24.1	26.1	28.0	22.9	23.6	25.5	27.4	22.9	23.6	25.5	27.4	21.7	22.4	24.2	26.0	20.1	20.7	22.4	24.1
	S/T	0.78	0.69	0.53	0.34	0.80	0.72	0.54	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.88	0.79	0.60	0.38	0.88	0.79	0.60	0.38	0.89	0.80	0.60	0.39
	ΔT	22	20	17	11	22	20	17	12	22	20	17	12	22	21	17	12	22	20	17	12	22	20	17	12	21	19	16	11
	kW	1.49	1.52	1.57	1.62	1.60	1.64	1.69	1.74	1.70	1.74	1.80	1.86	1.79	1.83	1.89	1.96	1.87	1.91	1.97	2.04	1.87	1.91	1.97	2.04	1.93	1.98	2.04	2.11
	Amps	5.8	5.9	6.1	6.3	6.2	6.4	6.6	6.8	6.7	6.9	7.1	7.4	7.2	7.4	7.6	7.9	7.6	7.8	8.1	8.4	7.6	7.8	8.1	8.4	8.1	8.3	8.5	8.9
	HI PR	218	234	238	243	246	265	269	275	280	301	306	312	319	343	348	356	345	371	376	384	345	371	376	384	409	439	446	455
Lo PR	118	122	133	142	122	125	137	146	126	130	142	151	129	133	145	155	132	136	148	158	132	136	148	158	135	139	152	162	
696	MBh	22.7	23.4	25.3	27.2	22.2	22.8	24.7	26.5	21.6	22.3	24.1	25.9	21.1	21.7	23.5	25.3	20.1	20.7	22.4	24.0	20.1	20.7	22.4	24.0	18.6	19.1	20.7	22.2
	S/T	0.75	0.67	0.51	0.33	0.78	0.69	0.53	0.34	0.80	0.71	0.54	0.35	0.82	0.73	0.56	0.36	0.85	0.76	0.58	0.37	0.85	0.76	0.58	0.37	0.86	0.77	0.58	0.37
	ΔT	22	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	19	16	11
	kW	1.47	1.51	1.55	1.60	1.59	1.62	1.67	1.73	1.69	1.73	1.78	1.84	1.78	1.82	1.88	1.94	1.85	1.89	1.96	2.02	1.85	1.89	1.96	2.02	1.92	1.96	2.03	2.10
	Amps	5.7	5.9	6.0	6.3	6.2	6.3	6.5	6.8	6.7	6.8	7.1	7.3	7.1	7.3	7.5	7.8	7.6	7.8	8.0	8.3	7.6	7.8	8.0	8.3	8.0	8.2	8.5	8.8
	HI PR	216	232	235	241	244	262	266	272	277	298	303	309	316	340	345	352	341	367	372	380	341	367	372	380	404	435	441	451
Lo PR	117	121	132	140	120	124	136	144	125	128	140	149	128	132	144	153	130	134	147	156	130	134	147	156	134	138	150	160	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 Amps = outdoor unit amps (comp. + fan)
 kW = Total system power

EXPANDED COOLING DATA — ASXC160361** / CA*F3743*6A* +TXV / MBVC1600** LOW STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	25.8	26.3	28.1	30.1	25.2	25.7	27.5	29.4	24.6	25.1	26.8	28.7	24.0	24.5	26.2	28.0	22.8	23.3	24.9	26.6	21.1	21.6	23.0	24.6
	S/T	0.89	0.84	0.68	0.51	0.93	0.87	0.71	0.53	0.95	0.89	0.72	0.54	1.00	0.92	0.75	0.56	1.00	0.95	0.78	0.58	1.00	0.96	0.78	0.58
	ΔT	23	22	20	16	24	23	20	16	24	23	20	16	24	23	20	16	23	23	20	16	21	21	18	15
	kW	1.50	1.53	1.58	1.63	1.61	1.65	1.70	1.76	1.72	1.75	1.81	1.87	1.81	1.85	1.91	1.97	1.88	1.93	1.99	2.06	1.95	2.00	2.06	2.13
	Amps	5.8	6.0	6.2	6.4	6.3	6.4	6.6	6.9	6.8	7.0	7.2	7.4	7.3	7.4	7.7	7.9	7.7	7.9	8.1	8.4	8.2	8.3	8.6	8.9
	HI PR	220	237	240	245	249	268	271	277	283	304	309	315	322	347	352	359	348	374	380	388	413	444	450	460
	Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	135	147	156	133	137	150	160	136	141	153	163
	MBh	25.0	25.6	27.3	29.2	24.4	25.0	26.7	28.5	23.9	24.4	26.1	27.9	23.3	23.8	25.4	27.2	22.1	22.6	24.1	25.8	20.5	20.9	22.4	23.9
	S/T	0.85	0.80	0.65	0.49	0.88	0.83	0.67	0.50	0.90	0.85	0.69	0.52	0.93	0.88	0.71	0.53	0.97	0.91	0.74	0.55	0.98	0.92	0.75	0.56
	ΔT	24	23	20	16	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	16	23	22	19	15
kW	1.49	1.52	1.57	1.62	1.60	1.64	1.69	1.74	1.70	1.74	1.80	1.86	1.79	1.83	1.89	1.96	1.87	1.91	1.97	2.04	1.93	1.98	2.04	2.11	
Amps	5.8	5.9	6.1	6.3	6.2	6.4	6.6	6.8	6.7	6.9	7.1	7.4	7.2	7.4	7.6	7.9	7.6	7.8	8.1	8.4	8.1	8.3	8.5	8.9	
HI PR	218	234	238	243	246	265	269	275	280	301	306	312	319	343	348	356	345	371	376	384	409	439	446	455	
Lo PR	118	122	133	142	122	125	137	146	126	130	142	151	129	133	145	155	132	136	148	158	135	139	152	162	
MBh	23.1	23.6	25.2	27.0	22.6	23.1	24.6	26.3	22.0	22.5	24.1	25.7	21.5	22.0	23.5	25.1	20.4	20.9	22.3	23.8	18.9	19.3	20.6	22.1	
S/T	0.82	0.77	0.63	0.47	0.85	0.80	0.65	0.49	0.87	0.82	0.67	0.50	0.90	0.84	0.69	0.51	0.93	0.88	0.71	0.53	0.94	0.88	0.72	0.54	
ΔT	25	24	21	17	25	24	21	17	25	24	21	17	26	25	22	17	25	24	21	17	24	23	20	16	
kW	1.47	1.51	1.55	1.60	1.59	1.62	1.67	1.73	1.69	1.73	1.78	1.84	1.78	1.82	1.88	1.94	1.85	1.89	1.96	2.02	1.92	1.96	2.03	2.10	
Amps	5.7	5.9	6.0	6.3	6.2	6.3	6.5	6.8	6.7	6.8	7.1	7.3	7.1	7.3	7.5	7.8	7.6	7.8	8.0	8.3	8.0	8.2	8.5	8.8	
HI PR	216	232	235	241	244	262	266	272	277	298	303	309	316	340	345	352	341	367	372	380	404	435	441	451	
Lo PR	117	121	132	140	120	124	136	144	125	128	140	149	128	132	144	153	130	134	147	156	134	138	150	160	
904	MBh	26.2	26.7	28.0	29.9	25.6	26.1	27.4	29.2	25.0	25.5	26.7	28.5	24.4	24.9	26.1	27.8	23.2	23.6	24.8	26.4	21.5	21.9	22.9	24.5
	S/T	0.94	0.90	0.82	0.66	0.97	0.94	0.84	0.69	0.99	0.96	0.87	0.70	1.00	0.99	0.89	0.73	1.00	1.00	0.93	0.75	1.00	1.00	0.94	0.76
	ΔT	25	25	23	20	25	25	24	20	25	25	24	20	25	25	24	21	24	24	23	20	22	22	22	19
	kW	1.50	1.53	1.58	1.63	1.61	1.65	1.70	1.76	1.72	1.75	1.81	1.87	1.81	1.85	1.91	1.97	1.88	1.93	1.99	2.06	1.95	2.00	2.06	2.13
	Amps	5.8	6.0	6.2	6.4	6.3	6.4	6.6	6.9	6.8	7.0	7.2	7.4	7.3	7.4	7.7	7.9	7.7	7.9	8.1	8.4	8.2	8.3	8.6	8.9
	HI PR	220	237	240	245	249	268	271	277	283	304	309	315	322	347	352	359	348	374	380	388	413	444	450	460
	Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	135	147	156	133	137	150	160	136	141	153	163
	MBh	25.5	26.0	27.2	29.0	24.9	25.4	26.6	28.3	24.3	24.8	25.9	27.7	23.7	24.2	25.3	27.0	22.5	22.9	24.0	25.6	20.8	21.3	22.3	23.7
	S/T	0.89	0.86	0.78	0.63	0.93	0.89	0.81	0.65	0.95	0.92	0.83	0.67	0.98	0.94	0.85	0.69	1.00	0.98	0.89	0.72	1.00	0.99	0.89	0.72
	ΔT	26	26	24	21	26	26	25	21	26	26	25	21	27	26	25	21	26	26	24	21	24	24	23	20
kW	1.49	1.52	1.57	1.62	1.60	1.64	1.69	1.74	1.70	1.74	1.80	1.86	1.79	1.83	1.89	1.96	1.87	1.91	1.97	2.04	1.93	1.98	2.04	2.11	
Amps	5.8	5.9	6.1	6.3	6.2	6.4	6.6	6.8	6.7	6.9	7.1	7.4	7.2	7.4	7.6	7.9	7.6	7.8	8.1	8.4	8.1	8.3	8.5	8.9	
HI PR	218	234	238	243	246	265	269	275	280	301	306	312	319	343	348	356	345	371	376	384	409	439	446	455	
Lo PR	118	122	133	142	122	125	137	146	126	130	142	151	129	133	145	155	132	136	148	158	135	139	152	162	
MBh	23.5	24.0	25.1	26.8	23.0	23.4	24.5	26.2	22.4	22.8	23.9	25.5	21.9	22.3	23.3	24.9	20.8	21.2	22.2	23.7	19.2	19.6	20.5	21.9	
S/T	0.86	0.83	0.75	0.61	0.89	0.86	0.78	0.63	0.91	0.88	0.80	0.65	0.94	0.91	0.82	0.67	0.98	0.95	0.85	0.69	0.99	0.95	0.86	0.70	
ΔT	26.7	26	25	22	27	27	25	22	27	27	25	22	27	27	25	22	27	26	25	22	25	25	23	20	
kW	1.47	1.51	1.55	1.60	1.59	1.62	1.67	1.73	1.69	1.73	1.78	1.84	1.78	1.82	1.88	1.94	1.85	1.89	1.96	2.02	1.92	1.96	2.03	2.10	
Amps	5.7	5.9	6.0	6.3	6.2	6.3	6.5	6.8	6.7	6.8	7.1	7.3	7.1	7.3	7.5	7.8	7.6	7.8	8.0	8.3	8.0	8.2	8.5	8.8	
HI PR	216	232	235	241	244	262	266	272	277	298	303	309	316	340	345	352	341	367	372	380	404	435	441	451	
Lo PR	117	121	132	140	120	124	136	144	125	128	140	149	128	132	144	153	130	134	147	156	134	138	150	160	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 Amps = outdoor unit amps (comp.+fan)
 kW = Total system power

EXPANDED COOLING DATA — ASXC160361** / CA*F3743*6A* +TXV / MBVC1600** HIGH STAGE

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE															
		65°F				75°F				85°F				95°F				105°F				115°F							
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
1356	MBh	33.9	35.1	38.5	-	33.1	34.3	37.6	-	32.3	33.5	36.7	-	31.5	32.7	35.8	-	30.0	31.1	34.0	-	30.0	31.1	34.0	-	27.8	28.8	31.5	-
	S/T	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-
	ΔT	17	14	11	-	17	14	11	-	17	14	11	-	17	15	11	-	17	14	11	-	17	14	11	-	16	13	10	-
	kW	2.14	2.18	2.25	-	2.31	2.36	2.43	-	2.45	2.51	2.59	-	2.58	2.64	2.73	-	2.69	2.76	2.85	-	2.69	2.76	2.85	-	2.79	2.85	2.95	-
	Amps	8.1	8.3	8.6	-	8.8	9.0	9.3	-	9.5	9.7	10.0	-	10.1	10.4	10.7	-	10.8	11.1	11.4	-	10.8	11.1	11.4	-	11.4	11.7	12.1	-
70	MBh	32.9	34.1	37.4	-	32.2	33.3	36.5	-	31.4	32.5	35.6	-	30.6	31.7	34.8	-	29.1	30.2	33.0	-	29.1	30.2	33.0	-	26.9	27.9	30.6	-
	S/T	0.68	0.57	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.78	0.65	0.45	-	0.78	0.65	0.45	-	0.79	0.66	0.45	-
	ΔT	17	15	11	-	17	15	11	-	18	15	11	-	18	15	12	-	18	15	11	-	17	15	11	-	16	14	11	-
	kW	2.12	2.17	2.24	-	2.29	2.34	2.41	-	2.43	2.49	2.57	-	2.56	2.62	2.71	-	2.67	2.73	2.82	-	2.67	2.73	2.82	-	2.77	2.83	2.93	-
	Amps	8.0	8.2	8.5	-	8.7	8.9	9.2	-	9.4	9.6	10.0	-	10.1	10.3	10.6	-	10.7	11.0	11.3	-	10.7	11.0	11.3	-	11.3	11.6	12.0	-
1043	MBh	30.4	31.5	34.5	-	29.7	30.8	33.7	-	29.0	30.0	32.9	-	28.3	29.3	32.1	-	26.9	27.8	30.5	-	26.9	27.8	30.5	-	24.9	25.8	28.2	-
	S/T	0.66	0.55	0.38	-	0.68	0.57	0.40	-	0.70	0.59	0.41	-	0.72	0.61	0.42	-	0.75	0.63	0.44	-	0.75	0.63	0.44	-	0.76	0.63	0.44	-
	ΔT	18	15	12	-	18	15	12	-	18	16	12	-	18	16	12	-	18	15	12	-	18	15	12	-	17	14	11	-
	kW	2.10	2.15	2.22	-	2.27	2.32	2.39	-	2.41	2.47	2.55	-	2.54	2.60	2.68	-	2.65	2.71	2.80	-	2.65	2.71	2.80	-	2.74	2.81	2.90	-
	Amps	8.0	8.2	8.4	-	8.6	8.8	9.1	-	9.3	9.6	9.9	-	10.0	10.2	10.5	-	10.6	10.9	11.2	-	10.6	10.9	11.2	-	11.2	11.5	11.9	-

1356	MBh	34.5	35.5	38.4	41.2	33.7	34.7	37.5	40.3	32.9	33.8	36.6	39.3	32.1	33.0	35.7	38.4	30.5	31.4	34.0	36.4	28.2	29.1	31.5	33.8
	S/T	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.94	0.84	0.63	0.41
	ΔT	19	18	14	10	19	18	15	10	19	18	15	10	19	18	15	10	19	18	14	10	18	17	14	9
	kW	2.14	2.18	2.25	2.33	2.31	2.36	2.43	2.51	2.45	2.51	2.59	2.68	2.58	2.64	2.73	2.82	2.69	2.76	2.85	2.95	2.79	2.85	2.95	3.05
	Amps	8.1	8.3	8.6	8.9	8.8	9.0	9.3	9.6	9.5	9.7	10.0	10.4	10.1	10.4	10.7	11.1	10.8	11.1	11.4	11.9	11.4	11.7	12.1	12.6
75	MBh	33.5	34.5	37.3	40.0	32.7	33.7	36.4	39.1	31.9	32.9	35.6	38.2	31.1	32.1	34.7	37.2	29.6	30.5	33.0	35.4	27.4	28.2	30.5	32.8
	S/T	0.78	0.70	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.89	0.79	0.60	0.39	0.89	0.80	0.61	0.39
	ΔT	20	18	15	10	20	19	15	11	20	19	15	11	20	19	15	11	20	19	15	10	19	17	14	10
	kW	2.12	2.17	2.24	2.31	2.29	2.34	2.41	2.49	2.43	2.49	2.57	2.66	2.56	2.62	2.71	2.80	2.67	2.73	2.82	2.92	2.77	2.83	2.93	3.03
	Amps	8.0	8.2	8.5	8.8	8.7	8.9	9.2	9.5	9.4	9.6	10.0	10.3	10.1	10.3	10.6	11.0	10.7	11.0	11.3	11.7	11.3	11.6	12.0	12.4

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ASXC160361** / CA*F3743*6A* +TXV / MBVC1600** HIGH STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	35.1	35.9	38.3	41.0	34.3	35.0	37.4	40.0	33.5	34.2	36.5	39.0	32.6	33.4	35.6	38.1	31.0	31.7	33.9	36.2	31.0	31.7	33.9	36.2
	S/T	0.90	0.84	0.68	0.51	0.93	0.87	0.71	0.53	0.95	0.89	0.73	0.54	1.00	0.92	0.75	0.56	1.00	0.96	0.78	0.58	1.00	0.96	0.78	0.58
	ΔT	21	20	18	14	22	21	18	14	22	21	18	14	22	21	18	14	21	21	18	14	19	19	17	13
	kW	2.14	2.18	2.25	2.33	2.31	2.36	2.43	2.51	2.45	2.51	2.59	2.68	2.58	2.64	2.73	2.82	2.69	2.76	2.85	2.95	2.79	2.85	2.95	3.05
	Amps	8.1	8.3	8.6	8.9	8.8	9.0	9.3	9.6	9.5	9.7	10.0	10.4	10.1	10.4	10.7	11.1	10.8	11.1	11.4	11.9	11.4	11.7	12.1	12.6
	HI PR	232	249	253	259	262	282	286	292	298	321	325	332	340	365	370	379	367	394	400	409	435	467	474	484
	Lo PR	116	120	131	139	119	123	135	143	124	127	139	148	127	131	143	152	129	133	146	155	133	137	149	159
	MBh	34.1	34.8	37.2	39.8	33.3	34.0	36.3	38.8	32.5	33.2	35.5	37.9	31.7	32.4	34.6	37.0	30.1	30.8	32.9	35.1	27.9	28.5	30.4	32.5
	S/T	0.85	0.80	0.65	0.49	0.88	0.83	0.68	0.50	0.91	0.85	0.69	0.52	0.94	0.88	0.71	0.53	0.97	0.91	0.74	0.55	0.98	0.92	0.75	0.56
	ΔT	22	21	19	15	23	22	19	15	23	22	19	15	23	22	19	15	22	21	19	15	21	20	17	14
	kW	2.12	2.17	2.24	2.31	2.29	2.34	2.41	2.49	2.43	2.49	2.57	2.66	2.56	2.62	2.71	2.80	2.67	2.73	2.82	2.92	2.77	2.83	2.93	3.03
Amps	8.0	8.2	8.5	8.8	8.7	8.9	9.2	9.5	9.4	9.6	10.0	10.3	10.1	10.3	10.6	11.0	10.7	11.0	11.3	11.7	11.3	11.6	12.0	12.4	
HI PR	230	247	250	256	260	279	283	289	295	317	322	329	336	362	367	375	363	390	396	405	430	463	469	480	
Lo PR	115	119	129	138	118	122	133	142	122	126	138	147	126	130	141	151	128	132	144	154	131	135	148	157	
MBh	31.4	32.1	34.3	36.7	30.7	31.4	33.5	35.8	30.0	30.6	32.7	35.0	29.3	29.9	31.9	34.1	27.8	28.4	30.3	32.4	25.7	26.3	28.1	30.0	
S/T	0.82	0.77	0.63	0.47	0.85	0.80	0.65	0.49	0.87	0.82	0.67	0.50	0.90	0.85	0.69	0.52	0.94	0.88	0.72	0.53	0.95	0.89	0.72	0.54	
ΔT	23	22	19	15	23	22	19	15	23	22	19	15	23	22	19	16	23	22	19	15	21	21	18	14	
kW	2.10	2.15	2.22	2.29	2.27	2.32	2.39	2.47	2.41	2.47	2.55	2.63	2.54	2.60	2.68	2.78	2.65	2.71	2.80	2.90	2.74	2.81	2.90	3.00	
Amps	8.0	8.2	8.4	8.7	8.6	8.8	9.1	9.4	9.3	9.6	9.9	10.2	10.0	10.2	10.5	10.9	10.6	10.9	11.2	11.6	11.2	11.5	11.9	12.3	
HI PR	227	244	248	253	257	276	280	286	292	314	319	326	333	358	363	371	360	387	392	401	426	458	465	475	
Lo PR	114	117	128	136	117	121	132	140	121	125	136	145	124	128	140	149	127	131	143	152	130	134	146	156	

85	MBh	35.7	36.4	38.1	40.7	34.9	35.6	37.2	39.7	34.0	34.7	36.3	38.8	33.2	33.9	35.5	37.8	31.6	32.2	33.7	35.9	29.2	29.8	31.2	33.3
	S/T	0.94	0.91	0.82	0.66	0.97	0.94	0.85	0.69	1.00	0.96	0.87	0.70	1.00	0.99	0.90	0.73	1.00	1.00	0.93	0.75	1.00	1.00	0.94	0.76
	ΔT	23	22	21	18	23	23	21	19	23	23	21	19	23	23	22	19	21	22	21	18	20	20	20	17
	kW	2.14	2.18	2.25	2.33	2.31	2.36	2.43	2.51	2.45	2.51	2.59	2.68	2.58	2.64	2.73	2.82	2.69	2.76	2.85	2.95	2.79	2.85	2.95	3.05
	Amps	8.1	8.3	8.6	8.9	8.8	9.0	9.3	9.6	9.5	9.7	10.0	10.4	10.1	10.4	10.7	11.1	10.8	11.1	11.4	11.9	11.4	11.7	12.1	12.6
	HI PR	232	249	253	259	262	282	286	292	298	321	325	332	340	365	370	379	367	394	400	409	435	467	474	484
	Lo PR	116	120	131	139	119	123	135	143	124	127	139	148	127	131	143	152	129	133	146	155	133	137	149	159
	MBh	34.7	35.3	37.0	39.5	33.9	34.5	36.1	38.6	33.1	33.7	35.3	37.6	32.2	32.9	34.4	36.7	30.6	31.2	32.7	34.9	28.4	28.9	30.3	32.3
	S/T	0.90	0.86	0.78	0.63	0.93	0.90	0.81	0.66	0.95	0.92	0.83	0.67	0.98	0.95	0.86	0.69	1.00	0.98	0.89	0.72	1.00	0.99	0.89	0.73
	ΔT	24	23	22	19	24	24	22	19	24	24	22	19	24	24	23	20	23	24	22	19	22	22	21	18
	kW	2.12	2.17	2.24	2.31	2.29	2.34	2.41	2.49	2.43	2.49	2.57	2.66	2.56	2.62	2.71	2.80	2.67	2.73	2.82	2.92	2.77	2.83	2.93	3.03
Amps	8.0	8.2	8.5	8.8	8.7	8.9	9.2	9.5	9.4	9.6	10.0	10.3	10.1	10.3	10.6	11.0	10.7	11.0	11.3	11.7	11.3	11.6	12.0	12.4	
HI PR	230	247	250	256	260	279	283	289	295	317	322	329	336	362	367	375	363	390	396	405	430	463	469	480	
Lo PR	115	119	129	138	118	122	133	142	122	126	138	147	126	130	141	151	128	132	144	154	131	135	148	157	
MBh	32.0	32.6	34.2	36.4	31.3	31.9	33.4	35.6	30.5	31.1	32.6	34.7	29.8	30.3	31.8	33.9	28.3	28.8	30.2	32.2	26.2	26.7	28.0	29.8	
S/T	0.86	0.83	0.75	0.61	0.89	0.86	0.78	0.63	0.92	0.89	0.80	0.65	0.95	0.91	0.82	0.67	0.98	0.95	0.86	0.69	0.99	0.96	0.86	0.70	
ΔT	24	24	23	20	25	24	23	20	25	24	23	20	25	24	23	20	24	24	23	20	23	22	21	18	
kW	2.10	2.15	2.22	2.29	2.27	2.32	2.39	2.47	2.41	2.47	2.55	2.63	2.54	2.60	2.68	2.78	2.65	2.71	2.80	2.90	2.74	2.81	2.90	3.00	
Amps	8.0	8.2	8.4	8.7	8.6	8.8	9.1	9.4	9.3	9.6	9.9	10.2	10.0	10.2	10.5	10.9	10.6	10.9	11.2	11.6	11.2	11.5	11.9	12.3	
HI PR	227	244	248	253	257	276	280	286	292	314	319	326	333	358	363	371	360	387	392	401	426	458	465	475	
Lo PR	114	117	128	136	117	121	132	140	121	125	136	145	124	128	140	149	127	131	143	152	130	134	146	156	

Amps = outdoor unit amps (comp.+fan)
kW = Total system power

Shaded area reflects AHRI (TVA) conditions

IDB = Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

EXPANDED COOLING DATA — ASXC160481B* / CA*F4860*6** +TXV/MBVC2000** LOW STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	34.3	35.5	38.9	-	33.5	34.7	38.0	-	32.7	33.9	37.1	-	31.9	33.1	36.2	-	30.3	31.4	34.4	-	28.1	29.1	31.9	-
	S/T	0.74	0.62	0.43	-	0.77	0.64	0.45	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.85	0.71	0.49	-	0.85	0.71	0.49	-
	ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	16	13	-	18	15	12	-
	kW	2.04	2.08	2.15	-	2.20	2.25	2.32	-	2.34	2.39	2.47	-	2.46	2.52	2.60	-	2.57	2.63	2.71	-	2.66	2.72	2.81	-
	Amps	9.8	10.0	10.2	-	10.4	10.6	10.9	-	11.2	11.4	11.8	-	11.9	12.1	12.5	-	12.5	12.8	13.2	-	13.2	13.4	13.8	-
	HI PR	216	232	245	-	242	261	275	-	275	296	313	-	314	337	356	-	353	380	401	-	390	419	443	-
	LO PR	107	114	124	-	113	120	131	-	117	125	136	-	123	131	143	-	129	137	150	-	133	142	155	-
	MBh	33.3	34.5	37.8	-	32.5	33.7	36.9	-	31.7	32.9	36.1	-	31.0	32.1	35.2	-	29.4	30.5	33.4	-	27.3	28.3	31.0	-
	S/T	0.71	0.59	0.41	-	0.73	0.61	0.43	-	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.67	0.47	-	0.81	0.68	0.47	-
	ΔT	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	19	16	12	-
kW	2.02	2.07	2.13	-	2.18	2.23	2.30	-	2.32	2.37	2.45	-	2.44	2.50	2.58	-	2.55	2.60	2.69	-	2.64	2.70	2.79	-	
Amps	9.7	9.9	10.2	-	10.4	10.6	10.9	-	11.1	11.3	11.7	-	11.8	12.0	12.4	-	12.4	12.7	13.0	-	13.1	13.3	13.7	-	
HI PR	214	230	243	-	240	258	272	-	273	293	310	-	310	334	353	-	349	376	397	-	386	415	439	-	
LO PR	106	112	123	-	112	119	130	-	116	123	135	-	122	130	142	-	128	136	148	-	132	141	153	-	
MBh	30.7	31.9	34.9	-	30.0	31.1	34.1	-	29.3	30.4	33.3	-	28.6	29.6	32.5	-	27.2	28.2	30.8	-	25.2	26.1	28.6	-	
S/T	0.68	0.57	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.78	0.65	0.45	-	0.78	0.66	0.45	-	
ΔT	20	17	13	-	20	18	13	-	20	18	13	-	20	18	13	-	20	17	13	-	19	16	12	-	
kW	1.97	2.02	2.08	-	2.13	2.17	2.24	-	2.26	2.31	2.39	-	2.38	2.43	2.51	-	2.48	2.54	2.62	-	2.57	2.63	2.71	-	
Amps	9.5	9.7	9.9	-	10.1	10.3	10.6	-	10.8	11.1	11.4	-	11.5	11.7	12.1	-	12.1	12.4	12.7	-	12.7	13.0	13.4	-	
HI PR	207	223	235	-	232	250	264	-	264	285	300	-	301	324	342	-	339	365	385	-	374	403	425	-	
LO PR	102	109	119	-	108	115	126	-	113	120	131	-	118	126	137	-	124	132	144	-	128	136	149	-	
75	MBh	34.9	35.9	38.9	41.7	34.1	35.1	38.0	40.7	33.3	34.2	37.1	39.8	32.4	33.4	36.2	38.8	30.8	31.7	34.4	36.9	28.6	29.4	31.8	34.2
	S/T	0.84	0.76	0.57	0.37	0.88	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.96	0.86	0.65	0.42	0.97	0.87	0.66	0.42
	ΔT	22	20	17	11	22	20	17	12	22	20	17	12	22	21	17	12	22	20	17	11	21	19	16	11
	kW	2.06	2.10	2.17	2.24	2.22	2.27	2.34	2.42	2.36	2.41	2.49	2.57	2.48	2.54	2.62	2.71	2.59	2.65	2.74	2.83	2.68	2.74	2.83	2.93
	Amps	9.9	10.0	10.3	10.6	10.5	10.7	11.0	11.4	11.3	11.5	11.8	12.2	11.9	12.2	12.6	13.0	12.6	12.9	13.3	13.7	13.3	13.6	14.0	14.4
	HI PR	218	235	248	258	245	263	278	290	278	299	316	330	317	341	360	375	356	383	405	422	394	424	447	467
	LO PR	108	115	125	133	114	121	132	141	118	126	137	146	124	132	144	154	130	139	151	161	135	143	157	167
	MBh	33.9	34.9	37.7	40.5	33.1	34.1	36.9	39.6	32.3	33.2	36.0	38.6	31.5	32.4	35.1	37.7	29.9	30.8	33.3	35.8	27.7	28.5	30.9	33.2
	S/T	0.81	0.72	0.55	0.35	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.37	0.88	0.79	0.60	0.38	0.92	0.82	0.62	0.40	0.93	0.83	0.63	0.40
	ΔT	23	21	17	12	23	21	17	12	23	21	17	12	23	21	18	12	23	21	17	12	21	20	16	11
kW	2.04	2.08	2.15	2.22	2.20	2.25	2.32	2.40	2.34	2.39	2.47	2.55	2.46	2.52	2.60	2.69	2.57	2.63	2.71	2.81	2.66	2.72	2.81	2.91	
Amps	9.8	10.0	10.2	10.6	10.4	10.6	10.9	11.3	11.2	11.4	11.8	12.1	11.9	12.1	12.5	12.9	12.5	12.8	13.2	13.6	13.2	13.4	13.8	14.3	
HI PR	216	232	245	256	242	261	275	287	275	296	313	326	314	338	356	372	353	380	401	418	390	420	443	462	
LO PR	107	114	124	132	113	120	131	139	117	125	136	145	123	131	143	152	129	137	150	160	133	142	155	165	
MBh	31.3	32.2	34.8	37.4	30.5	31.4	34.0	36.5	29.8	30.7	33.2	35.6	29.1	29.9	32.4	34.8	27.6	28.4	30.8	33.0	25.6	26.3	28.5	30.6	
S/T	0.78	0.69	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.88	0.79	0.60	0.39	0.89	0.80	0.60	0.39	
ΔT	23	21	17	12	23	22	18	12	24	22	18	12	24	22	18	12	23	21	18	12	22	20	16	11	
kW	1.99	2.03	2.10	2.17	2.14	2.19	2.26	2.34	2.28	2.33	2.41	2.49	2.40	2.45	2.54	2.62	2.50	2.56	2.64	2.73	2.59	2.65	2.74	2.83	
Amps	9.6	9.7	10.0	10.3	10.2	10.4	10.7	11.0	10.9	11.2	11.5	11.8	11.6	11.8	12.2	12.6	12.2	12.5	12.8	13.3	12.8	13.1	13.5	14.0	
HI PR	209	225	238	248	235	253	267	278	267	287	304	317	304	327	346	361	342	368	389	406	378	407	430	448	
LO PR	104	110	120	128	109	116	127	135	114	121	132	141	119	127	139	148	125	133	145	155	129	138	150	160	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ASXC160481B* / CA*F4860*6** +TXV/MBVC2000** LOW STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
80	1238	MBh	35.5	36.3	38.8	41.4	34.7	35.4	37.9	40.5	33.8	34.6	37.0	39.5	33.0	33.7	36.1	38.5	31.4	32.1	34.2	36.6	29.1	29.7	31.7	33.9
		S/T	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	1.00	0.92	0.75	0.56	1.00	0.95	0.78	0.58	1.00	1.00	0.81	0.60	1.00	1.00	0.81	0.61
		ΔT	24	23	20	16	25	24	21	16	25	24	21	16	25	24	21	17	23	24	20	16	22	22	19	15
		kW	2.07	2.12	2.19	2.26	2.24	2.28	2.36	2.44	2.38	2.43	2.51	2.60	2.50	2.56	2.65	2.74	2.61	2.67	2.76	2.85	2.70	2.77	2.86	2.96
		Amps	9.9	10.1	10.4	10.7	10.6	10.8	11.1	11.5	11.4	11.6	11.9	12.3	12.0	12.3	12.7	13.1	12.7	13.0	13.4	13.8	13.4	13.7	14.1	14.6
		HI PR	220	237	250	261	247	266	281	293	281	302	319	333	320	344	364	379	360	387	409	427	398	428	452	471
		LO PR	109	116	126	135	115	122	134	142	120	127	139	148	126	134	146	155	132	140	153	163	136	145	158	168
		MBh	34.5	35.2	37.6	40.2	33.7	34.4	36.8	39.3	32.9	33.6	35.9	38.4	32.1	32.8	35.0	37.4	30.5	31.1	33.3	35.5	28.2	28.8	30.8	32.9
		S/T	0.88	0.83	0.67	0.50	0.92	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.55	1.00	0.94	0.77	0.57	1.00	0.95	0.77	0.58
		ΔT	25	24	21	17	26	25	21	17	26	25	21	17	26	25	22	17	25	25	21	17	24	23	20	16
	kW	2.06	2.10	2.17	2.24	2.22	2.27	2.34	2.42	2.36	2.41	2.49	2.57	2.48	2.54	2.62	2.71	2.59	2.65	2.74	2.83	2.68	2.74	2.83	2.93	
	Amps	9.9	10.0	10.3	10.6	10.5	10.7	11.0	11.4	11.3	11.5	11.8	12.2	12.0	12.2	12.6	13.0	12.6	12.9	13.3	13.7	13.3	13.6	14.0	14.4	
	HI PR	218	235	248	258	245	263	278	290	278	299	316	330	317	341	360	375	356	384	405	422	394	424	447	467	
	LO PR	108	115	125	133	114	121	132	141	118	126	137	146	124	132	144	154	130	139	151	161	135	143	157	167	
	MBh	31.8	32.5	34.7	37.1	31.1	31.7	33.9	36.3	30.3	31.0	33.1	35.4	29.6	30.2	32.3	34.5	28.1	28.7	30.7	32.8	26.0	26.6	28.4	30.4	
	S/T	0.85	0.80	0.65	0.49	0.88	0.83	0.67	0.50	0.91	0.85	0.69	0.52	0.93	0.88	0.71	0.53	0.97	0.91	0.74	0.55	0.98	0.92	0.75	0.56	
	ΔT	26	25	22	17	26	25	22	17	26	25	22	17	26	25	22	18	26	25	22	17	24	23	20	16	
	kW	2.01	2.05	2.11	2.18	2.16	2.21	2.28	2.36	2.30	2.35	2.43	2.51	2.42	2.48	2.56	2.64	2.52	2.58	2.67	2.76	2.61	2.67	2.76	2.86	
	Amps	9.6	9.8	10.1	10.4	10.3	10.5	10.8	11.1	11.0	11.2	11.6	11.9	11.7	11.9	12.3	12.7	12.3	12.6	12.9	13.4	12.9	13.2	13.6	14.1	
	HI PR	211	228	240	251	237	255	270	281	270	290	307	320	307	331	349	364	346	372	393	410	382	411	434	453	
	LO PR	105	111	121	129	110	118	128	137	115	122	133	142	121	128	140	149	126	134	147	156	131	139	152	162	
85	1238	MBh	36.1	36.8	38.6	41.1	35.3	36.0	37.7	40.2	34.4	35.1	36.8	39.2	33.6	34.2	35.9	38.3	31.9	32.5	34.1	36.4	29.6	30.1	31.6	33.7
		S/T	0.97	0.94	0.85	0.69	1.00	0.97	0.88	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.93	0.75	1.00	1.00	0.96	0.78	1.00	1.00	0.97	0.79
		ΔT	26	26	24	21	26	26	25	21	26	26	25	21	25	25	25	21	24	24	24	21	22	22	23	20
		kW	2.09	2.13	2.20	2.28	2.25	2.30	2.38	2.46	2.40	2.45	2.53	2.62	2.53	2.58	2.67	2.76	2.63	2.69	2.78	2.88	2.73	2.79	2.88	2.98
		Amps	10.0	10.2	10.5	10.8	10.7	10.9	11.2	11.6	11.5	11.7	12.0	12.4	12.1	12.4	12.8	13.2	12.8	13.1	13.5	13.9	13.5	13.8	14.2	14.7
		HI PR	222	239	253	264	249	268	284	296	284	305	322	336	323	348	367	383	364	391	413	431	402	432	456	476
		LO PR	110	117	128	136	116	124	135	144	121	128	140	149	127	135	147	157	133	141	154	164	137	146	160	170
		MBh	35.1	35.7	37.4	39.9	34.3	34.9	36.6	39.0	33.4	34.1	35.7	38.1	32.6	33.3	34.8	37.2	31.0	31.6	33.1	35.3	28.7	29.3	30.6	32.7
		S/T	0.93	0.89	0.81	0.65	0.96	0.93	0.84	0.68	0.98	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.75	1.00	1.00	0.93	0.75
		ΔT	27	27	25	22	27	27	26	22	28	27	26	22	27	27	26	22	26	26	25	22	24	24	24	21
	kW	2.07	2.12	2.19	2.26	2.24	2.28	2.36	2.44	2.38	2.43	2.51	2.60	2.50	2.56	2.65	2.74	2.61	2.67	2.76	2.85	2.70	2.77	2.86	2.96	
	Amps	9.9	10.1	10.4	10.7	10.6	10.8	11.1	11.5	11.4	11.6	11.9	12.3	12.0	12.3	12.7	13.1	12.7	13.0	13.4	13.8	13.4	13.7	14.1	14.6	
	HI PR	220	237	250	261	247	266	281	293	281	302	319	333	320	344	364	379	360	387	409	427	398	428	452	471	
	LO PR	109	116	126	135	115	122	134	142	120	127	139	148	126	134	146	155	132	140	153	163	136	145	158	168	
	MBh	32.4	33.0	34.6	36.9	31.6	32.2	33.8	36.0	30.9	31.5	32.9	35.1	30.1	30.7	32.1	34.3	28.6	29.2	30.5	32.6	26.5	27.0	28.3	30.2	
	S/T	0.89	0.86	0.78	0.63	0.93	0.89	0.81	0.65	0.95	0.92	0.83	0.67	0.98	0.95	0.85	0.69	1.00	0.98	0.89	0.72	1.00	0.99	0.89	0.72	
	ΔT	28	27	26	22	28	27	26	22	28	28	26	22	28	28	26	23	27	27	26	22	25	26	24	21	
	kW	2.02	2.07	2.13	2.20	2.18	2.23	2.30	2.38	2.32	2.37	2.45	2.53	2.44	2.50	2.58	2.67	2.55	2.60	2.69	2.78	2.64	2.69	2.79	2.88	
	Amps	9.7	9.9	10.2	10.5	10.4	10.6	10.9	11.2	11.1	11.3	11.7	12.0	11.8	12.0	12.4	12.8	12.4	12.7	13.0	13.5	13.1	13.3	13.7	14.2	
	HI PR	214	230	243	253	240	258	272	284	273	293	310	323	310	334	353	368	349	376	397	414	386	415	438	457	
	LO PR	106	112	123	131	112	119	130	138	116	123	135	143	122	130	141	151	128	136	148	158	132	140	153	163	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.-fan)

EXPANDED COOLING DATA — ASXC160481B* / CA*F4860*6** +TXV/MBVC2000** HIGH STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	46.1	47.7	52.3	-	45.0	46.6	51.1	-	43.9	45.5	49.9	-	42.8	44.4	48.7	-	40.7	42.2	46.2	-	37.7	39.1	42.8	-
	S/T	0.74	0.62	0.43	-	0.77	0.64	0.45	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.85	0.71	0.49	-	0.85	0.71	0.49	-
	ΔT	17	15	11	-	18	15	12	-	18	15	12	-	18	15	12	-	18	15	12	-	16	14	11	-
	kW	3.03	3.10	3.19	-	3.27	3.34	3.45	-	3.48	3.55	3.67	-	3.66	3.74	3.87	-	3.82	3.90	4.03	-	3.95	4.04	4.18	-
	Amps	14.6	14.9	15.3	-	15.5	15.9	16.3	-	16.7	17.0	17.5	-	17.6	18.0	18.5	-	18.6	19.0	19.5	-	19.5	20.0	20.5	-
	HI PR	235	253	267	-	264	284	300	-	300	323	341	-	341	367	388	-	384	413	437	-	424	457	482	-
	LO PR	104	111	121	-	110	117	128	-	114	122	133	-	120	128	140	-	126	134	146	-	130	139	151	-
	MBh	44.7	46.3	50.8	-	43.7	45.3	49.6	-	42.6	44.2	48.4	-	41.6	43.1	47.2	-	39.5	41.0	44.9	-	36.6	37.9	41.6	-
	S/T	0.71	0.59	0.41	-	0.73	0.61	0.43	-	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.67	0.47	-	0.81	0.68	0.47	-
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-
	kW	3.01	3.07	3.17	-	3.24	3.31	3.42	-	3.45	3.52	3.64	-	3.63	3.71	3.83	-	3.78	3.87	4.00	-	3.92	4.01	4.14	-
	Amps	14.5	14.8	15.1	-	15.4	15.7	16.2	-	16.5	16.9	17.3	-	17.5	17.8	18.4	-	18.4	18.8	19.4	-	19.4	19.8	20.4	-
HI PR	233	250	264	-	261	281	297	-	297	319	337	-	338	364	384	-	380	409	432	-	420	452	478	-	
LO PR	103	110	120	-	109	116	127	-	113	120	132	-	119	127	138	-	125	133	145	-	129	137	150	-	
MBh	41.3	42.8	46.9	-	40.3	41.8	45.8	-	39.4	40.8	44.7	-	38.4	39.8	43.6	-	36.5	37.8	41.4	-	33.8	35.0	38.4	-	
S/T	0.68	0.57	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.78	0.65	0.45	-	0.78	0.66	0.45	-	
ΔT	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-	
kW	2.93	3.00	3.09	-	3.16	3.23	3.33	-	3.36	3.44	3.55	-	3.54	3.62	3.74	-	3.69	3.77	3.90	-	3.82	3.90	4.04	-	
Amps	14.2	14.4	14.8	-	15.1	15.4	15.8	-	16.1	16.5	16.9	-	17.1	17.4	17.9	-	18.0	18.4	18.9	-	18.9	19.3	19.9	-	
HI PR	226	243	256	-	253	272	288	-	288	310	327	-	328	353	373	-	369	397	419	-	408	439	463	-	
LO PR	100	106	116	-	106	112	123	-	110	117	128	-	115	123	134	-	121	129	140	-	125	133	145	-	
75	MBh	46.8	48.2	52.2	56.0	45.7	47.1	51.0	54.7	44.7	46.0	49.8	53.4	43.6	44.9	48.6	52.1	41.4	42.6	46.1	49.5	38.3	39.5	42.7	45.9
	S/T	0.84	0.76	0.57	0.37	0.88	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.96	0.86	0.65	0.42	0.97	0.87	0.66	0.42
	ΔT	20	19	15	11	20	19	15	11	20	19	15	11	21	19	16	11	20	19	15	11	19	17	14	10
	kW	3.06	3.12	3.22	3.33	3.29	3.37	3.48	3.59	3.51	3.58	3.70	3.83	3.69	3.77	3.90	4.03	3.85	3.94	4.07	4.21	3.99	4.08	4.21	4.36
	Amps	14.7	15.0	15.4	15.9	15.7	16.0	16.4	16.9	16.8	17.1	17.6	18.2	17.8	18.1	18.6	19.3	18.7	19.1	19.7	20.3	19.7	20.1	20.7	21.4
	HI PR	237	255	270	281	266	287	303	316	303	326	344	359	345	371	392	409	388	418	441	460	429	461	487	508
	LO PR	105	112	122	130	111	118	129	138	116	123	134	143	121	129	141	150	127	135	148	157	132	140	153	163
	MBh	45.5	46.8	50.7	54.4	44.4	45.7	49.5	53.1	43.4	44.6	48.3	51.9	42.3	43.6	47.1	50.6	40.2	41.4	44.8	48.1	37.2	38.3	41.5	44.5
	S/T	0.81	0.72	0.55	0.35	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.37	0.88	0.79	0.60	0.38	0.92	0.82	0.62	0.40	0.93	0.83	0.63	0.40
	ΔT	21	19	16	11	21	20	16	11	21	20	16	11	21	20	16	11	21	20	16	11	20	18	15	10
	kW	3.03	3.10	3.20	3.30	3.27	3.34	3.45	3.56	3.48	3.55	3.67	3.79	3.66	3.74	3.87	4.00	3.82	3.90	4.03	4.17	3.95	4.04	4.18	4.32
	Amps	14.6	14.9	15.3	15.7	15.5	15.9	16.3	16.8	16.7	17.0	17.5	18.0	17.6	18.0	18.5	19.1	18.6	19.0	19.5	20.2	19.5	20.0	20.5	21.2
HI PR	235	253	267	278	264	284	300	312	300	323	341	355	342	368	388	405	384	413	437	455	424	457	482	503	
LO PR	104	111	121	129	110	117	128	136	114	122	133	142	120	128	140	149	126	134	146	156	130	139	151	161	
MBh	42.0	43.2	46.8	50.2	41.0	42.2	45.7	49.0	40.0	41.2	44.6	47.9	39.0	40.2	43.5	46.7	37.1	38.2	41.3	44.4	34.4	35.4	38.3	41.1	
S/T	0.78	0.69	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.88	0.79	0.60	0.39	0.89	0.80	0.60	0.39	
ΔT	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	20	19	15	10	
kW	2.96	3.02	3.12	3.22	3.19	3.26	3.36	3.47	3.39	3.46	3.58	3.70	3.57	3.65	3.77	3.90	3.72	3.80	3.93	4.06	3.85	3.94	4.07	4.21	
Amps	14.3	14.5	14.9	15.4	15.2	15.5	15.9	16.4	16.3	16.6	17.1	17.6	17.2	17.6	18.1	18.6	18.1	18.5	19.1	19.7	19.1	19.5	20.0	20.7	
HI PR	228	245	259	270	256	275	291	303	291	313	331	345	331	356	376	393	373	401	423	442	412	443	468	488	
LO PR	101	108	117	125	107	114	124	132	111	118	129	137	117	124	135	144	122	130	142	151	126	134	147	156	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ASXC160481B* / CA*F4860*6** +TXV/MBVC2000** HIGH STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
80	1800	MBh	47.7	48.7	52.0	55.6	46.6	47.6	50.8	54.3	45.5	46.4	49.6	53.0	44.3	45.3	48.4	51.8	42.1	43.0	46.0	49.2	39.0	39.9	42.6	45.5
	S/T	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	1.00	0.92	0.75	0.56	1.00	0.95	0.78	0.58	1.00	1.00	0.81	0.60	1.00	1.00	0.81	0.61	
	ΔT	23	22	19	15	23	22	19	15	23	22	19	15	23	22	19	15	22	22	19	15	20	20	18	14	
	kW	3.08	3.15	3.25	3.35	3.32	3.39	3.51	3.62	3.53	3.61	3.73	3.86	3.72	3.81	3.93	4.07	3.88	3.97	4.10	4.24	4.02	4.11	4.25	4.40	
	Amps	14.8	15.1	15.5	16.0	15.8	16.1	16.5	17.1	16.9	17.3	17.8	18.3	17.9	18.3	18.8	19.4	18.9	19.3	19.8	20.5	19.9	20.3	20.9	21.6	
	HI PR	240	258	272	284	269	289	306	319	306	329	348	363	348	375	396	413	392	422	445	465	433	466	492	513	
	LO PR	106	113	123	131	112	119	130	139	117	124	136	144	123	130	142	152	129	137	149	159	133	141	154	164	
	1600	MBh	46.3	47.3	50.5	54.0	45.2	46.2	49.4	52.8	44.1	45.1	48.2	51.5	43.1	44.0	47.0	50.2	40.9	41.8	44.7	47.7	37.9	38.7	41.4	44.2
	S/T	0.88	0.83	0.67	0.50	0.92	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.55	1.00	0.94	0.77	0.57	1.00	0.95	0.77	0.58	
	ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	21	18	15	
kW	3.06	3.12	3.22	3.33	3.29	3.37	3.48	3.59	3.51	3.58	3.70	3.83	3.69	3.77	3.90	4.03	3.85	3.94	4.07	4.21	3.99	4.08	4.21	4.36		
Amps	14.7	15.0	15.4	15.9	15.7	16.0	16.4	16.9	16.8	17.1	17.6	18.2	17.8	18.1	18.7	19.3	18.7	19.1	19.7	20.3	19.7	20.1	20.7	21.4		
HI PR	237	255	270	281	266	287	303	316	303	326	344	359	345	371	392	409	388	418	441	460	429	461	487	508		
LO PR	105	112	122	130	111	118	129	138	116	123	134	143	121	129	141	150	127	135	148	157	132	140	153	163		
1400	MBh	42.7	43.6	46.6	49.9	41.7	42.6	45.6	48.7	40.7	41.6	44.5	47.5	39.7	40.6	43.4	46.4	37.8	38.6	41.2	44.1	35.0	35.7	38.2	40.8	
S/T	0.85	0.80	0.65	0.49	0.88	0.83	0.67	0.50	0.91	0.85	0.69	0.52	0.93	0.88	0.71	0.53	0.97	0.91	0.74	0.55	0.98	0.92	0.75	0.56		
ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	22	19	15		
kW	2.98	3.05	3.14	3.24	3.21	3.28	3.39	3.50	3.42	3.49	3.61	3.73	3.60	3.68	3.80	3.93	3.75	3.84	3.96	4.10	3.88	3.97	4.11	4.25		
Amps	14.4	14.6	15.0	15.5	15.3	15.6	16.0	16.5	16.4	16.7	17.2	17.7	17.3	17.7	18.2	18.8	18.3	18.7	19.2	19.8	19.2	19.6	20.2	20.9		
HI PR	230	248	262	273	258	278	294	306	294	316	334	348	335	360	380	397	376	405	428	446	416	448	473	493		
LO PR	102	109	119	126	108	115	125	133	112	119	130	139	118	125	137	146	123	131	143	153	128	136	148	158		
85	1800	MBh	48.5	49.4	51.8	55.2	47.4	48.3	50.6	54.0	46.2	47.1	49.4	52.7	45.1	46.0	48.2	51.4	42.9	43.7	45.8	48.8	39.7	40.5	42.4	45.2
	S/T	0.97	0.94	0.85	0.69	1.00	0.97	0.88	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.93	0.75	1.00	1.00	0.96	0.78	1.00	1.00	0.97	0.79	
	ΔT	24	24	22	19	24	24	23	20	24	24	23	20	23	23	23	20	22	22	23	19	20	21	21	18	
	kW	3.11	3.17	3.27	3.38	3.35	3.42	3.53	3.65	3.56	3.64	3.76	3.89	3.75	3.84	3.97	4.10	3.92	4.00	4.14	4.28	4.05	4.15	4.29	4.44	
	Amps	14.9	15.2	15.6	16.1	15.9	16.2	16.7	17.2	17.0	17.4	17.9	18.5	18.0	18.4	18.9	19.6	19.0	19.4	20.0	20.7	20.0	20.4	21.0	21.8	
	HI PR	242	261	275	287	272	292	309	322	309	332	351	366	352	379	400	417	396	426	450	469	437	471	497	518	
	LO PR	107	114	125	133	113	121	132	140	118	125	137	146	124	132	144	153	130	138	151	161	134	143	156	166	
	1600	MBh	47.1	48.0	50.3	53.6	46.0	46.9	49.1	52.4	44.9	45.8	47.9	51.1	43.8	44.7	46.8	49.9	41.6	42.4	44.4	47.4	38.5	39.3	41.2	43.9
	S/T	0.93	0.89	0.81	0.65	0.96	0.93	0.84	0.68	0.98	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.75	1.00	1.00	0.93	0.75	
	ΔT	25	25	23	20	25	25	24	20	25	25	24	20	25	25	24	21	24	24	23	20	22	23	22	19	
kW	3.08	3.15	3.25	3.35	3.32	3.39	3.51	3.62	3.53	3.61	3.73	3.86	3.72	3.81	3.93	4.07	3.88	3.97	4.10	4.24	4.02	4.11	4.25	4.40		
Amps	14.8	15.1	15.5	16.0	15.8	16.1	16.5	17.1	16.9	17.3	17.8	18.3	17.9	18.3	18.8	19.4	18.9	19.3	19.8	20.5	19.9	20.3	20.9	21.6		
HI PR	240	258	272	284	269	289	306	319	306	329	348	363	348	375	396	413	392	422	445	465	433	466	492	513		
LO PR	106	113	123	131	112	119	130	139	117	124	136	144	123	130	142	152	129	137	149	159	133	141	154	164		
1400	MBh	43.5	44.3	46.4	49.5	42.5	43.3	45.3	48.4	41.4	42.2	44.2	47.2	40.4	41.2	43.2	46.0	38.4	39.2	41.0	43.7	35.6	36.3	38.0	40.5	
S/T	0.89	0.86	0.78	0.63	0.93	0.89	0.81	0.65	0.95	0.92	0.83	0.67	0.98	0.95	0.85	0.69	1.00	0.98	0.89	0.72	1.00	0.99	0.89	0.72		
ΔT	25	25	24	21	26	25	24	21	26	25	24	21	26	26	24	21	25	25	24	21	23	24	22	19		
kW	3.01	3.07	3.17	3.27	3.24	3.31	3.42	3.53	3.45	3.52	3.64	3.76	3.63	3.71	3.83	3.96	3.78	3.87	4.00	4.13	3.92	4.01	4.14	4.28		
Amps	14.5	14.7	15.1	15.6	15.4	15.7	16.2	16.7	16.5	16.9	17.3	17.9	17.5	17.8	18.3	18.9	18.4	18.8	19.4	20.0	19.4	19.8	20.4	21.0		
HI PR	233	250	264	276	261	281	296	309	297	319	337	352	338	364	384	401	380	409	432	451	420	452	477	498		
LO PR	103	110	120	128	109	116	127	135	113	120	132	140	119	127	138	147	125	133	145	154	129	137	150	159		

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp. + fan)

EXPANDED COOLING DATA — ASXC160601B* / CA*F496*6**+TXV / MBVC2000*-1** LOW STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
70	1350	MBh	39.3	40.7	44.6	-	38.3	39.7	43.5	-	37.4	38.8	42.5	-	36.5	37.8	41.5	-	34.7	36.0	39.4	-	32.1	33.3	36.5	-
		S/T	0.73	0.61	0.42	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.47	-	0.83	0.70	0.48	-	0.84	0.70	0.49	-
	ΔT	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	18	16	12	-	
	kW	2.43	2.49	2.57	-	2.63	2.69	2.78	-	2.81	2.87	2.97	-	2.96	3.03	3.14	-	3.09	3.17	3.28	-	3.21	3.28	3.40	-	
	Amps	9.9	10.1	10.4	-	10.7	10.9	11.3	-	11.6	11.9	12.3	-	12.4	12.7	13.1	-	13.2	13.5	14.0	-	14.0	14.3	14.8	-	
	HI PR	214	231	244	-	241	259	273	-	274	294	311	-	312	335	354	-	351	377	398	-	387	417	440	-	
	LO PR	107	114	124	-	113	120	132	-	118	125	137	-	124	132	144	-	130	138	150	-	134	143	156	-	
	MBh	38.7	40.1	43.9	-	37.8	39.2	42.9	-	36.9	38.2	41.9	-	36.0	37.3	40.9	-	34.2	35.4	38.8	-	31.7	32.8	35.9	-	
	S/T	0.70	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.62	0.43	-	0.77	0.64	0.45	-	0.80	0.67	0.46	-	0.81	0.67	0.47	-	
	ΔT	21	18	13	-	21	18	14	-	21	18	14	-	21	18	14	-	21	18	14	-	19	17	13	-	
kW	2.42	2.47	2.56	-	2.62	2.68	2.77	-	2.79	2.85	2.95	-	2.94	3.01	3.12	-	3.07	3.15	3.26	-	3.19	3.26	3.38	-		
Amps	9.8	10.0	10.4	-	10.6	10.9	11.2	-	11.5	11.8	12.2	-	12.3	12.6	13.0	-	13.1	13.4	13.9	-	13.9	14.2	14.7	-		
HI PR	213	229	242	-	239	257	271	-	272	292	309	-	309	333	352	-	348	375	396	-	385	414	437	-		
LO PR	106	113	124	-	112	120	131	-	117	124	136	-	123	131	143	-	129	137	149	-	133	142	155	-		
MBh	35.7	37.0	40.5	-	34.9	36.1	39.6	-	34.0	35.3	38.6	-	33.2	34.4	37.7	-	31.5	32.7	35.8	-	29.2	30.3	33.2	-		
S/T	0.68	0.57	0.39	-	0.70	0.59	0.41	-	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.77	0.64	0.45	-	0.78	0.65	0.45	-		
ΔT	21	18	14	-	21	19	14	-	21	19	14	-	22	19	14	-	21	18	14	-	20	17	13	-		
kW	2.36	2.41	2.49	-	2.55	2.61	2.69	-	2.72	2.78	2.88	-	2.87	2.93	3.03	-	2.99	3.06	3.17	-	3.10	3.18	3.29	-		
Amps	9.5	9.8	10.1	-	10.3	10.6	10.9	-	11.2	11.5	11.8	-	12.0	12.3	12.7	-	12.7	13.0	13.5	-	13.5	13.8	14.3	-		
HI PR	207	222	235	-	232	249	263	-	264	284	299	-	300	323	341	-	338	363	384	-	373	401	424	-		
LO PR	103	110	120	-	109	116	127	-	113	121	132	-	119	127	138	-	125	133	145	-	129	137	150	-		
75	1350	MBh	39.92	41.10	44.49	47.75	38.99	40.14	43.45	46.64	38.06	39.19	42.42	45.52	37.13	38.23	41.38	44.41	35.28	36.32	39.31	42.19	32.68	33.64	36.42	39.08
		S/T	0.83	0.75	0.56	0.36	0.86	0.77	0.58	0.38	0.89	0.79	0.60	0.39	0.91	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.96	0.86	0.65	0.42
	ΔT	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	20	16	11	
	kW	2.45	2.51	2.59	2.68	2.65	2.72	2.81	2.90	2.83	2.90	3.00	3.10	2.99	3.06	3.16	3.27	3.12	3.19	3.31	3.42	3.24	3.31	3.43	3.55	
	Amps	10.0	10.2	10.5	10.9	10.8	11.0	11.4	11.8	11.7	12.0	12.4	12.8	12.5	12.8	13.2	13.7	13.3	13.6	14.1	14.6	14.1	14.4	14.9	15.5	
	HI PR	217	233	246	257	243	262	276	288	276	297	314	328	315	339	358	373	354	381	402	420	391	421	445	464	
	LO PR	108	115	126	134	114	122	133	142	119	126	138	147	125	133	145	154	131	139	152	162	135	144	157	167	
	MBh	39.3	40.5	43.8	47.0	38.4	39.6	42.8	45.9	37.5	38.6	41.8	44.9	36.6	37.7	40.8	43.8	34.8	35.8	38.7	41.6	32.2	33.1	35.9	38.5	
	S/T	0.80	0.71	0.54	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.57	0.37	0.88	0.78	0.59	0.38	0.91	0.81	0.62	0.40	0.92	0.82	0.62	0.40	
	ΔT	24	22	18	12	24	22	18	13	24	22	18	13	24	22	18	13	24	22	18	12	22	21	17	12	
kW	2.44	2.49	2.58	2.67	2.64	2.70	2.79	2.89	2.81	2.88	2.98	3.08	2.97	3.04	3.14	3.25	3.10	3.17	3.28	3.40	3.22	3.29	3.41	3.53		
Amps	9.9	10.1	10.5	10.9	10.7	11.0	11.3	11.7	11.6	11.9	12.3	12.8	12.4	12.7	13.1	13.6	13.2	13.5	14.0	14.5	14.0	14.4	14.8	15.4		
HI PR	215	231	244	255	241	260	274	286	274	295	312	325	313	336	355	370	352	378	400	417	389	418	442	461		
LO PR	108	114	125	133	114	121	132	141	118	126	137	146	124	132	144	153	130	138	151	161	134	143	156	166		
MBh	36.3	37.4	40.5	43.4	35.5	36.5	39.5	42.4	34.6	35.6	38.6	41.4	33.8	34.8	37.6	40.4	32.1	33.0	35.8	38.4	29.7	30.6	33.1	35.5		
S/T	0.77	0.69	0.52	0.34	0.80	0.71	0.54	0.35	0.82	0.73	0.55	0.36	0.84	0.76	0.57	0.37	0.88	0.78	0.59	0.38	0.88	0.79	0.60	0.38		
ΔT	24	23	18	13	25	23	19	13	25	23	19	13	25	23	19	13	25	23	19	13	23	21	17	12		
kW	2.38	2.43	2.51	2.60	2.57	2.63	2.72	2.81	2.74	2.80	2.90	3.00	2.89	2.96	3.06	3.17	3.02	3.09	3.20	3.31	3.13	3.20	3.32	3.43		
Amps	9.6	9.9	10.2	10.6	10.4	10.7	11.0	11.4	11.3	11.6	12.0	12.4	12.1	12.4	12.8	13.3	12.9	13.2	13.6	14.1	13.6	14.0	14.4	15.0		
HI PR	209	224	237	247	234	252	266	277	266	286	303	316	303	326	345	359	341	367	388	404	377	406	428	447		
LO PR	104	111	121	129	110	117	128	136	115	122	133	142	120	128	140	149	126	134	146	156	130	139	151	161		

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 Amps = outdoor unit amps (comp.+fan)
 kW = Total system power

EXPANDED COOLING DATA — ASXC160601B* / CA*F496*6**+TXV / MBVC2000*-1** LOW STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	40.63	41.51	44.35	47.41	39.68	40.55	43.32	46.31	38.74	39.58	42.29	45.21	37.79	38.62	41.26	44.11	35.90	36.69	39.20	41.90	33.26	33.98	36.31	38.81
	S/T	0.91	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.97	0.91	0.74	0.55	1.00	0.94	0.77	0.57	1.00	0.98	0.79	0.59	1.00	0.98	0.80	0.60
	ΔT	25	24	21	17	26	25	21	17	26	25	21	17	26	25	22	17	24	24	21	17	23	23	20	16
	kW	2.47	2.53	2.62	2.70	2.68	2.74	2.83	2.93	2.86	2.92	3.02	3.13	3.01	3.08	3.19	3.30	3.15	3.22	3.33	3.45	3.26	3.34	3.46	3.58
	Amps	10.1	10.3	10.6	11.0	10.9	11.1	11.5	11.9	11.8	12.1	12.5	13.0	12.6	12.9	13.4	13.9	13.4	13.8	14.2	14.8	14.2	14.6	15.1	15.6
	HI PR	219	235	249	259	245	264	279	291	279	300	317	331	318	342	361	377	358	385	406	424	395	425	449	468
	LO PR	109	116	127	135	116	123	134	143	120	128	139	149	126	134	147	156	132	141	154	164	137	145	159	169
	MBh	40.0	40.9	43.7	46.7	39.1	39.9	42.7	45.6	38.2	39.0	41.7	44.5	37.2	38.0	40.6	43.5	35.4	36.1	38.6	41.3	32.8	33.5	35.8	38.2
	S/T	0.88	0.82	0.67	0.50	0.91	0.85	0.69	0.52	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	1.00	0.93	0.76	0.57	1.00	0.94	0.77	0.57
	ΔT	26	25	22	18	27	26	22	18	27	26	22	18	27	26	23	18	27	26	22	18	25	24	21	17
kW	2.46	2.52	2.60	2.69	2.66	2.72	2.81	2.91	2.84	2.90	3.00	3.11	3.00	3.07	3.17	3.28	3.13	3.20	3.31	3.43	3.24	3.32	3.44	3.56	
Amps	10.0	10.2	10.6	11.0	10.8	11.1	11.4	11.8	11.7	12.0	12.4	12.9	12.5	12.8	13.3	13.8	13.3	13.7	14.1	14.7	14.1	14.5	15.0	15.5	
HI PR	217	234	247	257	244	262	277	289	277	298	315	329	316	340	359	374	355	382	404	421	392	422	446	465	
LO PR	109	116	126	134	115	122	133	142	119	127	139	148	125	133	146	155	131	140	152	162	136	144	158	168	
MBh	36.9	37.8	40.3	43.1	36.1	36.9	39.4	42.1	35.2	36.0	38.5	41.1	34.4	35.1	37.5	40.1	32.6	33.4	35.6	38.1	30.2	30.9	33.0	35.3	
S/T	0.84	0.79	0.64	0.48	0.87	0.82	0.67	0.50	0.90	0.84	0.68	0.51	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	0.97	0.91	0.74	0.55	
ΔT	27	26	23	18	28	26	23	18	28	27	23	18	28	27	23	19	27	26	23	18	26	25	21	17	
kW	2.40	2.45	2.53	2.62	2.59	2.65	2.74	2.84	2.77	2.83	2.93	3.03	2.92	2.99	3.09	3.20	3.05	3.12	3.23	3.34	3.16	3.23	3.35	3.46	
Amps	9.7	10.0	10.3	10.7	10.5	10.8	11.1	11.5	11.4	11.7	12.1	12.5	12.2	12.5	12.9	13.4	13.0	13.3	13.7	14.3	13.7	14.1	14.6	15.1	
HI PR	211	227	239	250	236	254	269	280	269	289	306	319	306	330	348	363	345	371	392	408	381	410	433	451	
LO PR	105	112	122	130	111	118	129	138	116	123	134	143	122	129	141	150	127	135	148	158	132	140	153	163	
85	MBh	41.34	42.14	44.13	47.08	40.38	41.16	43.11	45.99	39.41	40.18	42.08	44.89	38.45	39.20	41.05	43.80	36.53	37.24	39.00	41.61	33.84	34.49	36.13	38.54
	S/T	0.96	0.92	0.83	0.68	0.99	0.96	0.86	0.70	1.00	0.98	0.89	0.72	1.00	0.92	0.74	0.74	1.00	0.95	0.77	1.00	0.96	0.78		
	ΔT	27	27	25	22	27	27	25	22	27	27	25	22	26	27	26	22	25	25	25	22	23	23	24	20
	kW	2.50	2.55	2.64	2.73	2.70	2.76	2.86	2.96	2.88	2.95	3.05	3.16	3.04	3.11	3.22	3.33	3.18	3.25	3.36	3.48	3.29	3.37	3.49	3.61
	Amps	10.1	10.4	10.7	11.1	11.0	11.2	11.6	12.0	11.9	12.2	12.6	13.1	12.7	13.0	13.5	14.0	13.6	13.9	14.4	14.9	14.4	14.7	15.2	15.8
	HI PR	221	238	251	262	248	267	282	294	282	303	320	334	321	346	365	381	361	389	411	428	399	430	454	473
	LO PR	110	118	128	137	117	124	136	144	121	129	141	150	127	136	148	158	134	142	155	165	138	147	160	171
	MBh	40.7	41.5	43.5	46.4	39.8	40.5	42.5	45.3	38.8	39.6	41.5	44.2	37.9	38.6	40.4	43.1	36.0	36.7	38.4	41.0	33.3	34.0	35.6	38.0
	S/T	0.92	0.89	0.80	0.65	0.95	0.92	0.83	0.67	0.98	0.94	0.85	0.69	1.00	0.97	0.88	0.71	1.00	0.90	0.74	1.00	0.92	0.74		
	ΔT	28	28	26	23	29	29	27	23	29	28	27	23	29	28	27	23	27	28	26	23	25	26	25	21
kW	2.48	2.54	2.62	2.71	2.68	2.75	2.84	2.94	2.86	2.93	3.03	3.14	3.02	3.09	3.20	3.31	3.16	3.23	3.34	3.46	3.27	3.35	3.47	3.59	
Amps	10.1	10.3	10.7	11.1	10.9	11.2	11.5	12.0	11.8	12.1	12.5	13.0	12.7	13.0	13.4	13.9	13.5	13.8	14.3	14.8	14.3	14.6	15.1	15.7	
HI PR	219	236	249	260	246	265	280	292	280	301	318	332	319	343	362	378	359	386	408	425	396	427	450	470	
LO PR	110	117	127	136	116	123	135	143	120	128	140	149	127	135	147	157	133	141	154	164	137	146	159	170	
MBh	37.6	38.3	40.1	42.8	36.7	37.4	39.2	41.8	35.8	36.5	38.3	40.8	35.0	35.6	37.3	39.8	33.2	33.9	35.5	37.8	30.8	31.4	32.9	35.0	
S/T	0.88	0.85	0.77	0.63	0.92	0.88	0.80	0.65	0.94	0.91	0.82	0.66	0.97	0.94	0.85	0.69	1.00	0.97	0.88	0.71	1.00	0.98	0.88	0.72	
ΔT	29	29	27	24	29	29	27	24	30	29	27	24	30	29	28	24	29	29	27	24	27	27	25	22	
kW	2.42	2.47	2.56	2.64	2.62	2.67	2.77	2.86	2.79	2.85	2.95	3.05	2.94	3.01	3.12	3.22	3.07	3.15	3.25	3.37	3.19	3.26	3.38	3.49	
Amps	9.8	10.0	10.4	10.8	10.6	10.9	11.2	11.6	11.5	11.8	12.2	12.6	12.3	12.6	13.0	13.5	13.1	13.4	13.9	14.4	13.9	14.2	14.7	15.3	
HI PR	213	229	242	252	239	257	271	283	272	292	309	322	309	333	352	367	348	374	395	412	385	414	437	456	
LO PR	106	113	124	132	112	120	131	139	117	124	136	145	123	131	143	152	129	137	149	159	133	142	155	165	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 Amps = outdoor unit amps (comp.+fan)
 kW = Total system power

EXPANDED COOLING DATA — ASXC160601B* / CA*F496*6**+TXV / MBVC2000*-1** HIGH STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	55.9	57.9	63.4	-	54.6	56.5	62.0	-	53.3	55.2	60.5	-	52.0	53.9	59.0	-	49.4	51.2	56.1	-	45.7	47.4	51.9	-
	S/T	0.74	0.62	0.43	-	0.77	0.64	0.45	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.85	0.71	0.49	-	0.85	0.71	0.49	-
	ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	16	12	-	18	15	12	-
	kW	3.57	3.65	3.77	-	3.86	3.95	4.09	-	4.12	4.22	4.36	-	4.35	4.45	4.61	-	4.55	4.65	4.82	-	4.71	4.83	4.99	-
	Amps	14.1	14.4	14.9	-	15.2	15.6	16.2	-	16.6	17.0	17.6	-	17.8	18.2	18.9	-	19.0	19.4	20.1	-	20.1	20.6	21.3	-
	HI PR	231	248	262	-	259	279	294	-	295	317	335	-	336	361	381	-	377	406	429	-	417	449	474	-
	LO PR	104	111	121	-	110	117	128	-	114	122	133	-	120	128	140	-	126	134	146	-	130	139	151	-
	MBh	54.2	56.2	61.6	-	53.0	54.9	60.1	-	51.7	53.6	58.7	-	50.4	52.3	57.3	-	47.9	49.7	54.4	-	44.4	46.0	50.4	-
	S/T	0.71	0.59	0.41	-	0.73	0.61	0.43	-	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.67	0.47	-	0.81	0.68	0.47	-
	ΔT	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	18	16	12	-
kW	3.54	3.62	3.74	-	3.83	3.92	4.05	-	4.09	4.18	4.33	-	4.31	4.41	4.57	-	4.51	4.61	4.77	-	4.67	4.78	4.95	-	
Amps	13.9	14.3	14.8	-	15.1	15.5	16.0	-	16.5	16.9	17.4	-	17.6	18.1	18.7	-	18.8	19.2	19.9	-	19.9	20.4	21.1	-	
HI PR	229	246	260	-	256	276	291	-	292	314	331	-	332	357	377	-	374	402	425	-	413	444	469	-	
LO PR	103	110	120	-	109	116	127	-	113	120	132	-	119	127	138	-	125	133	145	-	129	137	150	-	
MBh	50.1	51.9	56.8	-	48.9	50.7	55.5	-	47.7	49.5	54.2	-	46.6	48.3	52.9	-	44.2	45.8	50.2	-	41.0	42.5	46.5	-	
S/T	0.68	0.57	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.78	0.65	0.45	-	0.78	0.66	0.45	-	
ΔT	20	17	13	-	20	17	13	-	20	18	13	-	20	18	13	-	20	17	13	-	19	16	12	-	
kW	3.45	3.53	3.65	-	3.73	3.82	3.95	-	3.98	4.07	4.21	-	4.20	4.30	4.45	-	4.39	4.49	4.65	-	4.55	4.66	4.82	-	
Amps	13.6	13.9	14.4	-	14.7	15.0	15.6	-	16.0	16.4	16.9	-	17.1	17.5	18.1	-	18.2	18.7	19.3	-	19.4	19.8	20.5	-	
HI PR	222	239	252	-	249	268	283	-	283	304	321	-	322	347	366	-	363	390	412	-	401	431	455	-	
LO PR	100	106	116	-	106	112	123	-	110	117	128	-	115	123	134	-	121	129	140	-	125	133	145	-	

2025	MBh	56.80	58.48	63.30	67.94	55.48	57.12	61.83	66.36	54.16	55.76	60.36	64.78	52.84	54.40	58.89	63.20	50.20	51.68	55.94	60.04	46.50	47.87	51.82	55.62
	S/T	0.84	0.76	0.57	0.37	0.88	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.96	0.86	0.65	0.42	0.97	0.87	0.66	0.42
	ΔT	22	20	16	11	22	20	17	11	22	20	17	12	22	20	17	12	22	20	17	11	20	19	15	11
	kW	3.60	3.68	3.81	3.94	3.90	3.99	4.12	4.27	4.16	4.26	4.40	4.56	4.39	4.49	4.65	4.81	4.59	4.70	4.86	5.03	4.76	4.87	5.04	5.22
	Amps	14.2	14.6	15.0	15.6	15.4	15.8	16.3	16.9	16.8	17.2	17.8	18.5	18.0	18.4	19.0	19.8	19.1	19.6	20.3	21.1	20.3	20.8	21.5	22.4
	HI PR	233	251	265	276	262	282	297	310	298	320	338	353	339	365	385	402	381	410	433	452	421	453	479	499
	LO PR	105	112	122	130	111	118	129	138	116	123	134	143	121	129	141	150	127	135	148	157	132	140	153	163
	MBh	55.1	56.8	61.5	66.0	53.9	55.5	60.0	64.4	52.6	54.1	58.6	62.9	51.3	52.8	57.2	61.4	48.7	50.2	54.3	58.3	45.1	46.5	50.3	54.0
	S/T	0.81	0.72	0.55	0.35	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.37	0.88	0.79	0.60	0.38	0.92	0.82	0.62	0.40	0.93	0.83	0.63	0.40
	ΔT	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	20	16	11
kW	3.57	3.65	3.78	3.90	3.87	3.95	4.09	4.23	4.12	4.22	4.36	4.52	4.35	4.45	4.61	4.77	4.55	4.65	4.82	4.99	4.71	4.83	5.00	5.17	
Amps	14.1	14.4	14.9	15.5	15.3	15.6	16.2	16.8	16.6	17.0	17.6	18.3	17.8	18.2	18.9	19.6	19.0	19.4	20.1	20.9	20.1	20.6	21.3	22.2	
HI PR	231	248	262	274	259	279	294	307	295	317	335	349	336	361	381	398	378	406	429	447	417	449	474	494	
LO PR	104	111	121	129	110	117	128	136	114	122	133	142	120	128	140	149	126	134	146	156	130	139	151	161	
MBh	50.9	52.4	56.7	60.9	49.7	51.2	55.4	59.5	48.5	50.0	54.1	58.1	47.3	48.8	52.8	56.6	45.0	46.3	50.1	53.8	41.7	42.9	46.4	49.8	
S/T	0.78	0.69	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.88	0.79	0.60	0.39	0.89	0.80	0.60	0.39	
ΔT	23	21	17	12	23	22	18	12	23	22	18	12	24	22	18	12	23	21	18	12	22	20	16	11	
kW	3.48	3.56	3.68	3.80	3.77	3.85	3.98	4.12	4.02	4.11	4.25	4.40	4.24	4.34	4.49	4.64	4.43	4.53	4.69	4.85	4.59	4.70	4.86	5.03	
Amps	13.7	14.0	14.5	15.0	14.8	15.2	15.7	16.3	16.1	16.5	17.1	17.8	17.3	17.7	18.3	19.0	18.4	18.9	19.5	20.3	19.5	20.0	20.7	21.5	
HI PR	224	241	254	265	251	270	286	298	286	308	325	339	326	350	370	386	366	394	416	434	405	435	460	480	
LO PR	101	108	117	125	107	114	124	132	111	118	129	137	117	124	135	144	122	130	142	151	126	134	147	156	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 Amps = outdoor unit amps (comp.+fan)
 kW = Total system power

EXPANDED COOLING DATA — ASXC160601B* / CA*F496*6**+TXV / MBVC2000*-1** HIGH STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	57.81	59.07	63.11	67.47	56.47	57.70	61.65	65.90	55.12	56.33	60.18	64.33	53.78	54.95	58.71	62.76	51.09	52.20	55.77	59.62	47.32	48.36	51.66	55.23
	S/T	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	1.00	0.92	0.75	0.56	1.00	0.95	0.78	0.58	1.00	1.00	0.81	0.60	1.00	1.00	0.81	0.61
	ΔT	24	23	20	16	25	24	21	16	25	24	21	16	24	24	21	17	23	24	20	16	21	22	19	15
	kW	3.63	3.72	3.84	3.97	3.93	4.02	4.16	4.30	4.20	4.29	4.44	4.60	4.43	4.53	4.69	4.86	4.63	4.74	4.90	5.08	4.80	4.91	5.09	5.27
	Amps	14.3	14.7	15.2	15.8	15.5	15.9	16.5	17.1	16.9	17.3	17.9	18.6	18.1	18.6	19.2	20.0	19.3	19.8	20.5	21.3	20.5	21.0	21.7	22.6
	HI PR	236	253	268	279	264	284	300	313	301	323	342	356	342	368	389	406	385	414	438	457	426	458	484	504
	LO PR	106	113	123	131	112	119	130	139	117	124	136	144	123	130	142	152	129	137	149	159	133	141	154	164
	MBh	56.1	57.4	61.3	65.5	54.8	56.0	59.9	64.0	53.5	54.7	58.4	62.5	52.2	53.4	57.0	60.9	49.6	50.7	54.2	57.9	45.9	46.9	50.2	53.6
	S/T	0.88	0.83	0.67	0.50	0.92	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.55	1.00	0.94	0.77	0.57	1.00	0.95	0.77	0.58
	ΔT	25	24	21	17	26	25	21	17	26	25	21	17	26	25	22	17	25	24	21	17	23	23	20	16
kW	3.60	3.68	3.81	3.94	3.90	3.99	4.12	4.27	4.16	4.26	4.40	4.56	4.39	4.49	4.65	4.81	4.59	4.70	4.86	5.03	4.76	4.87	5.04	5.22	
Amps	14.2	14.6	15.1	15.6	15.4	15.8	16.3	16.9	16.8	17.2	17.8	18.5	18.0	18.4	19.0	19.8	19.1	19.6	20.3	21.1	20.3	20.8	21.5	22.4	
HI PR	233	251	265	276	262	282	297	310	298	320	338	353	339	365	385	402	381	410	433	452	421	453	479	499	
LO PR	105	112	122	130	111	118	129	138	116	123	134	143	121	129	141	150	127	135	148	157	132	140	153	163	
MBh	51.8	52.9	56.6	60.5	50.6	51.7	55.2	59.1	49.4	50.5	53.9	57.6	48.2	49.2	52.6	56.2	45.8	46.8	50.0	53.4	42.4	43.3	46.3	49.5	
S/T	0.85	0.80	0.65	0.49	0.88	0.83	0.67	0.50	0.91	0.85	0.69	0.52	0.93	0.88	0.71	0.53	0.97	0.91	0.74	0.55	0.98	0.92	0.75	0.56	
ΔT	26	25	21	17	26	25	22	17	26	25	22	17	26	25	22	18	26	25	22	17	24	23	20	16	
kW	3.51	3.59	3.71	3.84	3.80	3.88	4.02	4.16	4.05	4.15	4.29	4.44	4.28	4.38	4.53	4.69	4.47	4.57	4.73	4.90	4.63	4.74	4.91	5.08	
Amps	13.8	14.2	14.6	15.2	15.0	15.3	15.9	16.5	16.3	16.7	17.3	17.9	17.4	17.9	18.5	19.2	18.6	19.1	19.7	20.5	19.7	20.2	20.9	21.7	
HI PR	226	243	257	268	254	273	288	301	289	311	328	342	329	354	374	390	370	398	420	438	409	440	464	484	
LO PR	102	109	119	126	108	115	125	133	112	119	130	139	118	125	137	146	123	131	143	153	128	136	148	158	
2025	MBh	58.82	59.96	62.80	67.00	57.45	58.57	61.34	65.44	56.09	57.17	59.88	63.88	54.72	55.78	58.42	62.32	51.98	52.99	55.50	59.21	48.15	49.08	51.41	54.84
	S/T	0.97	0.94	0.85	0.69	1.00	0.97	0.88	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.93	0.75	1.00	1.00	0.96	0.78	1.00	1.00	0.97	0.79
	ΔT	26	26	24	21	26	26	24	21	25	26	24	21	25	25	25	21	24	24	24	21	22	22	23	20
	kW	3.66	3.75	3.87	4.01	3.97	4.06	4.20	4.34	4.23	4.33	4.48	4.64	4.47	4.57	4.73	4.90	4.67	4.78	4.95	5.12	4.84	4.96	5.13	5.31
	Amps	14.5	14.8	15.3	15.9	15.7	16.1	16.6	17.3	17.1	17.5	18.1	18.8	18.3	18.8	19.4	20.2	19.5	20.0	20.7	21.5	20.7	21.2	22.0	22.8
	HI PR	238	256	270	282	267	287	303	316	304	327	345	360	346	372	393	410	389	419	442	461	430	463	488	509
	LO PR	107	114	125	133	113	121	132	140	118	125	137	146	124	132	144	153	130	138	151	161	134	143	156	166
	MBh	57.1	58.2	61.0	65.0	55.8	56.9	59.6	63.5	54.5	55.5	58.1	62.0	53.1	54.2	56.7	60.5	50.5	51.4	53.9	57.5	46.7	47.7	49.9	53.2
	S/T	0.93	0.89	0.81	0.65	0.96	0.93	0.84	0.68	0.98	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.75	1.00	1.00	0.93	0.75
	ΔT	27	27	25	22	27	27	25	22	27	27	25	22	27	27	26	22	26	26	25	22	24	24	24	20
kW	3.63	3.72	3.84	3.97	3.93	4.02	4.16	4.30	4.20	4.29	4.44	4.60	4.43	4.53	4.69	4.86	4.63	4.74	4.90	5.08	4.80	4.91	5.09	5.27	
Amps	14.3	14.7	15.2	15.8	15.5	15.9	16.5	17.1	16.9	17.3	17.9	18.6	18.1	18.6	19.2	20.0	19.3	19.8	20.5	21.3	20.5	21.0	21.7	22.6	
HI PR	236	253	268	279	264	284	300	313	301	323	342	356	342	368	389	406	385	414	438	457	426	458	484	504	
LO PR	106	113	123	131	112	119	130	139	117	124	136	144	123	130	142	152	129	137	149	159	133	141	154	164	
MBh	52.7	53.7	56.3	60.0	51.5	52.5	55.0	58.6	50.3	51.2	53.7	57.2	49.0	50.0	52.3	55.8	46.6	47.5	49.7	53.1	43.1	44.0	46.1	49.1	
S/T	0.89	0.86	0.78	0.63	0.93	0.89	0.81	0.65	0.95	0.92	0.83	0.67	0.98	0.95	0.85	0.69	1.00	0.98	0.89	0.72	1.00	0.99	0.89	0.72	
ΔT	27	27	26	22	28	27	26	22	28	27	26	22	28	28	26	22	27	27	26	22	25	25	24	21	
kW	3.54	3.62	3.74	3.87	3.83	3.92	4.05	4.19	4.09	4.18	4.33	4.48	4.31	4.41	4.57	4.73	4.51	4.61	4.77	4.94	4.67	4.78	4.95	5.13	
Amps	13.9	14.3	14.8	15.3	15.1	15.5	16.0	16.6	16.4	16.9	17.4	18.1	17.6	18.1	18.7	19.4	18.8	19.2	19.9	20.7	19.9	20.4	21.1	21.9	
HI PR	228	246	260	271	256	276	291	304	292	314	331	346	332	357	377	394	374	402	425	443	413	444	469	489	
LO PR	103	110	120	128	109	116	127	135	113	120	132	140	119	127	138	147	125	133	145	154	129	137	150	159	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 Amps = outdoor unit amps (comp.+fan)
 kW = Total system power

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
ASXC16 0241B*	AVPTC30C14A*		23,000	16,800	16.00	12.50	830	5924472
	CA*F3636*6D*+EEP+TXV		24,000	17,600	14.50	12.00	820	5357220
	CA*F3636*6D*+MBVC1200**-1A*+TXV		24,000	17,600	16.00	13.00	820	4392726
	CA*F3636*6D*+TXV	A*VC960403BNA*	24,000	17,600	16.00	13.00	810	7369673
	CA*F3636*6D*+TXV	A*VC960603BNA*	24,000	17,600	16.00	13.00	815	7369678
	CA*F3636*6D*+TXV	A*VC950714CXB*	24,000	17,600	16.00	13.00	800	5623798
	CA*F3636*6D*+TXV	ADVC80603B*B*	24,000	17,600	16.00	13.00	810	5188429
	CA*F3636*6D*+TXV	A*VM960604CXB*	24,000	17,600	16.00	13.00	800	5623817
	CA*F3636*6D*+TXV	A*VC960803BNA*	24,000	17,600	16.00	13.00	810	7369683
	CA*F3636*6D*+TXV	G*VC950453BXB*	24,000	17,600	16.00	13.00	820	6498219
	CA*F3636*6D*+TXV	A*VM970803BNA*	24,000	17,600	16.00	13.00	810	7369757
	CA*F3636*6D*+TXV	G*EC960603BNA*	24,000	17,600	16.00	13.00	800	7368303
	CA*F3636*6D*+TXV	G*VC950704CXB*	24,000	17,600	16.00	13.00	800	6498220
	CA*F3636*6D*+TXV	A*EC960302BNA*	24,000	17,600	16.00	13.00	800	7368336
	CA*F3636*6D*+TXV	G*VC960403BNA*	24,000	17,600	16.00	13.00	810	7369527
	CA*F3636*6D*+TXV	G*EC960302BNA*	24,000	17,600	16.00	13.00	800	7368297
	CA*F3636*6D*+TXV	A*EC960402BNA*	24,000	17,600	16.00	13.00	850	7368339
	CA*F3636*6D*+TXV	G*VC960803BNA*	24,000	17,600	16.00	13.00	810	7369537
	CA*F3636*6D*+TXV	A*EC960603BNA*	24,000	17,600	16.00	13.00	800	7368342
	CA*F3636*6D*+TXV	G*VC960603BNA*	24,000	17,600	16.00	13.00	815	7369532
	CA*F3636*6D*+TXV	A*EC960803BNA*	24,000	17,600	16.00	13.00	800	7368345
	CA*F3636*6D*+TXV	G*EC960402BNA*	24,000	17,600	16.00	13.00	850	7368300
	CA*F3636*6D*+TXV	A*VC950453BXB*	24,000	17,600	16.00	13.00	820	5623773
	CA*F3636*6D*+TXV	A*VC80604B*B*	24,000	17,600	16.00	13.00	820	5188266
	CA*F3636*6D*+TXV	G*VC950714CXB*	24,000	17,600	16.00	13.00	800	6498221
	CA*F3636*6D*+TXV	G*VM960604CXB*	24,000	17,600	16.00	13.00	800	6498223
	CA*F3636*6D*+TXV	G*VC80604B*B*	24,000	17,600	16.00	13.00	820	5188267
	CA*F3636*6D*+TXV	G*EC960803BNA*	24,000	17,600	16.00	13.00	800	7368306
	CA*F3636*6D*+TXV	G*VM970803BNA*	24,000	17,600	16.00	13.00	810	7369610
	CA*F3636*6D*+TXV	G*VM970603BNA*	24,000	17,600	16.00	13.00	815	7369605
	CA*F3636*6D*+TXV	A*VC950704CXB*	24,000	17,600	16.00	13.00	800	5623785
	CA*F3636*6D*+TXV	A*VM960603BXB*	24,000	17,600	16.00	13.00	820	5623809
	CA*F3636*6D*+TXV	A*VM970603BNA*	24,000	17,600	16.00	13.00	815	7369752
	CA*F3636*6D*+TXV	G*VM960603BXB*	24,000	17,600	16.00	13.00	820	6498222
	CA*F3642*6D*+EEP+TXV		24,000	17,600	14.50	12.00	820	5357221
	CA*F3642*6D*+TXV	G*VC950905CXB*	24,000	17,600	16.00	13.00	800	5623802
	CA*F3642*6D*+TXV	A*VM960805CXB*	24,000	17,600	16.00	13.00	800	5623826
	CA*F3642*6D*+TXV	A*VC80604B*B*	24,000	17,600	16.00	13.00	820	5188268
	CA*F3642*6D*+TXV	G*VM960604CXB*	24,000	17,600	16.00	13.00	800	5623819
	CA*F3642*6D*+TXV	G*VM960603BXB*	24,000	17,600	16.00	13.00	820	5623810
	CA*F3642*6D*+TXV	A*VM960805DXB*	24,000	17,600	16.00	13.00	800	5623828
	CA*F3642*6D*+TXV	G*VC950704CXB*	24,000	17,600	16.00	13.00	800	5623787
	CA*F3642*6D*+TXV	G*VM960805CXB*	24,000	17,600	16.00	13.00	800	5623827
	CA*F3642*6D*+TXV	A*VC950714CXB*	24,000	17,600	16.00	13.00	800	5623799
	CA*F3642*6D*+TXV	A*VM960604CXB*	24,000	17,600	16.00	13.00	800	5623818
	CA*F3642*6D*+TXV	G*VC950915DXB*	24,000	17,600	16.00	13.00	800	5623808
	CA*F3642*6D*+TXV	A*VC950915DXB*	24,000	17,600	16.00	13.00	800	5623807
CA*F3642*6D*+TXV	G*VM960805DXB*	24,000	17,600	16.00	13.00	800	5623829	
CA*F3642*6D*+TXV	A*VC950905CXB*	24,000	17,600	16.00	13.00	800	5623801	
CA*F3642*6D*+TXV	G*VC950714CXB*	24,000	17,600	16.00	13.00	800	5623800	
CA*F3642*6D*+TXV	G*VC950453BXB*	24,000	17,600	16.00	13.00	820	5623774	
CA*F3642*6D*+TXV	G*VC80604B*B*	24,000	17,600	16.00	13.00	820	5188269	
CA*F3642*6D*+TXV	A*VC950704CXB*	24,000	17,600	16.00	13.00	800	5623786	
CAPT3131*4A*	A*VC960803BNA*	23,400	17,100	15.50	12.50	810	7369684	
CAPT3131*4A*	A*VM970803BNA*	23,400	17,100	15.50	12.50	810	7369758	
CAPT3131*4A*	G*VM970803BNA*	23,400	17,100	15.50	12.50	810	7369611	

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #	
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³			
ASXC16 0241B* (cont.)	CAPT3131*4A*	G*VC960803BNA*	23,400	17,100	15.50	12.50	810	7369538	
	CAPT3131*4A*	A*VC960603BNA*	23,400	17,100	15.50	12.50	815	7369679	
	CAPT3131*4A*	G*VC960603BNA*	23,400	17,100	15.50	12.50	815	7369533	
	CAPT3131*4A*	G*VC960403BNA*	23,400	17,100	15.50	12.50	810	7369528	
	CAPT3131*4A*	A*VC960403BNA*	23,400	17,100	15.50	12.50	810	7369674	
	CAPT3131*4A*	G*VM970603BNA*	23,400	17,100	15.50	12.50	815	7369606	
	CAPT3131*4A*	A*VM970603BNA*	23,400	17,100	15.50	12.50	815	7369753	
	CAPT3743*4A*	A*EC960302BNA*	24,200	17,700	16.00	13.00	800	7368337	
	CAPT3743*4A*	A*EC960803BNA*	24,200	17,700	16.00	13.00	800	7368346	
	CAPT3743*4A*	G*EC960302BNA*	24,200	17,700	16.00	13.00	800	7368298	
	CAPT3743*4A*	G*EC960603BNA*	24,200	17,700	16.00	13.00	800	7368304	
	CAPT3743*4A*	A*EC960603BNA*	24,200	17,700	16.00	13.00	800	7368343	
	CAPT3743*4A*	G*EC960402BNA*	24,200	17,700	16.00	13.00	850	7368301	
	CAPT3743*4A*	G*EC960803BNA*	24,200	17,700	16.00	13.00	800	7368307	
	CAPT3743*4A*	A*EC960402BNA*	24,200	17,700	16.00	13.00	850	7368340	
	CHPF3636B6C*+EEP+TXV			24,000	17,600	14.50	12.00	820	5357222
	CHPF3636B6C*+MBVC1200**-1A*+TXV			24,000	17,600	16.00	13.00	820	3654984
	CHPF3636B6C*+TXV	A*EC960402BNA*		24,000	17,600	16.00	13.00	850	7368341
	CHPF3636B6C*+TXV	G*EC960803BNA*		24,000	17,600	16.00	13.00	800	7368308
	CHPF3636B6C*+TXV	A*EC960603BNA*		24,000	17,600	16.00	13.00	800	7368344
	CHPF3636B6C*+TXV	A*EC960302BNA*		24,000	17,600	16.00	13.00	800	7368338
	CHPF3636B6C*+TXV	G*VM960604CXB*		24,000	17,600	16.00	12.50	800	5623821
	CHPF3636B6C*+TXV	A*EC960803BNA*		24,000	17,600	16.00	13.00	800	7368347
	CHPF3636B6C*+TXV	G*VC950453BXB*		24,000	17,600	16.00	13.00	820	5623776
	CHPF3636B6C*+TXV	G*VM960603BXB*		24,000	17,600	16.00	13.00	820	5623812
	CHPF3636B6C*+TXV	G*VM970803BNA*		24,000	17,600	16.00	13.00	810	7369612
	CHPF3636B6C*+TXV	G*VM970603BNA*		24,000	17,600	16.00	13.00	815	7369607
	CHPF3636B6C*+TXV	A*VC950704CXB*		24,000	17,600	16.00	12.50	800	5623788
	CHPF3636B6C*+TXV	A*VM970803BNA*		24,000	17,600	16.00	13.00	810	7369759
	CHPF3636B6C*+TXV	A*VC960803BNA*		24,000	17,600	16.00	13.00	810	7369685
	CHPF3636B6C*+TXV	G*EC960603BNA*		24,000	17,600	16.00	13.00	800	7368305
	CHPF3636B6C*+TXV	G*VC960403BNA*		24,000	17,600	16.00	13.00	810	7369529
	CHPF3636B6C*+TXV	A*VM960604CXB*		24,000	17,600	16.00	12.50	800	5623820
	CHPF3636B6C*+TXV	G*VC950704CXB*		24,000	17,600	16.00	12.50	800	5623789
	CHPF3636B6C*+TXV	G*VC80604B*B*		24,000	17,600	16.00	13.00	820	5188271
	CHPF3636B6C*+TXV	G*VC960803BNA*		24,000	17,600	16.00	13.00	810	7369539
	CHPF3636B6C*+TXV	G*EC960302BNA*		24,000	17,600	16.00	13.00	800	7368299
	CHPF3636B6C*+TXV	G*EC960402BNA*		24,000	17,600	16.00	13.00	850	7368302
	CHPF3636B6C*+TXV	A*VM970603BNA*		24,000	17,600	16.00	13.00	815	7369754
	CHPF3636B6C*+TXV	A*VC950453BXB*		24,000	17,600	16.00	13.00	820	5623775
	CHPF3636B6C*+TXV	A*VM960603BXB*		24,000	17,600	16.00	13.00	820	5623811
	CHPF3636B6C*+TXV	G*VC960603BNA*		24,000	17,600	16.00	13.00	815	7369534
	CHPF3636B6C*+TXV	A*VC960603BNA*		24,000	17,600	16.00	13.00	815	7369680
	CHPF3636B6C*+TXV	A*VC960403BNA*		24,000	17,600	16.00	13.00	810	7369675
	CHPF3636B6C*+TXV	A*VC80604B*B*		24,000	17,600	16.00	13.00	820	5188270
	CHPF3642C6C*+TXV	G*VC950453BXB*		24,000	17,600	16.00	13.00	820	5623778
	CHPF3642C6C*+TXV	G*VM960603BXB*		24,000	17,600	16.00	13.00	820	5623814
	CHPF3642C6C*+TXV	A*VM960604CXB*		24,000	17,600	16.00	13.00	800	5623822
	CHPF3642C6C*+TXV	G*VM960604CXB*		24,000	17,600	16.00	13.00	800	5623823
	CHPF3642C6C*+TXV	A*VM960603BXB*		24,000	17,600	16.00	13.00	820	5623813
CHPF3642C6C*+TXV	A*VC950704CXB*		24,000	17,600	16.00	13.00	800	5623790	
CHPF3642C6C*+TXV	G*VC950704CXB*		24,000	17,600	16.00	13.00	800	5623791	
CHPF3642C6C*+TXV	A*VC950453BXB*		24,000	17,600	16.00	13.00	820	5623777	
CHPF3743C6B*+TXV	A*VC950704CXB*		24,000	17,600	16.00	12.50	800	5623792	
CHPF3743C6B*+TXV	A*VM960604CXB*		24,000	17,600	16.00	12.50	800	5623824	
CHPF3743C6B*+TXV	G*VC950453BXB*		24,000	17,600	16.00	12.50	820	5623780	

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
ASXC16 0241B* (cont.)	CHPF3743C6B*+TXV	A*VM960603BXB*	24,000	17,600	16.00	12.50	820	5623815
	CHPF3743C6B*+TXV	G*VC950704CXB*	24,000	17,600	16.00	12.50	800	5623793
	CHPF3743C6B*+TXV	A*VC950453BXB*	24,000	17,600	16.00	12.50	820	5623779
	CHPF3743C6B*+TXV	G*VM960604CXB*	24,000	17,600	16.00	12.50	800	5623825
	CHPF3743C6B*+TXV	G*VM960603BXB*	24,000	17,600	16.00	12.50	820	5623816
	CSCF3036N6D*+TXV	A*VC960403BNA*	24,000	17,600	15.50	12.50	810	7369676
	CSCF3036N6D*+TXV	A*VC950704CXB*	24,000	17,600	16.00	13.00	875	5623794
	CSCF3036N6D*+TXV	G*VC950453BXB*	24,000	17,600	15.50	12.50	800	5623782
	CSCF3036N6D*+TXV	G*VM970803BNA*	24,000	17,600	15.50	12.50	810	7369613
	CSCF3036N6D*+TXV	A*VM970603BNA*	24,000	17,600	15.50	12.50	815	7369755
	CSCF3036N6D*+TXV	A*VC950905CXB*	24,000	17,600	16.00	13.00	800	5623803
	CSCF3036N6D*+TXV	G*VC960403BNA*	24,000	17,600	15.50	12.50	810	7369530
	CSCF3036N6D*+TXV	G*VC960603BNA*	24,000	17,600	15.50	12.50	815	7369535
	CSCF3036N6D*+TXV	A*VM970803BNA*	24,000	17,600	15.50	12.50	810	7369760
	CSCF3036N6D*+TXV	A*VC80604B*B*	24,000	17,600	16.00	13.00	820	5948537
	CSCF3036N6D*+TXV	A*VC960603BNA*	24,000	17,600	15.50	12.50	815	7369681
	CSCF3036N6D*+TXV	G*VM970603BNA*	24,000	17,600	15.50	12.50	815	7369608
	CSCF3036N6D*+TXV	G*VC950704CXB*	24,000	17,600	16.00	13.00	875	5623795
	CSCF3036N6D*+TXV	A*VC960803BNA*	24,000	17,600	15.50	12.50	810	7369686
	CSCF3036N6D*+TXV	G*VC80604B*B*	24,000	17,600	16.00	13.00	820	5948538
	CSCF3036N6D*+TXV	A*VC950453BXB*	24,000	17,600	15.50	12.50	800	5623781
	CSCF3036N6D*+TXV	G*VC960803BNA*	24,000	17,600	15.50	12.50	810	7369540
	CSCF3036N6D*+TXV	G*VC950905CXB*	24,000	17,600	16.00	13.00	800	5623804
	CSCF3642N6D*+EEP+TXV		24,000	17,600	14.50	12.00	820	5357223
	CSCF3642N6D*+TXV	G*VM970603BNA*	24,000	17,600	16.00	13.00	815	7369609
	CSCF3642N6D*+TXV	G*VM970803BNA*	24,000	17,600	16.00	13.00	810	7369614
	CSCF3642N6D*+TXV	G*VC950704CXB*	24,000	17,600	16.00	13.00	875	5623797
	CSCF3642N6D*+TXV	A*VC960403BNA*	24,000	17,600	16.00	13.00	810	7369677
	CSCF3642N6D*+TXV	A*VM970803BNA*	24,000	17,600	16.00	13.00	810	7369761
	CSCF3642N6D*+TXV	A*VC950905CXB*	24,000	17,600	16.00	13.00	800	5623805
	CSCF3642N6D*+TXV	A*VC960603BNA*	24,000	17,600	16.00	13.00	815	7369682
	CSCF3642N6D*+TXV	A*VC960803BNA*	24,000	17,600	16.00	13.00	810	7369687
	CSCF3642N6D*+TXV	A*VC950453BXB*	24,000	17,600	16.00	13.00	800	5623783
CSCF3642N6D*+TXV	G*VC950905CXB*	24,000	17,600	16.00	13.00	800	5623806	
CSCF3642N6D*+TXV	G*VC960403BNA*	24,000	17,600	16.00	13.00	810	7369531	
CSCF3642N6D*+TXV	G*VC80604B*B*	24,000	17,600	16.00	13.00	820	6498225	
CSCF3642N6D*+TXV	A*VC80604B*B*	24,000	17,600	16.00	13.00	820	6498224	
CSCF3642N6D*+TXV	G*VC950453BXB*	24,000	17,600	16.00	13.00	800	5623784	
CSCF3642N6D*+TXV	G*VC960803BNA*	24,000	17,600	16.00	13.00	810	7369541	
CSCF3642N6D*+TXV	A*VC950704CXB*	24,000	17,600	16.00	13.00	875	5623796	
CSCF3642N6D*+TXV	G*VC960603BNA*	24,000	17,600	16.00	13.00	815	7369536	
CSCF3642N6D*+TXV	A*VM970603BNA*	24,000	17,600	16.00	13.00	815	7369756	
ASXC16 0361B*	AVPTC42D14A*		35,000	25,200	16.00	12.00	1,200	5924389
	AVPTC48C14A*		34,400	24,800	15.00	12.00	1,100	7080489
	AVPTC48D14A*		36,000	25,800	16.00	12.50	1,200	5924390
	CA*F3642*6D*+MBVC1600**-1A*+TXV		35,000	25,200	16.00	12.50	1,200	3881336
	CA*F3642*6D*+TXV	A*VC950905DXB*	34,600	24,800	16.00	12.25	1,150	5623867
	CA*F3642*6D*+TXV	G*EC960803BNA*	34,600	24,800	15.00	11.00	1,150	7368313
	CA*F3642*6D*+TXV	A*VM970603BNA*	33,600	24,200	15.50	11.50	1,075	7369762
	CA*F3642*6D*+TXV	A*VC960403BNA*	33,600	24,200	15.50	11.50	1,075	7369688
	CA*F3642*6D*+TXV	A*VC950704CXB*	34,600	24,800	15.50	12.00	1,100	5623838
	CA*F3642*6D*+TXV	G*EC960603BNA*	34,600	24,800	15.00	11.00	1,150	7368309
	CA*F3642*6D*+TXV	A*EC960603BNA*	34,600	24,800	15.00	11.00	1,150	7368348
	CA*F3642*6D*+TXV	A*VC960803BNA*	33,600	24,200	15.50	11.50	1,100	7369698
	CA*F3642*6D*+TXV	G*VC80805C*B*	35,000	25,200	16.00	12.50	1,190	5188275
	CA*F3642*6D*+TXV	G*VC950453BXB*	34,000	24,400	16.00	12.20	1,130	5623831

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
ASXC16 0361B* (cont.)	CA*F3642*6D*+TXV	A*VC950915DXB*	34,600	24,800	15.50	12.00	1,150	5623878
	CA*F3642*6D*+TXV	G*VM960805DXB*	34,600	24,800	15.50	12.00	1,150	5623923
	CA*F3642*6D*+TXV	A*VM960604CXB*	34,600	24,800	16.00	12.00	1,100	5623900
	CA*F3642*6D*+TXV	G*VC950915DXB*	34,600	24,800	15.50	12.00	1,150	5623879
	CA*F3642*6D*+TXV	G*VC950714CXB*	34,600	24,800	16.00	12.00	1,100	5623851
	CA*F3642*6D*+TXV	G*VM961005DXB*	34,600	24,800	16.00	12.30	1,150	5623931
	CA*F3642*6D*+TXV	A*VC80604B*B*	34,000	24,400	16.00	12.00	1,220	5188272
	CA*F3642*6D*+TXV	G*VC960603BNA*	33,600	24,200	15.50	11.50	1,075	7369547
	CA*F3642*6D*+TXV	G*VC950704CXB*	34,600	24,800	16.00	12.00	1,100	5623839
	CA*F3642*6D*+TXV	G*EC961205DNA*	34,600	24,800	15.50	11.50	1,250	7368322
	CA*F3642*6D*+TXV	A*VM961155DXB*	34,600	24,800	16.00	12.30	1,150	5623940
	CA*F3642*6D*+TXV	G*VM970803BNA*	33,600	24,200	15.50	11.50	1,100	7369620
	CA*F3642*6D*+TXV	ADVC80603B*B*	34,000	24,400	16.00	12.50	1,190	5188406
	CA*F3642*6D*+TXV	A*EC961004CNA*	34,600	24,800	15.50	11.50	1,150	7368356
	CA*F3642*6D*+TXV	G*VC950905DXB*	34,600	24,800	16.00	12.25	1,150	5623868
	CA*F3642*6D*+TXV	G*EC961004CNA*	34,600	24,800	15.50	11.50	1,150	7368317
	CA*F3642*6D*+TXV	A*VM970803BNA*	33,600	24,200	15.50	11.50	1,100	7369768
	CA*F3642*6D*+TXV	G*VC950905CXB*	34,600	24,800	15.50	12.00	1,150	5623857
	CA*F3642*6D*+TXV	G*VC960403BNA*	33,600	24,200	15.50	11.50	1,075	7369542
	CA*F3642*6D*+TXV	A*VC951155DXB*	34,600	24,800	16.00	12.30	1,150	5623882
	CA*F3642*6D*+TXV	G*VC951155DXB*	34,600	24,800	16.00	12.30	1,150	5623883
	CA*F3642*6D*+TXV	G*VC80604B*B*	34,000	24,400	16.00	12.00	1,220	5188274
	CA*F3642*6D*+TXV	ADVC80805C*B*	35,000	25,200	16.00	12.50	1,190	5188398
	CA*F3642*6D*+TXV	G*VM970603BNA*	33,600	24,200	15.50	11.50	1,075	7369615
	CA*F3642*6D*+TXV	A*VM960805DXB*	34,600	24,800	15.50	12.00	1,150	5623922
	CA*F3642*6D*+TXV	A*VC80805C*B*	35,000	25,200	16.00	12.50	1,190	5188273
	CA*F3642*6D*+TXV	A*EC960803BNA*	34,600	24,800	15.00	11.00	1,150	7368352
	CA*F3642*6D*+TXV	A*VC950453BXB*	34,000	24,400	15.50	12.00	1,130	5623830
	CA*F3642*6D*+TXV	A*VC960603BNA*	33,600	24,200	15.50	11.50	1,075	7369693
	CA*F3642*6D*+TXV	A*VC950714CXB*	34,600	24,800	16.00	12.00	1,100	5623850
	CA*F3642*6D*+TXV	G*VM961155DXB*	34,600	24,800	16.00	12.30	1,150	5623941
	CA*F3642*6D*+TXV	A*VM960805CXB*	34,600	24,800	15.50	12.00	1,150	5623910
	CA*F3642*6D*+TXV	G*VM960603BXB*	34,000	24,400	16.00	12.20	1,130	5623894
	CA*F3642*6D*+TXV	A*VM960603BXB*	34,000	24,400	15.50	12.00	1,130	5623893
	CA*F3642*6D*+TXV	G*VM960604CXB*	34,600	24,800	16.00	12.00	1,100	5623901
	CA*F3642*6D*+TXV	A*VC950905CXB*	34,600	24,800	15.50	12.00	1,150	5623856
	CA*F3642*6D*+TXV	A*EC961205DNA*	34,600	24,800	15.50	11.50	1,250	7368361
	CA*F3642*6D*+TXV	G*VM960805CXB*	34,600	24,800	15.50	12.00	1,150	5623911
	CA*F3642*6D*+TXV	A*VM961005DXB*	34,600	24,800	16.00	12.30	1,150	5623930
	CA*F3642*6D*+TXV	G*VC960803BNA*	33,600	24,200	15.50	11.50	1,100	7369552
	CA*F3743*6D*+EEP+TXV		34,000	24,400	14.50	11.50	1,200	5357224
	CA*F3743*6D*+MBVC1600**-1A*+TXV		35,000	25,200	16.00	12.50	1,100	4415257
	CA*F3743*6D*+TXV	G*VM970603BNA*	34,000	24,400	15.50	11.50	1,075	7369616
	CA*F3743*6D*+TXV	G*VC80805C*B*	34,000	24,400	16.00	12.50	1,190	5188279
	CA*F3743*6D*+TXV	A*VC961205DNA*	34,200	24,600	15.50	12.00	1,115	7369716
	CA*F3743*6D*+TXV	A*EC961004CNA*	34,800	25,000	16.00	12.30	1,150	7368357
	CA*F3743*6D*+TXV	G*VM970804CNA*	34,600	24,800	16.00	12.00	1,125	7369625
CA*F3743*6D*+TXV	A*VM960603BXB*	34,000	24,400	15.50	12.00	1,130	6603418	
CA*F3743*6D*+TXV	G*VM960805CXB*	34,600	24,800	16.00	12.00	1,150	5623913	
CA*F3743*6D*+TXV	A*VM961155DXB*	34,000	24,400	16.00	12.50	1,150	5623942	
CA*F3743*6D*+TXV	A*VC80805C*B*	34,000	24,400	16.00	12.50	1,190	5188277	
CA*F3743*6D*+TXV	G*VM961005DXB*	34,600	24,800	16.00	12.50	1,150	5623933	
CA*F3743*6D*+TXV	G*VC960603BNA*	34,000	24,400	15.50	11.50	1,075	7369548	
CA*F3743*6D*+TXV	G*VC950905DXB*	34,600	24,800	16.00	12.50	1,150	5623870	
CA*F3743*6D*+TXV	A*VC960804CNA*	34,600	24,800	16.00	12.00	1,125	7369703	
CA*F3743*6D*+TXV	G*VC950704CXB*	34,600	24,800	16.00	12.30	1,100	5623841	

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
ASXC16 0361B* (cont.)	CA*F3743*6D*+TXV	G*VC961205DNA*	34,200	24,600	15.50	12.00	1,115	7369569
	CA*F3743*6D*+TXV	G*VC950905CXB*	34,600	24,800	16.00	12.00	1,150	5623859
	CA*F3743*6D*+TXV	G*VC80604B*B*	34,000	24,400	16.00	12.50	1,220	5188278
	CA*F3743*6D*+TXV	A*VM960604CXB*	34,600	24,800	16.00	12.50	1,100	5623902
	CA*F3743*6D*+TXV	A*VC960603BNA*	34,000	24,400	15.50	11.50	1,075	7369694
	CA*F3743*6D*+TXV	G*VC951155DXB*	34,600	24,800	16.00	12.50	1,150	5623885
	CA*F3743*6D*+TXV	A*VM961005DXB*	34,000	24,400	16.00	12.50	1,150	5623932
	CA*F3743*6D*+TXV	G*VM960603BXB*	34,000	24,400	15.50	12.00	1,130	6603419
	CA*F3743*6D*+TXV	G*VM970803BNA*	34,000	24,400	15.50	11.50	1,100	7369621
	CA*F3743*6D*+TXV	A*EC960603BNA*	35,000	25,200	15.50	11.50	1,150	7368349
	CA*F3743*6D*+TXV	A*VC950453BXB*	34,000	24,400	15.50	12.00	1,130	6498226
	CA*F3743*6D*+TXV	A*VM971205DNA*	34,200	24,600	15.50	12.00	1,115	7369785
	CA*F3743*6D*+TXV	A*VM970603BNA*	34,000	24,400	15.50	11.50	1,075	7369763
	CA*F3743*6D*+TXV	G*VM961155DXB*	34,600	24,800	16.00	12.50	1,150	5623943
	CA*F3743*6D*+TXV	A*VC950905CXB*	34,600	24,800	16.00	12.00	1,150	5623858
	CA*F3743*6D*+TXV	A*VC960403BNA*	34,000	24,400	15.50	11.50	1,075	7369689
	CA*F3743*6D*+TXV	ADVC80805C*B*	34,000	24,400	16.00	12.50	1,190	5188387
	CA*F3743*6D*+TXV	G*EC960803BNA*	35,000	25,200	15.50	11.50	1,150	7368314
	CA*F3743*6D*+TXV	G*VM960805DXB*	34,600	24,800	16.00	12.50	1,150	6498230
	CA*F3743*6D*+TXV	A*VC950704CXB*	34,000	24,400	16.00	12.50	1,150	5623840
	CA*F3743*6D*+TXV	G*EC961205DNA*	34,800	25,000	15.50	12.30	1,250	7368323
	CA*F3743*6D*+TXV	A*VC951155DXB*	34,000	24,400	16.00	12.50	1,150	5623884
	CA*F3743*6D*+TXV	G*EC961004CNA*	34,800	25,000	16.00	12.30	1,150	7368318
	CA*F3743*6D*+TXV	G*EC960603BNA*	35,000	25,200	15.50	11.50	1,150	7368310
	CA*F3743*6D*+TXV	A*EC961205DNA*	34,800	25,000	15.50	12.30	1,250	7368362
	CA*F3743*6D*+TXV	A*EC960803BNA*	35,000	25,200	15.50	11.50	1,150	7368353
	CA*F3743*6D*+TXV	G*VC960803BNA*	34,000	24,400	15.50	11.50	1,100	7369553
	CA*F3743*6D*+TXV	A*VM971005CNA*	34,600	24,800	16.00	12.00	1,200	7369779
	CA*F3743*6D*+TXV	A*VM960805CXB*	34,600	24,800	16.00	12.00	1,150	5623912
	CA*F3743*6D*+TXV	G*VM971005CNA*	34,600	24,800	16.00	12.00	1,200	7369631
	CA*F3743*6D*+TXV	G*VC960804CNA*	34,600	24,800	16.00	12.00	1,125	7369557
	CA*F3743*6D*+TXV	A*VC950714CXB*	34,600	24,800	16.00	12.30	1,100	5623852
	CA*F3743*6D*+TXV	A*VM970804CNA*	34,600	24,800	16.00	12.00	1,125	7369773
	CA*F3743*6D*+TXV	A*VC950905DXB*	34,000	24,400	16.00	12.50	1,150	5623869
	CA*F3743*6D*+TXV	A*VC961005CNA*	34,600	24,800	16.00	12.00	1,200	7369709
	CA*F3743*6D*+TXV	G*VC961005CNA*	34,600	24,800	16.00	12.00	1,200	7369563
	CA*F3743*6D*+TXV	A*VC950915DXB*	34,600	24,800	16.00	12.50	1,150	6498227
	CA*F3743*6D*+TXV	A*VM970803BNA*	34,000	24,400	15.50	11.50	1,100	7369769
	CA*F3743*6D*+TXV	G*VC950915DXB*	34,600	24,800	16.00	12.50	1,150	6498229
	CA*F3743*6D*+TXV	G*VC91155DXA*	34,600	24,800	15.50	12.20	1,150	6498228
	CA*F3743*6D*+TXV	G*VM971205DNA*	34,200	24,600	15.50	12.00	1,115	7369637
	CA*F3743*6D*+TXV	A*VC80604B*B*	34,000	24,400	16.00	12.50	1,220	5188276
	CA*F3743*6D*+TXV	G*VC950714CXB*	34,600	24,800	16.00	12.30	1,100	5623853
	CA*F3743*6D*+TXV	G*VM960604CXB*	34,600	24,800	16.00	12.50	1,100	5623903
	CA*F3743*6D*+TXV	A*VC960803BNA*	34,000	24,400	15.50	11.50	1,100	7369699
	CA*F3743*6D*+TXV	G*VC960403BNA*	34,000	24,400	15.50	11.50	1,075	7369543
	CA*F4860*6D*+EEP+TXV		35,000	25,200	14.50	11.50	1,200	5357225
	CA*F4860*6D*+TXV	G*VM960604CXB*	34,600	24,800	16.00	12.30	1,100	5623905
CA*F4860*6D*+TXV	G*VC950905DXB*	35,000	25,200	16.00	12.50	1,150	5623872	
CA*F4860*6D*+TXV	A*VC80805C*B*	35,000	25,200	16.00	12.50	1,190	5188281	
CA*F4860*6D*+TXV	G*VM961005DXB*	34,600	24,800	16.00	12.50	1,150	5623935	
CA*F4860*6D*+TXV	A*VC950905DXB*	35,000	25,200	16.00	12.50	1,150	5623871	
CA*F4860*6D*+TXV	G*VC950915DXB*	35,000	25,200	16.00	12.50	1,150	5623881	
CA*F4860*6D*+TXV	G*VC91155DXA*	35,000	25,200	15.50	12.20	1,100	6498231	
CA*F4860*6D*+TXV	G*VM960805CXB*	35,000	25,200	15.50	12.00	1,150	5623915	
CA*F4860*6D*+TXV	G*VC950453BXB*	34,600	24,800	16.00	12.20	1,130	5623833	

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
ASXC16 0361B* (cont.)	CA*F4860*6D*+TXV	A*VM961005DXB*	35,000	25,200	16.00	12.50	1,150	5623934
	CA*F4860*6D*+TXV	A*VC951155DXB*	35,000	25,200	16.00	12.50	1,150	5623886
	CA*F4860*6D*+TXV	G*VC80604B*B*	34,600	24,800	16.00	12.50	1,220	5188282
	CA*F4860*6D*+TXV	A*VM960604CXB*	34,600	24,800	16.00	12.30	1,100	5623904
	CA*F4860*6D*+TXV	A*VC950714CXB*	34,600	24,800	16.00	12.30	1,100	5623854
	CA*F4860*6D*+TXV	G*VC951155DXB*	34,600	24,800	16.00	12.50	1,150	5623887
	CA*F4860*6D*+TXV	A*VC950905CXB*	35,000	25,200	15.50	12.00	1,150	5623860
	CA*F4860*6D*+TXV	G*VC80805C*B*	35,000	25,200	16.00	12.50	1,190	5188283
	CA*F4860*6D*+TXV	G*VC950714CXB*	34,600	24,800	16.00	12.30	1,100	5623855
	CA*F4860*6D*+TXV	G*VM960805DXB*	35,000	25,200	16.00	12.50	1,150	5623925
	CA*F4860*6D*+TXV	A*VM960603BXB*	35,000	25,200	16.00	12.20	1,130	5623895
	CA*F4860*6D*+TXV	A*VC950453BXB*	35,000	25,200	16.00	12.20	1,130	5623832
	CA*F4860*6D*+TXV	ADVC80805C*B*	35,000	25,200	16.00	12.50	1,190	5188388
	CA*F4860*6D*+TXV	A*VM961155DXB*	35,000	25,200	16.00	12.50	1,150	5623944
	CA*F4860*6D*+TXV	A*VC950704CXB*	34,600	24,800	16.00	12.20	1,100	5623842
	CA*F4860*6D*+TXV	G*VM961155DXB*	34,600	24,800	16.00	12.50	1,150	5623945
	CA*F4860*6D*+TXV	G*VC950905CXB*	35,000	25,200	15.50	12.00	1,150	5623861
	CA*F4860*6D*+TXV	A*VM960805CXB*	35,000	25,200	15.50	12.00	1,150	5623914
	CA*F4860*6D*+TXV	A*VM960805DXB*	35,000	25,200	15.50	12.00	1,150	5623924
	CA*F4860*6D*+TXV	A*VC950915DXB*	35,000	25,200	16.00	12.50	1,150	5623880
	CA*F4860*6D*+TXV	G*VC950704CXB*	34,600	24,800	16.00	12.30	1,100	5623843
	CA*F4860*6D*+TXV	A*VC80604B*B*	34,600	24,800	16.00	12.50	1,220	5188280
	CA*F4860*6D*+TXV	G*VM960603BXB*	34,600	24,800	16.00	12.20	1,130	5623896
	CA*F4961*6D*+TXV	G*VM960805CXB*	35,000	25,200	16.00	12.50	1,200	5623917
	CA*F4961*6D*+TXV	G*EC961004CNA*	35,000	25,200	16.00	12.50	1,150	7368319
	CA*F4961*6D*+TXV	G*VC961205DNA*	35,000	25,200	16.00	13.00	1,115	7369570
	CA*F4961*6D*+TXV	A*VM971205DNA*	35,000	25,200	16.00	13.00	1,115	7369786
	CA*F4961*6D*+TXV	G*VC961005CNA*	35,000	25,200	16.00	13.00	1,200	7369564
	CA*F4961*6D*+TXV	A*VC961005CNA*	35,000	25,200	16.00	13.00	1,200	7369710
	CA*F4961*6D*+TXV	G*VM971205DNA*	35,000	25,200	16.00	13.00	1,115	7369638
	CA*F4961*6D*+TXV	A*EC961004CNA*	35,000	25,200	16.00	12.50	1,150	7368358
	CA*F4961*6D*+TXV	A*VM960805CXB*	35,000	25,200	16.00	12.50	1,200	5623916
	CA*F4961*6D*+TXV	G*VM971005CNA*	35,000	25,200	16.00	13.00	1,200	7369632
	CA*F4961*6D*+TXV	A*VM971005CNA*	35,000	25,200	16.00	13.00	1,200	7369780
	CA*F4961*6D*+TXV	A*VM970804CNA*	35,000	25,200	16.00	13.00	1,125	7369774
	CA*F4961*6D*+TXV	A*EC961205DNA*	35,000	25,200	16.00	12.20	1,250	7368363
	CA*F4961*6D*+TXV	G*EC961205DNA*	35,000	25,200	16.00	12.20	1,250	7368324
	CA*F4961*6D*+TXV	G*VC960804CNA*	35,000	25,200	16.00	13.00	1,125	7369558
	CA*F4961*6D*+TXV	G*VM970804CNA*	35,000	25,200	16.00	13.00	1,125	7369626
	CA*F4961*6D*+TXV	A*VC960804CNA*	35,000	25,200	16.00	13.00	1,125	7369704
	CA*F4961*6D*+TXV	A*VC961205DNA*	35,000	25,200	16.00	13.00	1,115	7369717
	CAPT3743*4A*	A*EC961205DNA*	34,600	24,800	15.50	12.00	1,250	7368364
	CAPT3743*4A*	A*VC961005CNA*	34,600	24,800	15.50	12.00	1,200	7369711
	CAPT3743*4A*	A*EC961004CNA*	34,600	24,800	15.50	12.00	1,150	7368359
CAPT3743*4A*	G*VC960803BNA*	34,000	24,400	15.50	11.50	1,100	7369554	
CAPT3743*4A*	A*EC960603BNA*	34,800	25,000	15.00	11.50	1,150	7368350	
CAPT3743*4A*	G*VM971205DNA*	34,200	24,600	15.50	12.00	1,115	7369639	
CAPT3743*4A*	G*VM970804CNA*	34,600	24,800	15.50	12.00	1,125	7369627	
CAPT3743*4A*	G*VC960804CNA*	34,600	24,800	15.50	12.00	1,125	7369559	
CAPT3743*4A*	G*VM971005CNA*	34,600	24,800	15.50	12.00	1,200	7369633	
CAPT3743*4A*	G*VM970603BNA*	34,000	24,400	15.50	11.50	1,075	7369617	
CAPT3743*4A*	A*VC960803BNA*	34,000	24,400	15.50	11.50	1,100	7369700	
CAPT3743*4A*	G*EC961004CNA*	34,600	24,800	15.50	12.00	1,150	7368320	
CAPT3743*4A*	G*VC961005CNA*	34,600	24,800	15.50	12.00	1,200	7369565	
CAPT3743*4A*	A*EC960803BNA*	34,800	25,000	15.00	11.50	1,150	7368354	
CAPT3743*4A*	G*VC960603BNA*	34,000	24,400	15.50	11.50	1,075	7369549	

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #	
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³			
ASXC16 0361B* (cont.)	CAPT3743*4A*	G*EC960803BNA*	34,800	25,000	15.00	11.50	1,150	7368315	
	CAPT3743*4A*	A*VM970803BNA*	34,000	24,400	15.50	11.50	1,100	7369770	
	CAPT3743*4A*	G*VM970803BNA*	34,000	24,400	15.50	11.50	1,100	7369622	
	CAPT3743*4A*	G*VM960603BXB*	34,000	24,400	15.50	12.00	1,130	6603425	
	CAPT3743*4A*	A*VM970603BNA*	34,000	24,400	15.50	11.50	1,075	7369764	
	CAPT3743*4A*	A*VM971005CNA*	34,600	24,800	15.50	12.00	1,200	7369781	
	CAPT3743*4A*	A*VM960603BXB*	34,000	24,400	15.50	12.00	1,130	6603424	
	CAPT3743*4A*	A*VC961205DNA*	34,200	24,600	15.50	12.00	1,115	7369718	
	CAPT3743*4A*	A*VM971205DNA*	34,200	24,600	15.50	12.00	1,115	7369787	
	CAPT3743*4A*	A*VC960403BNA*	34,000	24,400	15.50	11.50	1,075	7369690	
	CAPT3743*4A*	G*VC960403BNA*	34,000	24,400	15.50	11.50	1,075	7369544	
	CAPT3743*4A*	G*EC960603BNA*	34,800	25,000	15.00	11.50	1,150	7368311	
	CAPT3743*4A*	A*VC960804CNA*	34,600	24,800	15.50	12.00	1,125	7369705	
	CAPT3743*4A*	A*VM970804CNA*	34,600	24,800	15.50	12.00	1,125	7369775	
	CAPT3743*4A*	G*EC961205DNA*	34,600	24,800	15.50	12.00	1,250	7368325	
	CAPT3743*4A*	A*VC960603BNA*	34,000	24,400	15.50	11.50	1,075	7369695	
	CAPT3743*4A*	G*VC961205DNA*	34,200	24,600	15.50	12.00	1,115	7369571	
	CHPF3642C6C*+MBVC1600**-1A*+TXV			34,600	24,800	16.00	12.50	1,200	3655119
	CHPF3642C6C*+TXV	G*VM960805DXB*		34,600	24,800	16.00	12.50	1,150	6498238
	CHPF3642C6C*+TXV	G*VC80805C*B*		34,600	24,800	16.00	12.50	1,190	5188287
	CHPF3642C6C*+TXV	G*VM960603BXB*		34,000	24,400	15.50	12.00	1,130	6498235
	CHPF3642C6C*+TXV	G*VC80604B*B*		34,000	24,400	15.50	12.00	1,220	5188286
	CHPF3642C6C*+TXV	G*VM960805CXB*		34,600	24,800	16.00	12.00	1,150	6498237
	CHPF3642C6C*+TXV	G*VM961155DXB*		34,600	24,800	16.00	12.50	1,150	6498240
	CHPF3642C6C*+TXV	G*VM960604CXB*		34,600	24,800	16.00	12.00	1,100	6498236
	CHPF3642C6C*+TXV	G*VC950905CXB*		34,600	24,800	16.00	12.00	1,150	6498234
	CHPF3642C6C*+TXV	A*VC950453BXB*		34,000	24,400	15.50	12.00	1,130	6498232
	CHPF3642C6C*+TXV	A*VC80604B*B*		34,000	24,400	15.50	12.00	1,220	5188284
	CHPF3642C6C*+TXV	A*VC80805C*B*		34,600	24,800	16.00	12.50	1,190	5188285
	CHPF3642C6C*+TXV	A*VM960604CXB*		34,600	24,800	16.00	12.00	1,100	5623906
	CHPF3642C6C*+TXV	A*VC950704CXB*		34,600	24,800	16.00	12.00	1,100	5623844
	CHPF3642C6C*+TXV	G*VM961005DXB*		34,600	24,800	16.00	12.50	1,150	6498239
	CHPF3642C6C*+TXV	G*VC950453BXB*		34,000	24,400	15.50	12.00	1,130	6498233
	CHPF3642C6C*+TXV	G*VC950704CXB*		34,600	24,800	16.00	12.00	1,100	5623845
	CHPF3642D6C*+MBVC2000**-1A*+TXV			35,000	25,200	16.00	12.80	1,200	3655129
	CHPF3642D6C*+TXV	G*VC950905DXB*		34,600	24,800	16.00	12.50	1,150	6498242
	CHPF3642D6C*+TXV	A*VC950905CXB*		34,600	24,800	16.00	12.00	1,150	5623862
	CHPF3642D6C*+TXV	A*VM961005DXB*		34,600	24,800	16.00	12.50	1,150	5623936
	CHPF3642D6C*+TXV	G*VM961005DXB*		34,600	24,800	16.00	12.50	1,150	6498246
	CHPF3642D6C*+TXV	G*VC950905CXB*		34,600	24,800	16.00	12.00	1,150	6498241
	CHPF3642D6C*+TXV	G*VC951155DXB*		34,600	24,800	16.00	12.50	1,150	6498243
	CHPF3642D6C*+TXV	A*VM960805CXB*		34,600	24,800	16.00	12.00	1,150	5623918
	CHPF3642D6C*+TXV	G*VM960805CXB*		34,600	24,800	16.00	12.00	1,150	6498244
	CHPF3642D6C*+TXV	G*VM961155DXB*		34,600	24,800	16.00	12.50	1,150	6498247
	CHPF3642D6C*+TXV	A*VM961155DXB*		34,600	24,800	16.00	12.50	1,150	5623946
	CHPF3642D6C*+TXV	A*VM960805DXB*		34,600	24,800	16.00	12.00	1,150	5623926
	CHPF3642D6C*+TXV	A*VC950905DXB*		34,600	24,800	16.00	12.50	1,150	5623873
CHPF3642D6C*+TXV	A*VC951155DXB*		34,600	24,800	16.00	12.50	1,150	5623888	
CHPF3642D6C*+TXV	G*VM960805DXB*		34,600	24,800	16.00	12.50	1,150	6498245	
CHPF3743C6B*+EEP+TXV			34,000	24,400	14.50	11.50	1,200	5357226	
CHPF3743C6B*+MBVC1600**-1A*+TXV			34,600	24,800	16.00	12.50	1,200	3655137	
CHPF3743C6B*+MBVC2000**-1A*+TXV			35,000	25,200	16.00	12.80	1,200	3655138	
CHPF3743C6B*+TXV	G*VM961005DXB*		34,600	24,800	16.00	12.50	1,150	6498255	
CHPF3743C6B*+TXV	A*VM970804CNA*		34,600	24,800	15.50	12.00	1,125	7369776	
CHPF3743C6B*+TXV	A*VC950905CXB*		34,600	24,800	16.00	12.00	1,150	5623863	
CHPF3743C6B*+TXV	G*VM960805DXB*		34,600	24,800	16.00	12.50	1,150	6498254	

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #	
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³			
ASXC16 0361B* (cont.)	CHPF3743C6B*+TXV	G*VM960604CXB*	34,600	24,800	16.00	12.00	1,100	6498252	
	CHPF3743C6B*+TXV	A*VC960603BNA*	33,600	24,200	15.50	11.50	1,075	7369696	
	CHPF3743C6B*+TXV	G*VM970803BNA*	33,600	24,200	15.50	11.50	1,100	7369623	
	CHPF3743C6B*+TXV	A*VM960603BXB*	34,000	24,400	16.00	12.20	1,130	5623897	
	CHPF3743C6B*+TXV	G*VM960805CXB*	34,600	24,800	16.00	12.00	1,150	6498253	
	CHPF3743C6B*+TXV	A*VC960403BNA*	33,600	24,200	15.50	11.50	1,075	7369691	
	CHPF3743C6B*+TXV	G*VC950704CXB*	34,600	24,800	16.00	12.00	1,100	6498249	
	CHPF3743C6B*+TXV	G*VC960803BNA*	33,600	24,200	15.50	11.50	1,100	7369555	
	CHPF3743C6B*+TXV	A*VC80805C*B*	34,600	24,800	16.00	12.50	1,190	5188289	
	CHPF3743C6B*+TXV	A*EC960603BNA*	34,800	25,000	15.50	11.50	1,150	7368351	
	CHPF3743C6B*+TXV	G*VC960804CNA*	34,600	24,800	15.50	12.00	1,125	7369560	
	CHPF3743C6B*+TXV	A*VM960805DXB*	34,600	24,800	16.00	12.00	1,150	5623927	
	CHPF3743C6B*+TXV	A*EC961004CNA*	34,600	24,800	15.50	12.00	1,150	7368360	
	CHPF3743C6B*+TXV	A*VC951155DXB*	34,600	24,800	16.00	12.50	1,150	5623889	
	CHPF3743C6B*+TXV	A*VC950704CXB*	34,600	24,800	16.00	12.00	1,100	5623846	
	CHPF3743C6B*+TXV	A*VM960805CXB*	34,600	24,800	16.00	12.00	1,150	5623919	
	CHPF3743C6B*+TXV	A*VM961005DXB*	34,600	24,800	16.00	12.50	1,150	5623937	
	CHPF3743C6B*+TXV	A*VM970803BNA*	33,600	24,200	15.50	11.50	1,100	7369771	
	CHPF3743C6B*+TXV	G*VM970603BNA*	33,600	24,200	15.50	11.50	1,075	7369618	
	CHPF3743C6B*+TXV	G*VC961005CNA*	34,600	24,800	15.50	12.00	1,200	7369566	
	CHPF3743C6B*+TXV	A*VC960804CNA*	34,600	24,800	15.50	12.00	1,125	7369706	
	CHPF3743C6B*+TXV	G*EC960603BNA*	34,800	25,000	15.50	11.50	1,150	7368312	
	CHPF3743C6B*+TXV	G*VC950453BXB*	34,000	24,400	16.00	12.50	1,130	6498248	
	CHPF3743C6B*+TXV	A*VM971005CNA*	34,600	24,800	15.50	12.00	1,200	7369782	
	CHPF3743C6B*+TXV	G*VC950905CXB*	34,600	24,800	16.00	12.00	1,150	6498250	
	CHPF3743C6B*+TXV	A*VM970603BNA*	33,600	24,200	15.50	11.50	1,075	7369765	
	CHPF3743C6B*+TXV	G*EC961004CNA*	34,600	24,800	15.50	12.00	1,150	7368321	
	CHPF3743C6B*+TXV	G*VC960403BNA*	33,600	24,200	15.50	11.50	1,075	7369545	
	CHPF3743C6B*+TXV	G*VM960603BXB*	34,000	24,400	16.00	12.50	1,130	6498251	
	CHPF3743C6B*+TXV	A*VM960604CXB*	34,600	24,800	16.00	12.00	1,100	5623907	
	CHPF3743C6B*+TXV	G*VM971005CNA*	34,600	24,800	15.50	12.00	1,200	7369634	
	CHPF3743C6B*+TXV	A*VC960803BNA*	33,600	24,200	15.50	11.50	1,100	7369701	
	CHPF3743C6B*+TXV	G*VC960603BNA*	33,600	24,200	15.50	11.50	1,075	7369550	
	CHPF3743C6B*+TXV	A*VC961005CNA*	34,600	24,800	15.50	12.00	1,200	7369712	
	CHPF3743C6B*+TXV	G*VC80805C*B*	34,600	24,800	16.00	12.50	1,190	5188291	
	CHPF3743C6B*+TXV	A*VC80604B*B*	34,000	24,400	15.50	12.00	1,220	5188288	
	CHPF3743C6B*+TXV	A*VM961155DXB*	34,600	24,800	16.00	12.50	1,150	5623947	
	CHPF3743C6B*+TXV	A*EC960803BNA*	34,800	25,000	15.50	11.50	1,150	7368355	
	CHPF3743C6B*+TXV	G*VM961155DXB*	34,600	24,800	16.00	12.50	1,150	6498256	
	CHPF3743C6B*+TXV	G*VM970804CNA*	34,600	24,800	15.50	12.00	1,125	7369628	
	CHPF3743C6B*+TXV	G*EC960803BNA*	34,800	25,000	15.50	11.50	1,150	7368316	
	CHPF3743C6B*+TXV	G*VC80604B*B*	34,000	24,400	15.50	12.00	1,220	5188290	
	CHPF3743C6B*+TXV	A*VC950453BXB*	34,000	24,400	16.00	12.20	1,130	5623834	
	CHPF3743C6B*+TXV	A*VC950905DXB*	34,600	24,800	16.00	12.50	1,150	5623874	
	CHPF3743D6B*+MBVC2000**-1A*+TXV			35,000	25,200	16.00	12.80	1,200	3655155
	CHPF3743D6B*+TXV	A*VC80604B*B*		34,000	24,400	16.00	12.50	1,220	5188292
	CHPF3743D6B*+TXV	G*VC951155DXB*		34,600	24,800	16.00	12.50	1,150	6498261
CHPF3743D6B*+TXV	G*VC961205DNA*		34,200	24,600	15.50	12.00	1,115	7369572	
CHPF3743D6B*+TXV	A*VM960805DXB*		34,600	24,800	16.00	12.00	1,150	5623928	
CHPF3743D6B*+TXV	A*VC950905DXB*		34,600	24,800	16.00	12.50	1,150	5623875	
CHPF3743D6B*+TXV	A*VM971205DNA*		34,200	24,600	15.50	12.00	1,115	7369788	
CHPF3743D6B*+TXV	G*VC950905DXB*		34,600	24,800	16.00	12.50	1,150	6498260	
CHPF3743D6B*+TXV	A*VM960604CXB*		34,000	24,400	16.00	12.30	1,100	5623908	
CHPF3743D6B*+TXV	G*VC80604B*B*		34,000	24,400	16.00	12.50	1,220	5188294	
CHPF3743D6B*+TXV	A*VC951155DXB*		34,600	24,800	16.00	12.50	1,150	5623890	
CHPF3743D6B*+TXV	G*VM960604CXB*		34,000	24,400	16.00	12.50	1,100	6498263	

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
ASXC16 0361B* (cont.)	CHPF3743D6B*+TXV	A*VC950905CXB*	34,600	24,800	16.00	12.00	1,150	5623864
	CHPF3743D6B*+TXV	G*VC80805C*B*	34,000	24,400	16.00	12.50	1,190	5188295
	CHPF3743D6B*+TXV	A*EC961205DNA*	34,600	24,800	15.50	12.00	1,250	7368365
	CHPF3743D6B*+TXV	A*VM961155DXB*	34,600	24,800	16.00	12.50	1,150	5623948
	CHPF3743D6B*+TXV	G*VC950905CXB*	34,600	24,800	16.00	12.00	1,150	6498259
	CHPF3743D6B*+TXV	G*VM961005DXB*	34,600	24,800	16.00	12.50	1,150	6498266
	CHPF3743D6B*+TXV	A*VM960603BXB*	34,000	24,400	16.00	12.20	1,130	5623898
	CHPF3743D6B*+TXV	G*EC961205DNA*	34,600	24,800	15.50	12.00	1,250	7368326
	CHPF3743D6B*+TXV	G*VM971205DNA*	34,200	24,600	15.50	12.00	1,115	7369640
	CHPF3743D6B*+TXV	G*VM961155DXB*	34,600	24,800	16.00	12.50	1,150	6498267
	CHPF3743D6B*+TXV	G*VC950453BXB*	34,000	24,400	16.00	12.50	1,130	6498257
	CHPF3743D6B*+TXV	A*VM961005DXB*	34,600	24,800	16.00	12.50	1,150	5623938
	CHPF3743D6B*+TXV	A*VC950704CXB*	34,000	24,400	16.00	12.20	1,100	5623847
	CHPF3743D6B*+TXV	G*VM960603BXB*	34,000	24,400	16.00	12.50	1,130	6498262
	CHPF3743D6B*+TXV	A*VM960805CXB*	34,600	24,800	16.00	12.00	1,150	5623920
	CHPF3743D6B*+TXV	A*VC950453BXB*	34,000	24,400	16.00	12.20	1,130	5623835
	CHPF3743D6B*+TXV	G*VM960805DXB*	34,600	24,800	16.00	12.50	1,150	6498265
	CHPF3743D6B*+TXV	G*VM960805CXB*	34,600	24,800	16.00	12.00	1,150	6498264
	CHPF3743D6B*+TXV	G*VC950704CXB*	34,000	24,400	16.00	12.50	1,100	6498258
	CHPF3743D6B*+TXV	A*VC80805C*B*	34,000	24,400	16.00	12.50	1,190	5188293
	CHPF3743D6B*+TXV	A*VC961205DNA*	34,200	24,600	15.50	12.00	1,115	7369719
	CHPF4860D6D*+EEP+TXV		35,000	25,200	14.50	11.50	1,200	5357227
	CHPF4860D6D*+TXV	G*VC950453BXB*	34,600	24,800	16.00	12.50	1,130	6498268
	CHPF4860D6D*+TXV	A*VM961155DXB*	35,000	25,200	16.00	12.50	1,150	5623949
	CHPF4860D6D*+TXV	G*VC80805C*B*	34,600	24,800	16.00	12.50	1,190	5188299
	CHPF4860D6D*+TXV	A*VM970804CNA*	34,600	24,800	15.50	12.00	1,125	7369777
	CHPF4860D6D*+TXV	A*VM960604CXB*	35,000	25,200	16.00	12.30	1,100	5623909
	CHPF4860D6D*+TXV	G*VM961155DXB*	35,000	25,200	16.00	12.50	1,150	6498278
	CHPF4860D6D*+TXV	A*VC950453BXB*	34,600	24,800	16.00	12.20	1,130	5623836
	CHPF4860D6D*+TXV	G*VM970804CNA*	34,600	24,800	15.50	12.00	1,125	7369629
	CHPF4860D6D*+TXV	G*VM971005CNA*	34,600	24,800	15.50	12.50	1,200	7369635
	CHPF4860D6D*+TXV	G*VC951155DXB*	35,000	25,200	16.00	12.50	1,150	6498272
	CHPF4860D6D*+TXV	G*VC950905CXB*	35,000	25,200	16.00	12.00	1,150	6498270
	CHPF4860D6D*+TXV	A*VC961005CNA*	34,600	24,800	15.50	12.50	1,200	7369714
	CHPF4860D6D*+TXV	A*VC950905DXB*	35,000	25,200	16.00	12.50	1,150	5623876
	CHPF4860D6D*+TXV	A*VM971005CNA*	34,600	24,800	15.50	12.50	1,200	7369783
	CHPF4860D6D*+TXV	G*VC950704CXB*	35,000	25,200	16.00	12.50	1,100	6498269
	CHPF4860D6D*+TXV	A*VM960805CXB*	35,000	25,200	16.00	12.00	1,150	5623921
	CHPF4860D6D*+TXV	A*VM960603BXB*	34,600	24,800	16.00	12.20	1,130	5623899
	CHPF4860D6D*+TXV	G*VM960805DXB*	35,000	25,200	16.00	12.50	1,150	6498276
	CHPF4860D6D*+TXV	A*VC950704CXB*	35,000	25,200	16.00	12.20	1,100	5623848
	CHPF4860D6D*+TXV	G*VM960603BXB*	34,600	24,800	16.00	12.50	1,130	6498273
	CHPF4860D6D*+TXV	G*VC950905DXB*	35,000	25,200	16.00	12.50	1,150	6498271
	CHPF4860D6D*+TXV	G*VC80604B*B*	34,600	24,800	16.00	12.50	1,220	5188298
	CHPF4860D6D*+TXV	A*VC80805C*B*	34,600	24,800	16.00	12.50	1,190	5188297
CHPF4860D6D*+TXV	A*VC80604B*B*	34,600	24,800	16.00	12.50	1,220	5188296	
CHPF4860D6D*+TXV	A*VM961005DXB*	35,000	25,200	16.00	12.50	1,150	5623939	
CHPF4860D6D*+TXV	G*VM971205DNA*	34,200	24,600	15.50	12.50	1,115	7369641	
CHPF4860D6D*+TXV	A*VC951155DXB*	35,000	25,200	16.00	12.50	1,150	5623891	
CHPF4860D6D*+TXV	G*VC960804CNA*	34,600	24,800	15.50	12.00	1,125	7369561	
CHPF4860D6D*+TXV	G*VM961005DXB*	35,000	25,200	16.00	12.50	1,150	6498277	
CHPF4860D6D*+TXV	A*VC950905CXB*	35,000	25,200	16.00	12.00	1,150	5623865	
CHPF4860D6D*+TXV	A*VM960805DXB*	35,000	25,200	16.00	12.00	1,150	5623929	
CHPF4860D6D*+TXV	G*VC961005CNA*	34,600	24,800	15.50	12.50	1,200	7369567	
CHPF4860D6D*+TXV	A*VC960804CNA*	34,600	24,800	15.50	12.00	1,125	7369707	
CHPF4860D6D*+TXV	G*VM960805CXB*	35,000	25,200	16.00	12.00	1,150	6498275	

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
ASXC16 0361B* (cont.)	CHPF4860D6D*+TXV	A*VM971205DNA*	34,200	24,600	15.50	12.50	1,115	7369789
	CHPF4860D6D*+TXV	A*VC961205DNA*	34,200	24,600	15.50	12.50	1,115	7369720
	CHPF4860D6D*+TXV	G*VM960604CXB*	35,000	25,200	16.00	12.50	1,100	6498274
	CHPF4860D6D*+TXV	G*VC961205DNA*	34,200	24,600	15.50	12.50	1,115	7369573
	CSCF3642N6D*+TXV	G*VC950453BXB*	34,000	24,400	16.00	12.00	1,200	6498279
	CSCF3642N6D*+TXV	A*VC950905CXB*	34,600	24,800	16.00	12.00	1,150	5623866
	CSCF3642N6D*+TXV	G*VM970804CNA*	34,600	24,800	15.50	12.00	1,125	7369630
	CSCF3642N6D*+TXV	A*VM971005CNA*	34,600	24,800	15.50	12.00	1,200	7369784
	CSCF3642N6D*+TXV	G*VC960603BNA*	33,600	24,200	15.50	11.50	1,075	7369551
	CSCF3642N6D*+TXV	A*VC950453BXB*	34,000	24,400	16.00	12.00	1,200	5623837
	CSCF3642N6D*+TXV	A*VC950704CXB*	34,200	24,600	16.00	12.00	1,225	5623849
	CSCF3642N6D*+TXV	G*VM970603BNA*	33,600	24,200	15.50	11.50	1,075	7369619
	CSCF3642N6D*+TXV	G*VM971005CNA*	34,600	24,800	15.50	12.00	1,200	7369636
	CSCF3642N6D*+TXV	G*VM970803BNA*	33,600	24,200	15.50	11.50	1,100	7369624
	CSCF3642N6D*+TXV	A*VC961005CNA*	34,600	24,800	15.50	12.00	1,200	7369715
	CSCF3642N6D*+TXV	A*VM970804CNA*	34,600	24,800	15.50	12.00	1,125	7369778
	CSCF3642N6D*+TXV	A*VC960804CNA*	34,600	24,800	15.50	12.00	1,125	7369708
	CSCF3642N6D*+TXV	A*VC951155DXB*	34,600	24,800	16.00	12.00	1,225	5623892
	CSCF3642N6D*+TXV	A*VM970603BNA*	33,600	24,200	15.50	11.50	1,075	7369766
	CSCF3642N6D*+TXV	A*VC960403BNA*	33,600	24,200	15.50	11.50	1,075	7369692
	CSCF3642N6D*+TXV	G*VC960803BNA*	33,600	24,200	15.50	11.50	1,100	7369556
	CSCF3642N6D*+TXV	G*VC961005CNA*	34,600	24,800	15.50	12.00	1,200	7369568
	CSCF3642N6D*+TXV	G*VC960804CNA*	34,600	24,800	15.50	12.00	1,125	7369562
	CSCF3642N6D*+TXV	A*VM970803BNA*	33,600	24,200	15.50	11.50	1,100	7369772
	CSCF3642N6D*+TXV	A*VC950905DXB*	34,600	24,800	16.00	12.00	1,150	5623877
	CSCF3642N6D*+TXV	A*VC960603BNA*	33,600	24,200	15.50	11.50	1,075	7369697
	CSCF3642N6D*+TXV	G*VC960403BNA*	33,600	24,200	15.50	11.50	1,075	7369546
	CSCF3642N6D*+TXV	A*VC960803BNA*	33,600	24,200	15.50	11.50	1,100	7369702
	CSCF4860N6D*+EEP+TXV		35,000	25,200	14.50	11.50	1,200	5357229
	CSCF4860N6D*+TXV	A*VC961205DNA*	34,200	24,600	15.50	12.00	1,115	7369721
CSCF4860N6D*+TXV	G*VC961205DNA*	34,200	24,600	15.50	12.00	1,115	7369574	
CSCF4860N6D*+TXV	G*VM971205DNA*	34,200	24,600	15.50	12.00	1,115	7369642	
CSCF4860N6D*+TXV	A*VM971205DNA*	34,200	24,600	15.50	12.00	1,115	7369790	
ASXC16 0481B*	AVPTC48C14A*		44,500	33,400	14.50	11.50	1,450	7080491
	AVPTC48D14A*		46,000	34,600	15.50	12.00	1,575	5924391
	AVPTC60D14A*		45,500	34,200	16.00	12.00	1,430	6687798
	CA*F4860*6D*+EEP+TXV		47,000	35,200	14.50	12.00	1,675	5357230
	CA*F4860*6D*+MBVC1600**-1A*+TXV		46,000	34,600	15.00	12.00	1,600	4559618
	CA*F4860*6D*+MBVC2000**-1A*+TXV		47,000	35,200	16.00	12.50	1,600	4559619
	CA*F4860*6D*+TXV	A*VC961005CNA*	45,500	34,200	15.00	12.00	1,400	7369727
	CA*F4860*6D*+TXV	A*VC951155DXB*	46,000	34,600	16.00	12.50	1,400	5623966
	CA*F4860*6D*+TXV	G*VC950704CXB*	45,500	34,200	15.00	12.00	1,400	5623951
	CA*F4860*6D*+TXV	ADVC81005C*B*	46,000	34,600	16.00	12.00	1,410	5188415
	CA*F4860*6D*+TXV	A*VC80805C*B*	46,000	34,600	16.00	12.30	1,390	5188301
	CA*F4860*6D*+TXV	G*VC950905CXB*	46,000	34,600	15.00	11.50	1,400	5623956
	CA*F4860*6D*+TXV	A*VM961005DXB*	46,000	34,600	16.00	12.50	1,400	5623973
	CA*F4860*6D*+TXV	A*VM971005CNA*	45,500	34,200	15.00	12.00	1,400	7369796
	CA*F4860*6D*+TXV	G*VM961005DXB*	46,000	34,600	16.00	12.30	1,400	5623974
	CA*F4860*6D*+TXV	G*VC960804CNA*	45,500	34,200	15.00	12.00	1,400	7369575
	CA*F4860*6D*+TXV	G*VC951155DXB*	46,000	34,600	16.00	12.30	1,400	5623967
	CA*F4860*6D*+TXV	A*VC950905DXB*	46,000	34,600	16.00	12.30	1,400	5623958
	CA*F4860*6D*+TXV	G*VM971005CNA*	45,500	34,200	15.00	12.00	1,400	7369648
	CA*F4860*6D*+TXV	G*VC961005CNA*	45,500	34,200	15.00	12.00	1,400	7369580
	CA*F4860*6D*+TXV	G*VC80604B*B*	45,500	34,200	15.00	12.00	1,400	5188303
	CA*F4860*6D*+TXV	A*VC81005C*B*	46,000	34,600	16.00	12.00	1,370	5188302
	CA*F4860*6D*+TXV	G*VM961155DXB*	46,000	34,600	16.00	12.30	1,400	5623980

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
ASXC16 0481B* (cont.)	CA*F4860*6D*+TXV	A*VM971205DNA*	46,000	34,600	15.50	12.00	1,450	7369801
	CA*F4860*6D*+TXV	G*VC950905DXB*	46,000	34,600	16.00	12.30	1,400	5623959
	CA*F4860*6D*+TXV	A*VC960804CNA*	45,500	34,200	15.00	12.00	1,400	7369722
	CA*F4860*6D*+TXV	G*VC950915DXB*	46,000	34,600	15.00	11.50	1,400	5623965
	CA*F4860*6D*+TXV	A*VC950915DXB*	46,000	34,600	15.00	11.50	1,400	5623964
	CA*F4860*6D*+TXV	G*VM971205DNA*	46,000	34,600	15.50	12.00	1,450	7369653
	CA*F4860*6D*+TXV	A*VC950905CXB*	46,000	34,600	15.00	11.50	1,400	7125856
	CA*F4860*6D*+TXV	G*VC81005C*B*	46,000	34,600	16.00	12.00	1,370	5188305
	CA*F4860*6D*+TXV	A*VM970804CNA*	45,500	34,200	15.00	12.00	1,400	7369791
	CA*F4860*6D*+TXV	G*VC961205DNA*	46,000	34,600	15.50	12.00	1,450	7369585
	CA*F4860*6D*+TXV	G*VC80805C*B*	46,000	34,600	16.00	12.30	1,390	5188304
	CA*F4860*6D*+TXV	A*VC80604B*B*	45,500	34,200	15.00	12.00	1,400	5188300
	CA*F4860*6D*+TXV	G*VC91155DXA*	45,500	34,200	15.50	11.50	1,400	6498280
	CA*F4860*6D*+TXV	A*VC961205DNA*	46,000	34,600	15.50	12.00	1,450	7369732
	CA*F4860*6D*+TXV	ADVC80805C*B*	46,000	34,600	16.00	12.30	1,380	5188420
	CA*F4860*6D*+TXV	A*VM961155DXB*	46,000	34,600	16.00	12.50	1,400	5623979
	CA*F4860*6D*+TXV	A*VC950704CXB*	45,500	34,200	15.00	12.00	1,400	5623950
	CA*F4860*6D*+TXV	G*VM970804CNA*	45,500	34,200	15.00	12.00	1,400	7369643
	CA*F4961*6D*+EEP+TXV		48,000	36,000	14.50	12.00	1,675	5357231
	CA*F4961*6D*+MBVC1600**-1A*+TXV		46,000	34,600	15.00	12.00	1,400	4431406
	CA*F4961*6D*+MBVC2000**-1A*+TXV		47,000	35,200	16.00	12.50	1,400	4431407
	CA*F4961*6D*+TXV	G*EC961205DNA*	46,500	35,000	15.50	12.00	1,520	7368330
	CA*F4961*6D*+TXV	A*EC961004CNA*	46,500	35,000	15.50	12.00	1,550	7368366
	CA*F4961*6D*+TXV	A*VC950704CXB*	46,500	35,000	15.00	12.00	1,350	5623952
	CA*F4961*6D*+TXV	G*VC960804CNA*	46,500	35,000	15.50	12.00	1,400	7369576
	CA*F4961*6D*+TXV	A*VC960804CNA*	46,500	35,000	15.50	12.00	1,400	7369723
	CA*F4961*6D*+TXV	A*VM960805CXB*	47,000	35,200	15.50	12.00	1,350	5623972
	CA*F4961*6D*+TXV	A*VM961155DXB*	47,000	35,200	16.00	12.50	1,350	5623981
	CA*F4961*6D*+TXV	A*VC81005C*B*	46,500	35,000	16.00	12.00	1,370	5188308
	CA*F4961*6D*+TXV	G*VC91155DXA*	45,500	34,200	15.50	12.00	1,350	6498281
	CA*F4961*6D*+TXV	G*VM961155DXB*	47,000	35,200	16.00	12.50	1,350	5623982
	CA*F4961*6D*+TXV	A*VM971005CNA*	46,500	35,000	15.50	12.00	1,400	7369797
	CA*F4961*6D*+TXV	G*VC950704CXB*	46,500	35,000	15.00	12.00	1,350	5623953
	CA*F4961*6D*+TXV	A*VC951155DXB*	47,000	35,200	16.00	12.50	1,350	5623968
	CA*F4961*6D*+TXV	A*VM961005DXB*	47,000	35,200	16.00	12.50	1,350	5623975
	CA*F4961*6D*+TXV	G*VC80805C*B*	47,000	35,200	16.00	12.50	1,390	5188310
	CA*F4961*6D*+TXV	G*VM971005CNA*	46,500	35,000	15.50	12.00	1,400	7369649
	CA*F4961*6D*+TXV	A*VM971205DNA*	47,000	35,200	16.00	12.00	1,450	7369802
	CA*F4961*6D*+TXV	G*VC961005CNA*	46,500	35,000	15.50	12.00	1,400	7369581
	CA*F4961*6D*+TXV	A*EC961205DNA*	46,500	35,000	15.50	12.00	1,520	7368372
	CA*F4961*6D*+TXV	A*VC961205DNA*	47,000	35,200	16.00	12.00	1,450	7369733
	CA*F4961*6D*+TXV	G*VC951155DXB*	47,000	35,200	16.00	12.50	1,350	5623969
	CA*F4961*6D*+TXV	G*VM970804CNA*	46,500	35,000	15.50	12.00	1,400	7369644
	CA*F4961*6D*+TXV	G*VM961005DXB*	47,000	35,200	16.00	12.50	1,350	5623976
	CA*F4961*6D*+TXV	A*VC961005CNA*	46,500	35,000	15.50	12.00	1,400	7369728
	CA*F4961*6D*+TXV	A*VM970804CNA*	46,500	35,000	15.50	12.00	1,400	7369792
	CA*F4961*6D*+TXV	ADVC81005C*B*	46,500	35,000	16.00	12.00	1,410	5188430
	CA*F4961*6D*+TXV	G*EC961004CNA*	46,500	35,000	15.50	12.00	1,550	7368327
	CA*F4961*6D*+TXV	G*VC81005C*B*	46,500	35,000	16.00	12.00	1,370	5188311
	CA*F4961*6D*+TXV	A*VC80604B*B*	46,000	34,600	16.00	12.30	1,400	5188306
CA*F4961*6D*+TXV	A*VC80805C*B*	47,000	35,200	16.00	12.50	1,390	5188307	
CA*F4961*6D*+TXV	G*VM971205DNA*	47,000	35,200	16.00	12.00	1,450	7369654	
CA*F4961*6D*+TXV	G*VC80604B*B*	46,000	34,600	16.00	12.30	1,400	5188309	
CA*F4961*6D*+TXV	ADVC80805C*B*	47,000	35,200	16.00	12.50	1,380	5188390	
CA*F4961*6D*+TXV	G*VC961205DNA*	47,000	35,200	16.00	12.00	1,450	7369586	
CA*F4961*6D*+TXV	G*VC950905DXB*	47,000	35,200	16.00	12.50	1,350	5623961	

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #	
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³			
ASXC16 0481B* (cont.)	CA*F4961*6D*+TXV	A*VC950905DXB*	47,000	35,200	16.00	12.50	1,350	5623960	
	CAPT4961*4A*	A*VC961005CNA*	46,500	35,000	15.00	12.00	1,400	7369729	
	CAPT4961*4A*	A*VM971205DNA*	47,000	35,200	15.50	12.00	1,450	7369803	
	CAPT4961*4A*	G*EC961205DNA*	46,500	35,000	15.00	12.00	1,520	7368331	
	CAPT4961*4A*	G*VC960804CNA*	46,500	35,000	15.00	12.00	1,400	7369577	
	CAPT4961*4A*	A*EC961004CNA*	46,500	35,000	15.00	12.00	1,550	7368367	
	CAPT4961*4A*	A*VC960804CNA*	46,500	35,000	15.00	12.00	1,400	7369724	
	CAPT4961*4A*	G*VC961005CNA*	46,500	35,000	15.00	12.00	1,400	7369582	
	CAPT4961*4A*	G*VC961205DNA*	47,000	35,200	15.50	12.00	1,450	7369587	
	CAPT4961*4A*	G*VM971205DNA*	47,000	35,200	15.50	12.00	1,450	7369655	
	CAPT4961*4A*	G*EC961004CNA*	46,500	35,000	15.00	12.00	1,550	7368328	
	CAPT4961*4A*	A*VM970804CNA*	46,500	35,000	15.00	12.00	1,400	7369793	
	CAPT4961*4A*	G*VM971005CNA*	46,500	35,000	15.00	12.00	1,400	7369650	
	CAPT4961*4A*	A*VC961205DNA*	47,000	35,200	15.50	12.00	1,450	7369734	
	CAPT4961*4A*	A*VM971005CNA*	46,500	35,000	15.00	12.00	1,400	7369798	
	CAPT4961*4A*	A*EC961205DNA*	46,500	35,000	15.00	12.00	1,520	7368375	
	CAPT4961*4A*	G*VM970804CNA*	46,500	35,000	15.00	12.00	1,400	7369645	
	CHPF4860D6D*+EEP+TXV			48,000	36,000	14.50	12.00	1,675	5357232
	CHPF4860D6D*+MBVC1600**-1A*+TXV			46,000	34,600	15.00	12.00	1,400	4172425
	CHPF4860D6D*+MBVC2000**-1A*+TXV			47,000	35,200	16.00	12.50	1,400	4172426
	CHPF4860D6D*+TXV	G*VC951155DXB*		47,000	35,200	16.00	12.30	1,350	5623971
	CHPF4860D6D*+TXV	G*VM971205DNA*		47,000	35,200	15.50	12.00	1,450	7369656
	CHPF4860D6D*+TXV	A*VM961155DXB*		47,000	35,200	16.00	12.30	1,350	5623983
	CHPF4860D6D*+TXV	A*VC80604B*B*		45,500	34,200	15.50	12.00	1,400	5188312
	CHPF4860D6D*+TXV	A*VC960804CNA*		46,000	34,600	15.50	12.00	1,400	7369725
	CHPF4860D6D*+TXV	G*VC80805C*B*		45,500	34,200	15.50	12.00	1,390	5188316
	CHPF4860D6D*+TXV	A*VC80805C*B*		45,500	34,200	15.50	12.00	1,390	5188313
	CHPF4860D6D*+TXV	A*VC951155DXB*		47,000	35,200	16.00	12.30	1,350	5623970
	CHPF4860D6D*+TXV	G*EC961004CNA*		46,000	34,600	15.50	12.00	1,550	7368329
	CHPF4860D6D*+TXV	A*EC961205DNA*		46,000	34,600	15.50	12.00	1,520	7368378
	CHPF4860D6D*+TXV	A*EC961004CNA*		46,000	34,600	15.50	12.00	1,550	7368369
	CHPF4860D6D*+TXV	A*VC961005CNA*		46,000	34,600	15.50	12.00	1,400	7369730
	CHPF4860D6D*+TXV	G*VC950905DXB*		47,000	35,200	16.00	12.30	1,350	5623963
	CHPF4860D6D*+TXV	G*VC81005C*B*		45,500	34,200	15.50	12.00	1,370	5188317
	CHPF4860D6D*+TXV	A*VC950905DXB*		47,000	35,200	16.00	12.30	1,350	5623962
	CHPF4860D6D*+TXV	G*VM961155DXB*		47,000	35,200	16.00	12.30	1,350	5623984
	CHPF4860D6D*+TXV	G*VC950905CXB*		47,000	35,200	16.00	12.25	1,350	5623957
	CHPF4860D6D*+TXV	A*VC950704CXB*		46,000	34,600	15.50	12.00	1,350	5623954
	CHPF4860D6D*+TXV	G*VM970804CNA*		46,000	34,600	15.50	12.00	1,400	7369646
	CHPF4860D6D*+TXV	A*VM961005DXB*		47,000	35,200	16.00	12.30	1,350	5623977
	CHPF4860D6D*+TXV	G*VC961005CNA*		46,000	34,600	15.50	12.00	1,400	7369583
	CHPF4860D6D*+TXV	G*VM971005CNA*		46,000	34,600	15.50	12.00	1,400	7369651
	CHPF4860D6D*+TXV	A*VC961205DNA*		47,000	35,200	15.50	12.00	1,450	7369735
	CHPF4860D6D*+TXV	G*VC960804CNA*		46,000	34,600	15.50	12.00	1,400	7369578
	CHPF4860D6D*+TXV	G*VC950704CXB*		46,000	34,600	15.50	12.00	1,350	5623955
CHPF4860D6D*+TXV	G*EC961205DNA*		46,000	34,600	15.50	12.00	1,520	7368332	
CHPF4860D6D*+TXV	G*VC961205DNA*		47,000	35,200	15.50	12.00	1,450	7369588	
CHPF4860D6D*+TXV	A*VM970804CNA*		46,000	34,600	15.50	12.00	1,400	7369794	
CHPF4860D6D*+TXV	A*VC81005C*B*		45,500	34,200	15.50	12.00	1,370	5188314	
CHPF4860D6D*+TXV	G*VM961005DXB*		47,000	35,200	16.00	12.30	1,350	5623978	
CHPF4860D6D*+TXV	G*VC80604B*B*		45,500	34,200	15.50	12.00	1,400	5188315	
CHPF4860D6D*+TXV	A*VM971005CNA*		46,000	34,600	15.50	12.00	1,400	7369799	
CHPF4860D6D*+TXV	A*VM971205DNA*		47,000	35,200	15.50	12.00	1,450	7369804	
CSCF4860N6D*+EEP+TXV			48,000	36,000	14.50	12.00	1,675	5357233	
CSCF4860N6D*+TXV	G*VC960804CNA*		45,500	34,200	15.00	12.00	1,400	7369579	
CSCF4860N6D*+TXV	G*VM971205DNA*		46,000	34,600	15.50	12.00	1,450	7369657	

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
ASXC16 0481B* (cont.)	CSCF4860N6D*+TXV	G*VM970804CNA*	45,500	34,200	15.00	12.00	1,400	7369647
	CSCF4860N6D*+TXV	A*VC960804CNA*	45,500	34,200	15.00	12.00	1,400	7369726
	CSCF4860N6D*+TXV	G*VC961205DNA*	46,000	34,600	15.50	12.00	1,450	7369589
	CSCF4860N6D*+TXV	A*VC961005CNA*	45,500	34,200	15.00	12.00	1,400	7369731
	CSCF4860N6D*+TXV	A*VM971005CNA*	45,500	34,200	15.00	12.00	1,400	7369800
	CSCF4860N6D*+TXV	G*VM971005CNA*	45,500	34,200	15.00	12.00	1,400	7369652
	CSCF4860N6D*+TXV	A*VC961205DNA*	46,000	34,600	15.50	12.00	1,450	7369736
	CSCF4860N6D*+TXV	A*VM970804CNA*	45,500	34,200	15.00	12.00	1,400	7369795
	CSCF4860N6D*+TXV	A*VM971205DNA*	46,000	34,600	15.50	12.00	1,450	7369805
CSCF4860N6D*+TXV	G*VC961005CNA*	45,500	34,200	15.00	12.00	1,400	7369584	
ASXC16 0601B*	AVPTC60D14A*		57,000	42,500	15.50	12.00	1,780	5924392
	CA*F4860*6D*+MBVC2000**-1A*+TXV		55,500	41,000	15.50	12.00	1,800	3881374
	CA*F4860*6D*+TXV	A*VM961155DXB*	55,500	41,000	15.50	12.00	1,575	5624021
	CA*F4860*6D*+TXV	A*VM970804CNA*	55,000	41,000	15.00	11.50	1,550	7369806
	CA*F4860*6D*+TXV	G*VM960805DXB*	55,500	41,000	15.50	11.50	1,575	5624012
	CA*F4860*6D*+TXV	A*VM960805DXB*	55,500	41,000	15.50	11.50	1,575	5624011
	CA*F4860*6D*+TXV	ADVC81005C*B*	55,500	41,000	15.50	12.00	1,550	5188409
	CA*F4860*6D*+TXV	G*VC961005CNA*	55,000	41,000	15.00	11.50	1,600	7369595
	CA*F4860*6D*+TXV	A*VC81005C*B*	55,500	41,000	15.50	12.00	1,610	5188319
	CA*F4860*6D*+TXV	G*VM971005CNA*	55,000	41,000	15.00	11.50	1,600	7369663
	CA*F4860*6D*+TXV	G*VM971205DNA*	55,000	41,000	15.50	12.00	1,600	7369668
	CA*F4860*6D*+TXV	G*VM970804CNA*	55,000	41,000	15.00	11.50	1,550	7369658
	CA*F4860*6D*+TXV	A*VC950905DXB*	55,500	41,000	15.50	12.00	1,575	5623991
	CA*F4860*6D*+TXV	G*VC81005C*B*	55,500	41,000	15.50	12.00	1,610	5188321
	CA*F4860*6D*+TXV	A*VC950915DXB*	55,500	41,000	15.50	11.50	1,575	5623997
	CA*F4860*6D*+TXV	A*VM971005CNA*	55,000	41,000	15.00	11.50	1,600	7369811
	CA*F4860*6D*+TXV	ADVC80805C*B*	55,500	41,000	15.50	12.00	1,580	5188383
	CA*F4860*6D*+TXV	A*VC951155DXB*	55,500	41,000	15.50	12.00	1,575	5623999
	CA*F4860*6D*+TXV	A*VC960804CNA*	55,000	41,000	15.00	11.50	1,550	7369737
	CA*F4860*6D*+TXV	G*VC950915DXB*	55,500	41,000	15.50	11.50	1,575	5623998
	CA*F4860*6D*+TXV	A*VC950905CXB*	55,500	41,000	15.00	11.50	1,575	5623985
	CA*F4860*6D*+TXV	A*VC80805C*B*	55,500	41,000	15.50	12.00	1,590	5188318
	CA*F4860*6D*+TXV	A*VC961005CNA*	55,000	41,000	15.00	11.50	1,600	7369742
	CA*F4860*6D*+TXV	G*VC91155DXA*	55,500	41,000	15.50	12.00	1,575	3881442
	CA*F4860*6D*+TXV	G*VC960804CNA*	55,000	41,000	15.00	11.50	1,550	7369590
	CA*F4860*6D*+TXV	G*VC961205DNA*	55,000	41,000	15.50	12.00	1,600	7369600
	CA*F4860*6D*+TXV	G*VC950905CXB*	55,500	41,000	15.00	11.50	1,575	5623986
	CA*F4860*6D*+TXV	G*VC951155DXB*	55,500	41,000	15.50	12.00	1,575	5624000
	CA*F4860*6D*+TXV	G*VM960805CXB*	55,500	41,000	15.00	11.50	1,575	5624006
	CA*F4860*6D*+TXV	G*VC950905DXB*	55,500	41,000	15.50	12.00	1,575	5623992
	CA*F4860*6D*+TXV	A*VC961205DNA*	55,000	41,000	15.50	12.00	1,600	7369747
	CA*F4860*6D*+TXV	G*VC80805C*B*	55,500	41,000	15.50	12.00	1,590	5188320
	CA*F4860*6D*+TXV	A*VM971205DNA*	55,000	41,000	15.50	12.00	1,600	7369816
CA*F4860*6D*+TXV	G*VM961005DXB*	55,500	41,000	15.50	12.00	1,575	5624016	
CA*F4860*6D*+TXV	A*VM961005DXB*	55,500	41,000	15.50	12.00	1,575	5624015	
CA*F4860*6D*+TXV	G*VM961155DXB*	55,500	41,000	15.50	12.00	1,575	5624022	
CA*F4860*6D*+TXV	A*VM960805CXB*	55,500	41,000	15.00	11.50	1,575	5624005	
CA*F4961*6D*+EEP+TXV		56,000	41,500	14.00	11.80	1,550	5357234	
CA*F4961*6D*+MBVC2000**-1A*+TXV		57,000	42,500	16.00	12.30	1,800	4431409	
CA*F4961*6D*+TXV	G*VC950905CXB*	56,000	41,500	15.50	11.50	1,575	5623988	
CA*F4961*6D*+TXV	ADVC81005C*B*	56,000	41,500	15.50	12.00	1,550	5188421	
CA*F4961*6D*+TXV	G*VM960805DXB*	56,000	41,500	15.50	12.30	1,575	6498285	
CA*F4961*6D*+TXV	G*VC950905DXB*	56,000	41,500	15.50	12.30	1,575	5623994	
CA*F4961*6D*+TXV	G*VC961005CNA*	55,000	41,000	15.50	11.50	1,600	7369596	
CA*F4961*6D*+TXV	A*VC961205DNA*	55,000	41,000	15.50	12.00	1,600	7369748	
CA*F4961*6D*+TXV	G*EC961205DNA*	56,000	41,500	15.50	11.50	1,520	7368333	

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
ASXC16 0601B* (cont.)	CA*F4961*6D*+TXV	G*VM960805CXB*	56,000	41,500	15.50	11.50	1,575	5624008
	CA*F4961*6D*+TXV	A*VC950905CXB*	56,000	41,500	15.50	11.50	1,575	5623987
	CA*F4961*6D*+TXV	A*VM960805CXB*	56,000	41,500	15.50	11.50	1,575	5624007
	CA*F4961*6D*+TXV	A*VM970804CNA*	55,000	41,000	15.50	11.50	1,550	7369807
	CA*F4961*6D*+TXV	A*VC951155DXB*	56,000	41,500	15.50	12.00	1,575	5624001
	CA*F4961*6D*+TXV	A*VM960805DXB*	56,000	41,500	15.50	12.30	1,575	6498283
	CA*F4961*6D*+TXV	A*VC81005C*B*	56,000	41,500	15.50	12.00	1,610	5188323
	CA*F4961*6D*+TXV	G*VM970804CNA*	55,000	41,000	15.50	11.50	1,550	7369659
	CA*F4961*6D*+TXV	G*VC960804CNA*	55,000	41,000	15.50	11.50	1,550	7369591
	CA*F4961*6D*+TXV	A*VM961005DXB*	56,000	41,500	15.50	12.00	1,575	5624017
	CA*F4961*6D*+TXV	G*VC81005C*B*	56,000	41,500	15.50	12.00	1,610	5188325
	CA*F4961*6D*+TXV	A*VC80805C*B*	56,000	41,500	15.50	12.30	1,590	5188322
	CA*F4961*6D*+TXV	A*VM961155DXB*	56,000	41,500	15.50	12.00	1,575	5624023
	CA*F4961*6D*+TXV	A*VC950915DXB*	56,000	41,500	15.50	12.30	1,575	6498282
	CA*F4961*6D*+TXV	G*VM961155DXB*	56,000	41,500	15.50	12.00	1,575	5624024
	CA*F4961*6D*+TXV	A*VM971205DNA*	55,000	41,000	15.50	12.00	1,600	7369817
	CA*F4961*6D*+TXV	A*VC950905DXB*	56,000	41,500	15.50	12.30	1,575	5623993
	CA*F4961*6D*+TXV	G*VM961005DXB*	56,000	41,500	15.50	12.00	1,575	5624018
	CA*F4961*6D*+TXV	A*EC961205DNA*	56,000	41,500	15.50	11.50	1,520	7368382
	CA*F4961*6D*+TXV	G*VM971005CNA*	55,000	41,000	15.50	11.50	1,600	7369664
	CA*F4961*6D*+TXV	G*VC951155DXB*	56,000	41,500	15.50	12.00	1,575	5624002
	CA*F4961*6D*+TXV	G*VC91155DXA*	56,000	41,500	15.50	12.00	1,575	4431454
	CA*F4961*6D*+TXV	G*VM971205DNA*	55,000	41,000	15.50	12.00	1,600	7369669
	CA*F4961*6D*+TXV	G*VC80805C*B*	56,000	41,500	15.50	12.30	1,590	5188324
	CA*F4961*6D*+TXV	A*VM971005CNA*	55,000	41,000	15.50	11.50	1,600	7369812
	CA*F4961*6D*+TXV	G*VC961205DNA*	55,000	41,000	15.50	12.00	1,600	7369601
	CA*F4961*6D*+TXV	A*VC961005CNA*	55,000	41,000	15.50	11.50	1,600	7369743
	CA*F4961*6D*+TXV	ADVC80805C*B*	56,000	41,500	15.50	12.30	1,580	5188439
	CA*F4961*6D*+TXV	A*VC960804CNA*	55,000	41,000	15.50	11.50	1,550	7369738
	CA*F4961*6D*+TXV	G*VC950915DXB*	56,000	41,500	15.50	12.30	1,575	6498284
	CAPT4961*4A*	A*VC961005CNA*	55,000	41,000	15.00	11.50	1,600	7369744
	CAPT4961*4A*	G*VM970804CNA*	55,000	41,000	15.00	11.50	1,550	7369660
	CAPT4961*4A*	A*VM971005CNA*	55,000	41,000	15.00	11.50	1,600	7369813
	CAPT4961*4A*	A*VC960804CNA*	55,000	41,000	15.00	11.50	1,550	7369739
	CAPT4961*4A*	A*VM971205DNA*	55,000	41,000	15.00	12.00	1,600	7369818
	CAPT4961*4A*	G*VM971205DNA*	55,000	41,000	15.00	12.00	1,600	7369670
	CAPT4961*4A*	G*VM971005CNA*	55,000	41,000	15.00	11.50	1,600	7369665
	CAPT4961*4A*	A*EC961205DNA*	56,000	41,500	15.00	11.50	1,520	7368385
	CAPT4961*4A*	G*VC961005CNA*	55,000	41,000	15.00	11.50	1,600	7369597
	CAPT4961*4A*	A*VC961205DNA*	55,000	41,000	15.00	12.00	1,600	7369749
	CAPT4961*4A*	G*VC960804CNA*	55,000	41,000	15.00	11.50	1,550	7369592
	CAPT4961*4A*	G*VC961205DNA*	55,000	41,000	15.00	12.00	1,600	7369602
	CAPT4961*4A*	G*EC961205DNA*	56,000	41,500	15.00	11.50	1,520	7368334
	CAPT4961*4A*	A*VM970804CNA*	55,000	41,000	15.00	11.50	1,550	7369808
	CHPF4860D6D*+EEP+TXV		56,000	41,500	14.00	11.80	1,550	5357235
	CHPF4860D6D*+MBVC2000**-1A*+TXV		57,000	42,500	15.50	12.30	1,800	3798683
	CHPF4860D6D*+TXV	G*VM961155DXB*	56,000	41,500	15.50	12.00	1,575	5624026
CHPF4860D6D*+TXV	G*VM960805DXB*	56,000	41,500	15.50	11.50	1,575	5624014	
CHPF4860D6D*+TXV	G*VC80805C*B*	56,000	41,500	15.50	12.30	1,590	5188328	
CHPF4860D6D*+TXV	A*VC960804CNA*	55,000	41,000	15.50	11.50	1,550	7369740	
CHPF4860D6D*+TXV	A*VM961155DXB*	56,000	41,500	15.50	12.00	1,575	5624025	
CHPF4860D6D*+TXV	G*VC951155DXB*	56,000	41,500	15.50	12.00	1,575	5624004	
CHPF4860D6D*+TXV	A*VC81005C*B*	56,000	41,500	15.50	12.00	1,610	5188327	
CHPF4860D6D*+TXV	A*EC961205DNA*	56,000	41,500	15.50	11.50	1,520	7368386	
CHPF4860D6D*+TXV	A*VM960805CXB*	56,000	41,500	15.50	11.50	1,575	5624009	
CHPF4860D6D*+TXV	G*VC81005C*B*	56,000	41,500	15.50	12.00	1,610	5188329	

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
ASXC16 0601B* (cont.)	CHPF4860D6D*+TXV	A*VC961005CNA*	55,000	41,000	15.50	11.50	1,600	7369745
	CHPF4860D6D*+TXV	G*VM970804CNA*	55,000	41,000	15.50	11.50	1,550	7369661
	CHPF4860D6D*+TXV	G*VC950905CXB*	56,000	41,500	15.50	11.50	1,575	5623990
	CHPF4860D6D*+TXV	G*VC961205DNA*	55,000	41,000	15.50	12.00	1,600	7369603
	CHPF4860D6D*+TXV	A*VM971205DNA*	55,000	41,000	15.50	12.00	1,600	7369819
	CHPF4860D6D*+TXV	A*VM961005DXB*	56,000	41,500	15.50	12.00	1,575	5624019
	CHPF4860D6D*+TXV	G*VC961005CNA*	55,000	41,000	15.50	11.50	1,600	7369598
	CHPF4860D6D*+TXV	A*VM960805DXB*	56,000	41,500	15.50	11.50	1,575	5624013
	CHPF4860D6D*+TXV	A*VM971005CNA*	55,000	41,000	15.50	11.50	1,600	7369814
	CHPF4860D6D*+TXV	G*VC950905DXB*	56,000	41,500	15.50	12.30	1,575	5623996
	CHPF4860D6D*+TXV	A*VM970804CNA*	55,000	41,000	15.50	11.50	1,550	7369809
	CHPF4860D6D*+TXV	A*VC950905CXB*	56,000	41,500	15.50	11.50	1,575	5623989
	CHPF4860D6D*+TXV	A*VC961205DNA*	55,000	41,000	15.50	12.00	1,600	7369750
	CHPF4860D6D*+TXV	A*VC951155DXB*	56,000	41,500	15.50	12.00	1,575	5624003
	CHPF4860D6D*+TXV	G*VM960805CXB*	56,000	41,500	15.50	11.50	1,575	5624010
	CHPF4860D6D*+TXV	G*VM971005CNA*	55,000	41,000	15.50	11.50	1,600	7369666
	CHPF4860D6D*+TXV	G*VM971205DNA*	55,000	41,000	15.50	12.00	1,600	7369671
	CHPF4860D6D*+TXV	G*EC961205DNA*	56,000	41,500	15.50	11.50	1,520	7368335
	CHPF4860D6D*+TXV	G*VM961005DXB*	56,000	41,500	15.50	12.00	1,575	5624020
	CHPF4860D6D*+TXV	G*VC960804CNA*	55,000	41,000	15.50	11.50	1,550	7369593
	CHPF4860D6D*+TXV	A*VC80805C*B*	56,000	41,500	15.50	12.30	1,590	5188326
	CHPF4860D6D*+TXV	A*VC950905DXB*	56,000	41,500	15.50	12.30	1,575	5623995
	CSCF4860N6D*+EEP+TXV		56,000	41,500	14.00	11.80	1,550	5357236
	CSCF4860N6D*+TXV	A*VC961205DNA*	55,000	41,000	15.00	12.00	1,600	7369751
	CSCF4860N6D*+TXV	G*VM970804CNA*	55,000	41,000	15.00	11.50	1,550	7369662
	CSCF4860N6D*+TXV	A*VC960804CNA*	55,000	41,000	15.00	11.50	1,550	7369741
	CSCF4860N6D*+TXV	G*VC961205DNA*	55,000	41,000	15.00	12.00	1,600	7369604
	CSCF4860N6D*+TXV	G*VC960804CNA*	55,000	41,000	15.00	11.50	1,550	7369594
	CSCF4860N6D*+TXV	G*VM971205DNA*	55,000	41,000	15.00	12.00	1,600	7369672
	CSCF4860N6D*+TXV	G*VM971005CNA*	55,000	41,000	15.00	11.50	1,600	7369667
CSCF4860N6D*+TXV	A*VM971205DNA*	55,000	41,000	15.00	12.00	1,600	7369820	
CSCF4860N6D*+TXV	G*VC961005CNA*	55,000	41,000	15.00	11.50	1,600	7369599	
CSCF4860N6D*+TXV	A*VM970804CNA*	55,000	41,000	15.00	11.50	1,550	7369810	
CSCF4860N6D*+TXV	A*VM971005CNA*	55,000	41,000	15.00	11.50	1,600	7369815	
CSCF4860N6D*+TXV	A*VC961005CNA*	55,000	41,000	15.00	11.50	1,600	7369746	

¹ BTU/h


² Seasonal Energy Efficiency Ratio; Certified per AHRI 210/240 @ 80°F/ 67°F/ 95°F

³ Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- When matching outdoor unit to indoor unit, use the piston supplied with the outdoor unit or that specified on the piston kit chart supplied with the indoor unit.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The Goodman Gas Furnace contains the EEP cooling time delay

WIRING DIAGRAM

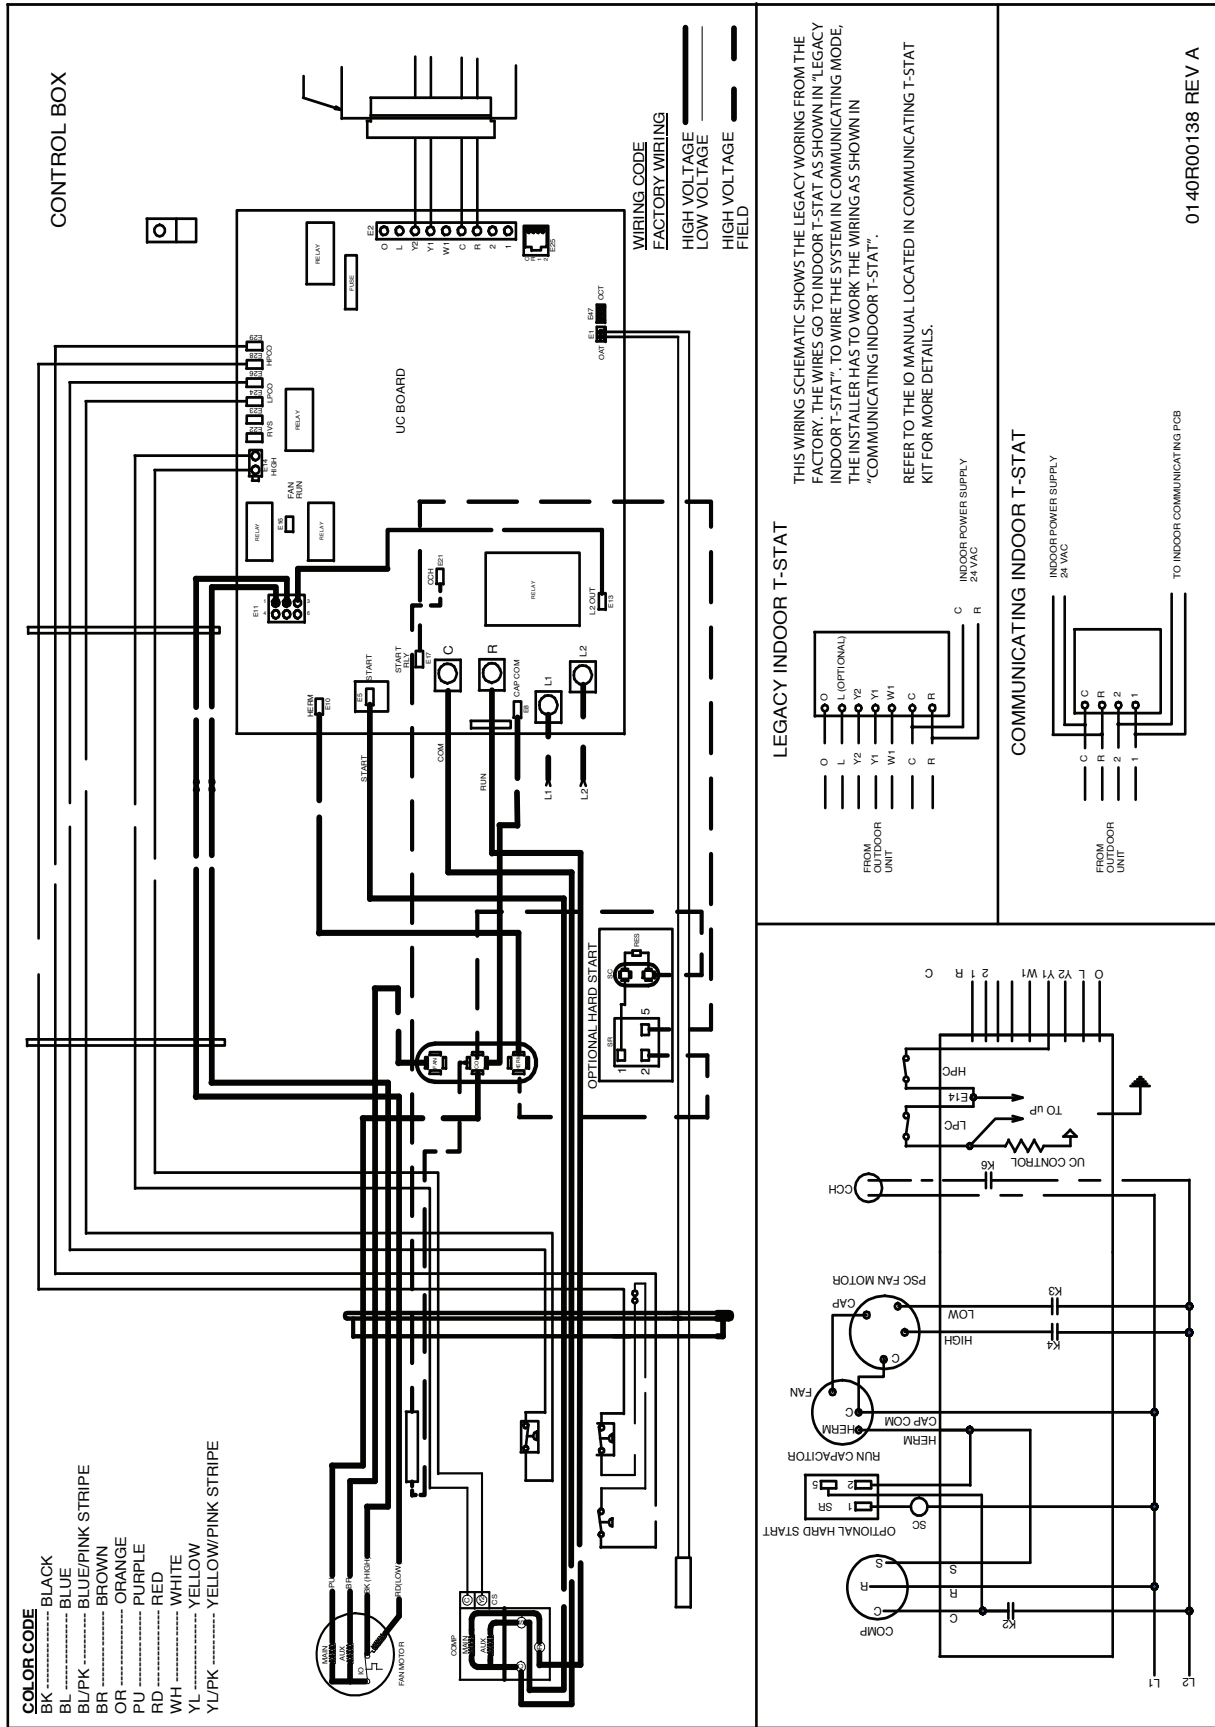

01 40R00138 REV A




High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.



Wiring is subject to change. Always refer to the wiring diagram or the unit for the most up-to-date wiring.

DIMENSIONS

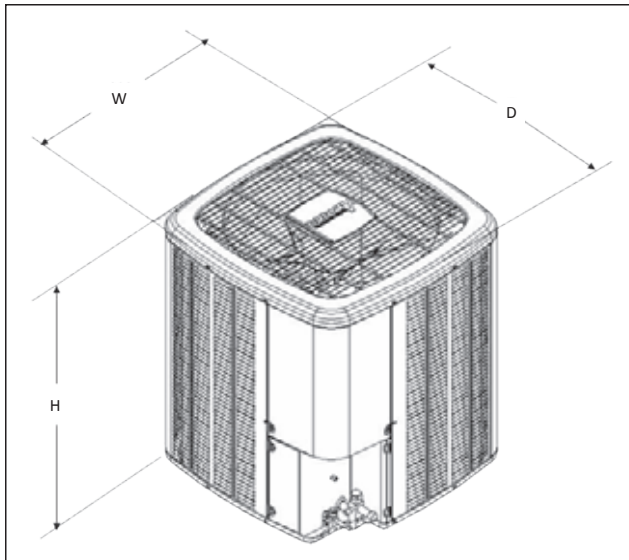

MODEL	DIMENSIONS		
	W"	D"	H"
ASXC160241**	29	29	32¼
ASXC160361**	29	29	32¼
ASXC160481A*	35½	35½	38¼
ASXC160481B*	35½	35½	36¼
ASXC160601**	35½	35½	38¼

ACCESSORIES

MODEL	DESCRIPTION	ASXC16 024	ASXC16 036	ASXC16 048	ASXC16 060
ABK-20	Anchor Bracket Kit [^]	X	X	X	X
ASC-01	Anti-Short Cycle Kit	X	X	X	X
B1141643 ¹	24V Transformer	X	X	X	X
CSR-U-1	Hard-start Kit	X		X	
CSR-U-2	Hard-start Kit		X		
CSR-U-3	Hard-start Kit				X
FSK01A ²	Freeze Protection Kit	X	X	X	X
LSK02A	Liquid Line Solenoid Valve	X	X	X	X
OT18-60A ³	Outdoor Thermostat/Lockout Thermostat	X	X	X	X
TX2N4	TXV Kit				
TX2N4A	TXV Kit	X			
TX3N4 ⁴	TXV Kit		X		
TX5N4	TXV Kit			X	X

[^] Contains 20 brackets; four brackets needed to anchor unit to pad

¹ This component is included in the CTK01AA communicating thermostat kit.

² Installed on indoor coil

³ Available in 24V legacy mode only. This feature is integrated in the communicating mode.

Note: Maximum number of installed accessories at the same time is limited by the size of the unit's control box.